


11  
11  
11  
11

11  
11  
11  
11

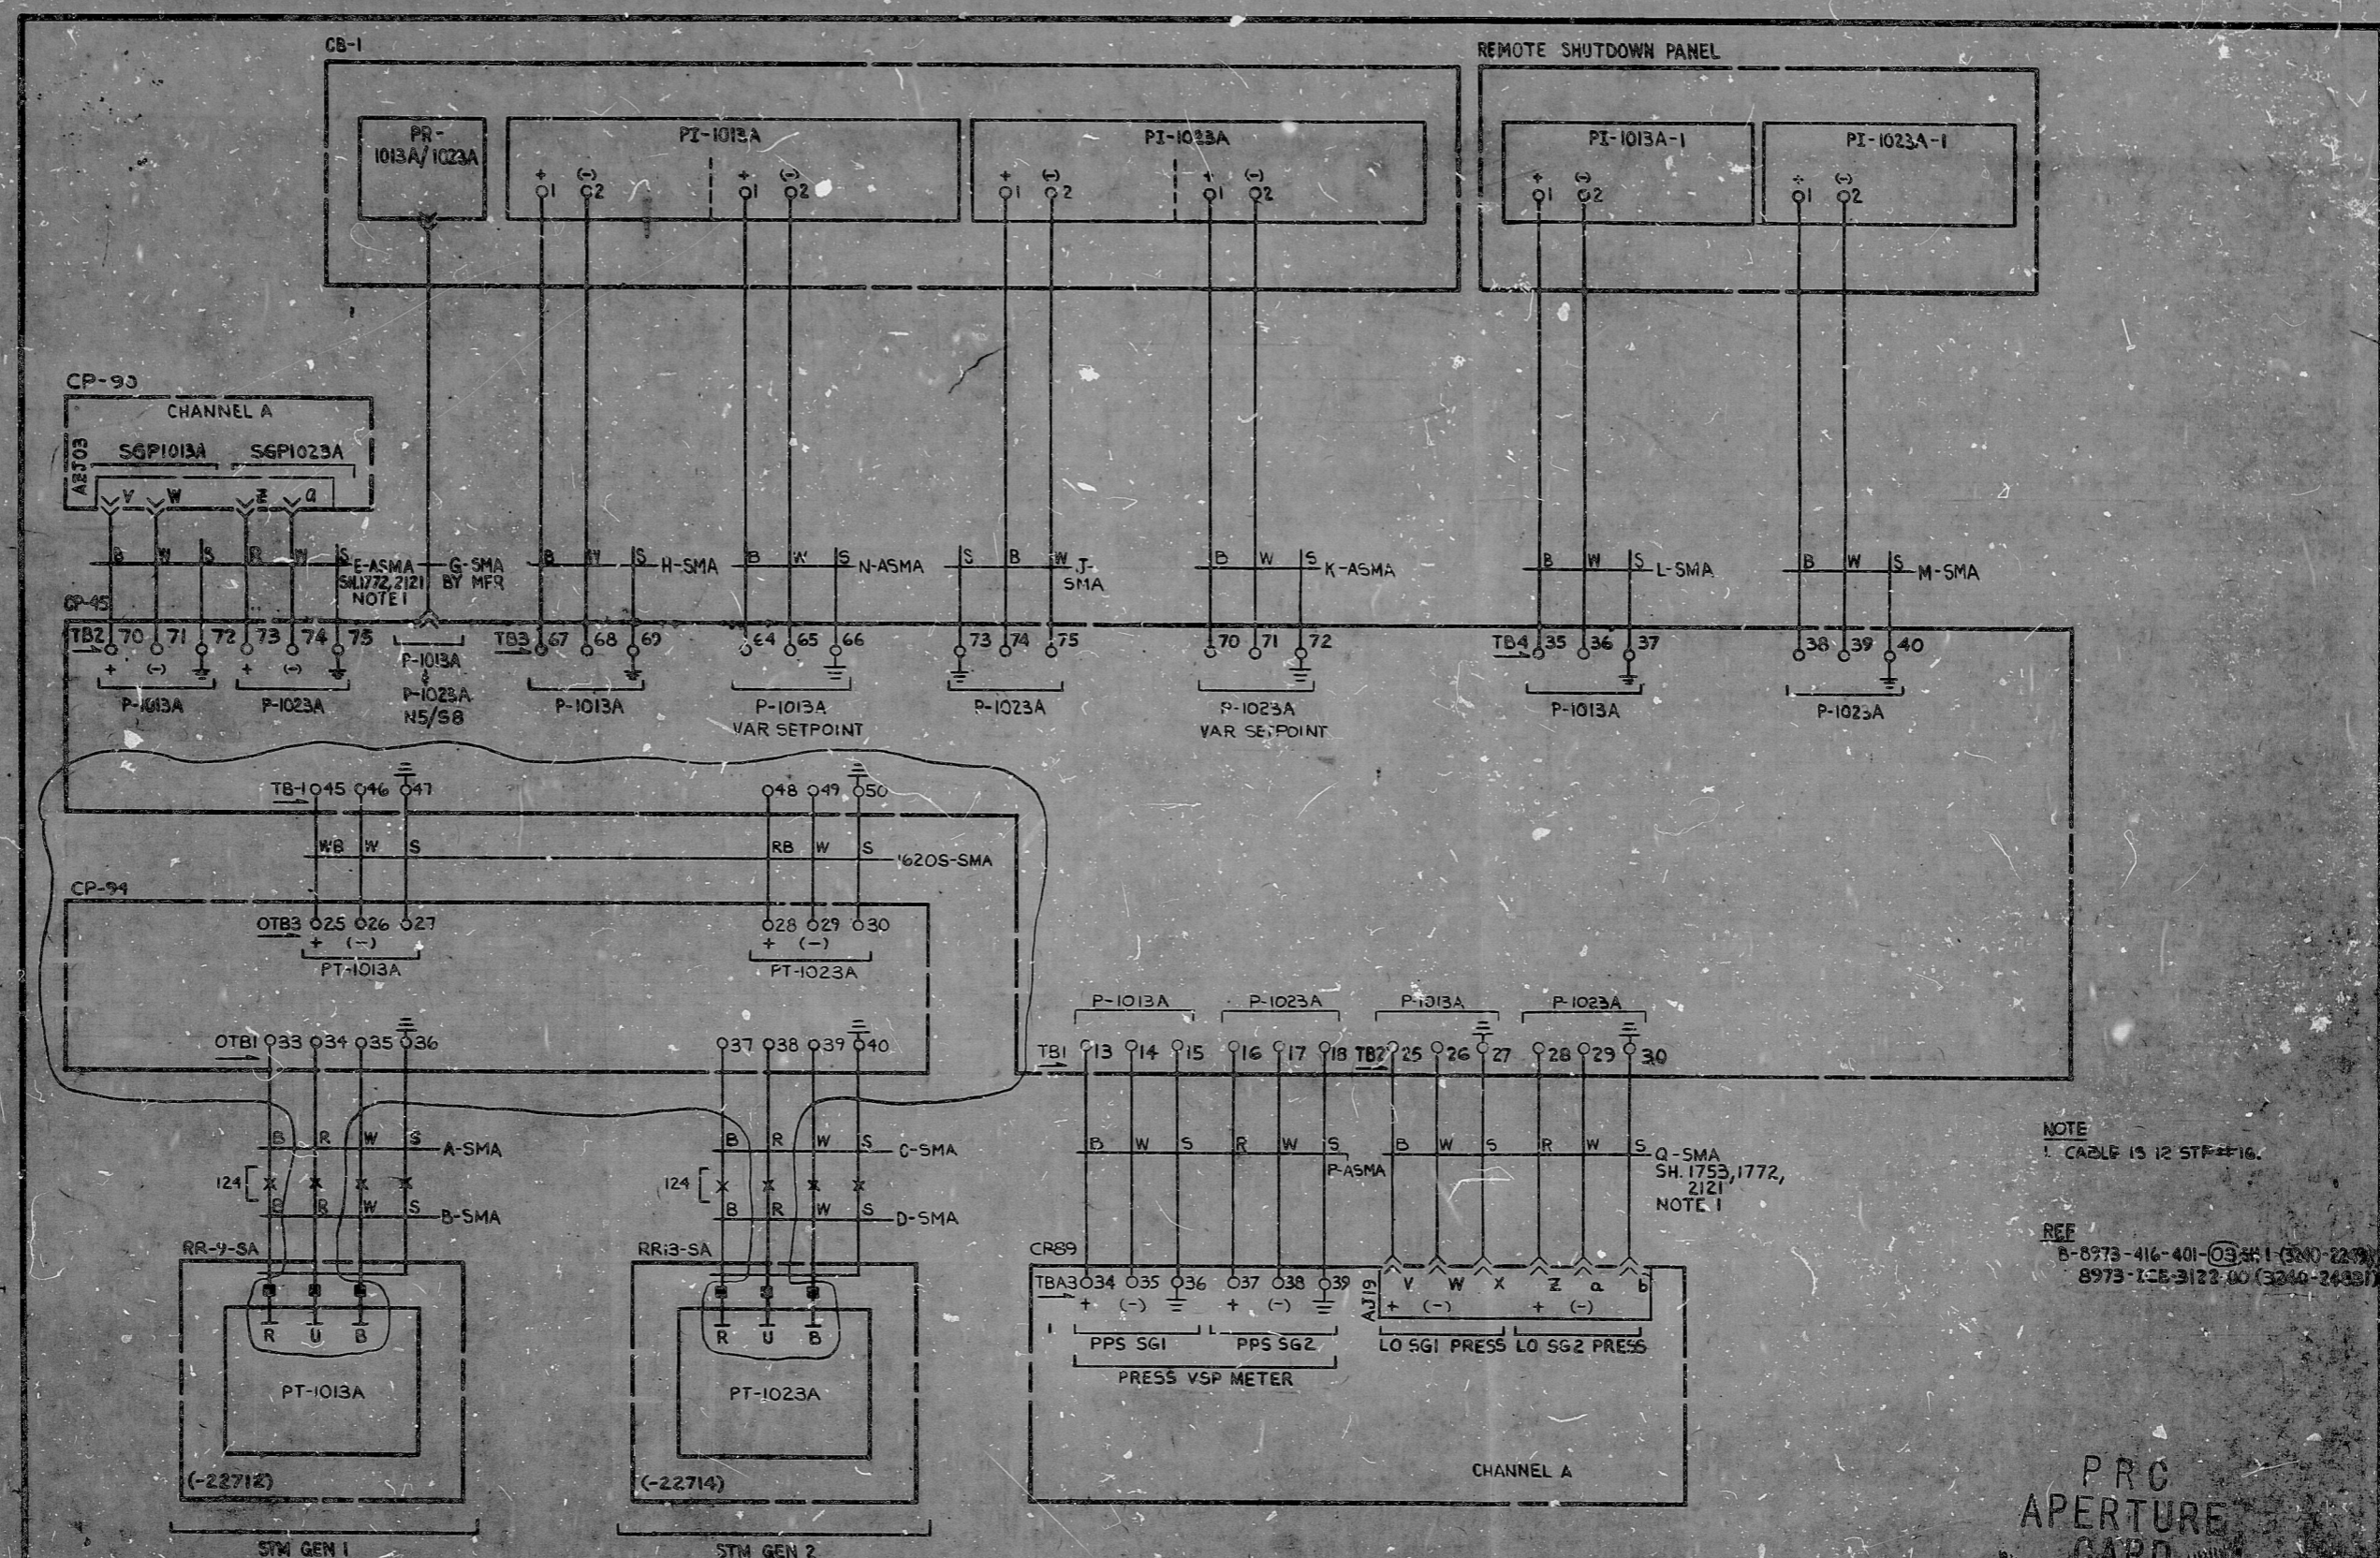

NOTE  
1. CABLE IS 12 STR #16.

REF  
E-8973-416-401-0341 (REV. 2-77)  
8973-1-5-3122-00 (3340-2438)

PROC  
APERTURE  
CARD

11  
11  
11  
11

8.5  
11  
17

NUCLEAR SAFETY RELATED    WFP QUALITY CONTROL

ERASCO SERVICES INCORPORATED				WASHINGTON FIELD OFFICE			
DIV. CONTROL OR R.G.HAINES				NUCLEAR POWER PLANT			
CH. E. DVALLS				CONTROL ROOM			
DATE: APR 15, 1977				STREAM GENERATOR			
				MEAS. CH. P-1013A			

RIDS

8303210057

