


WPPS-3240 G-5015

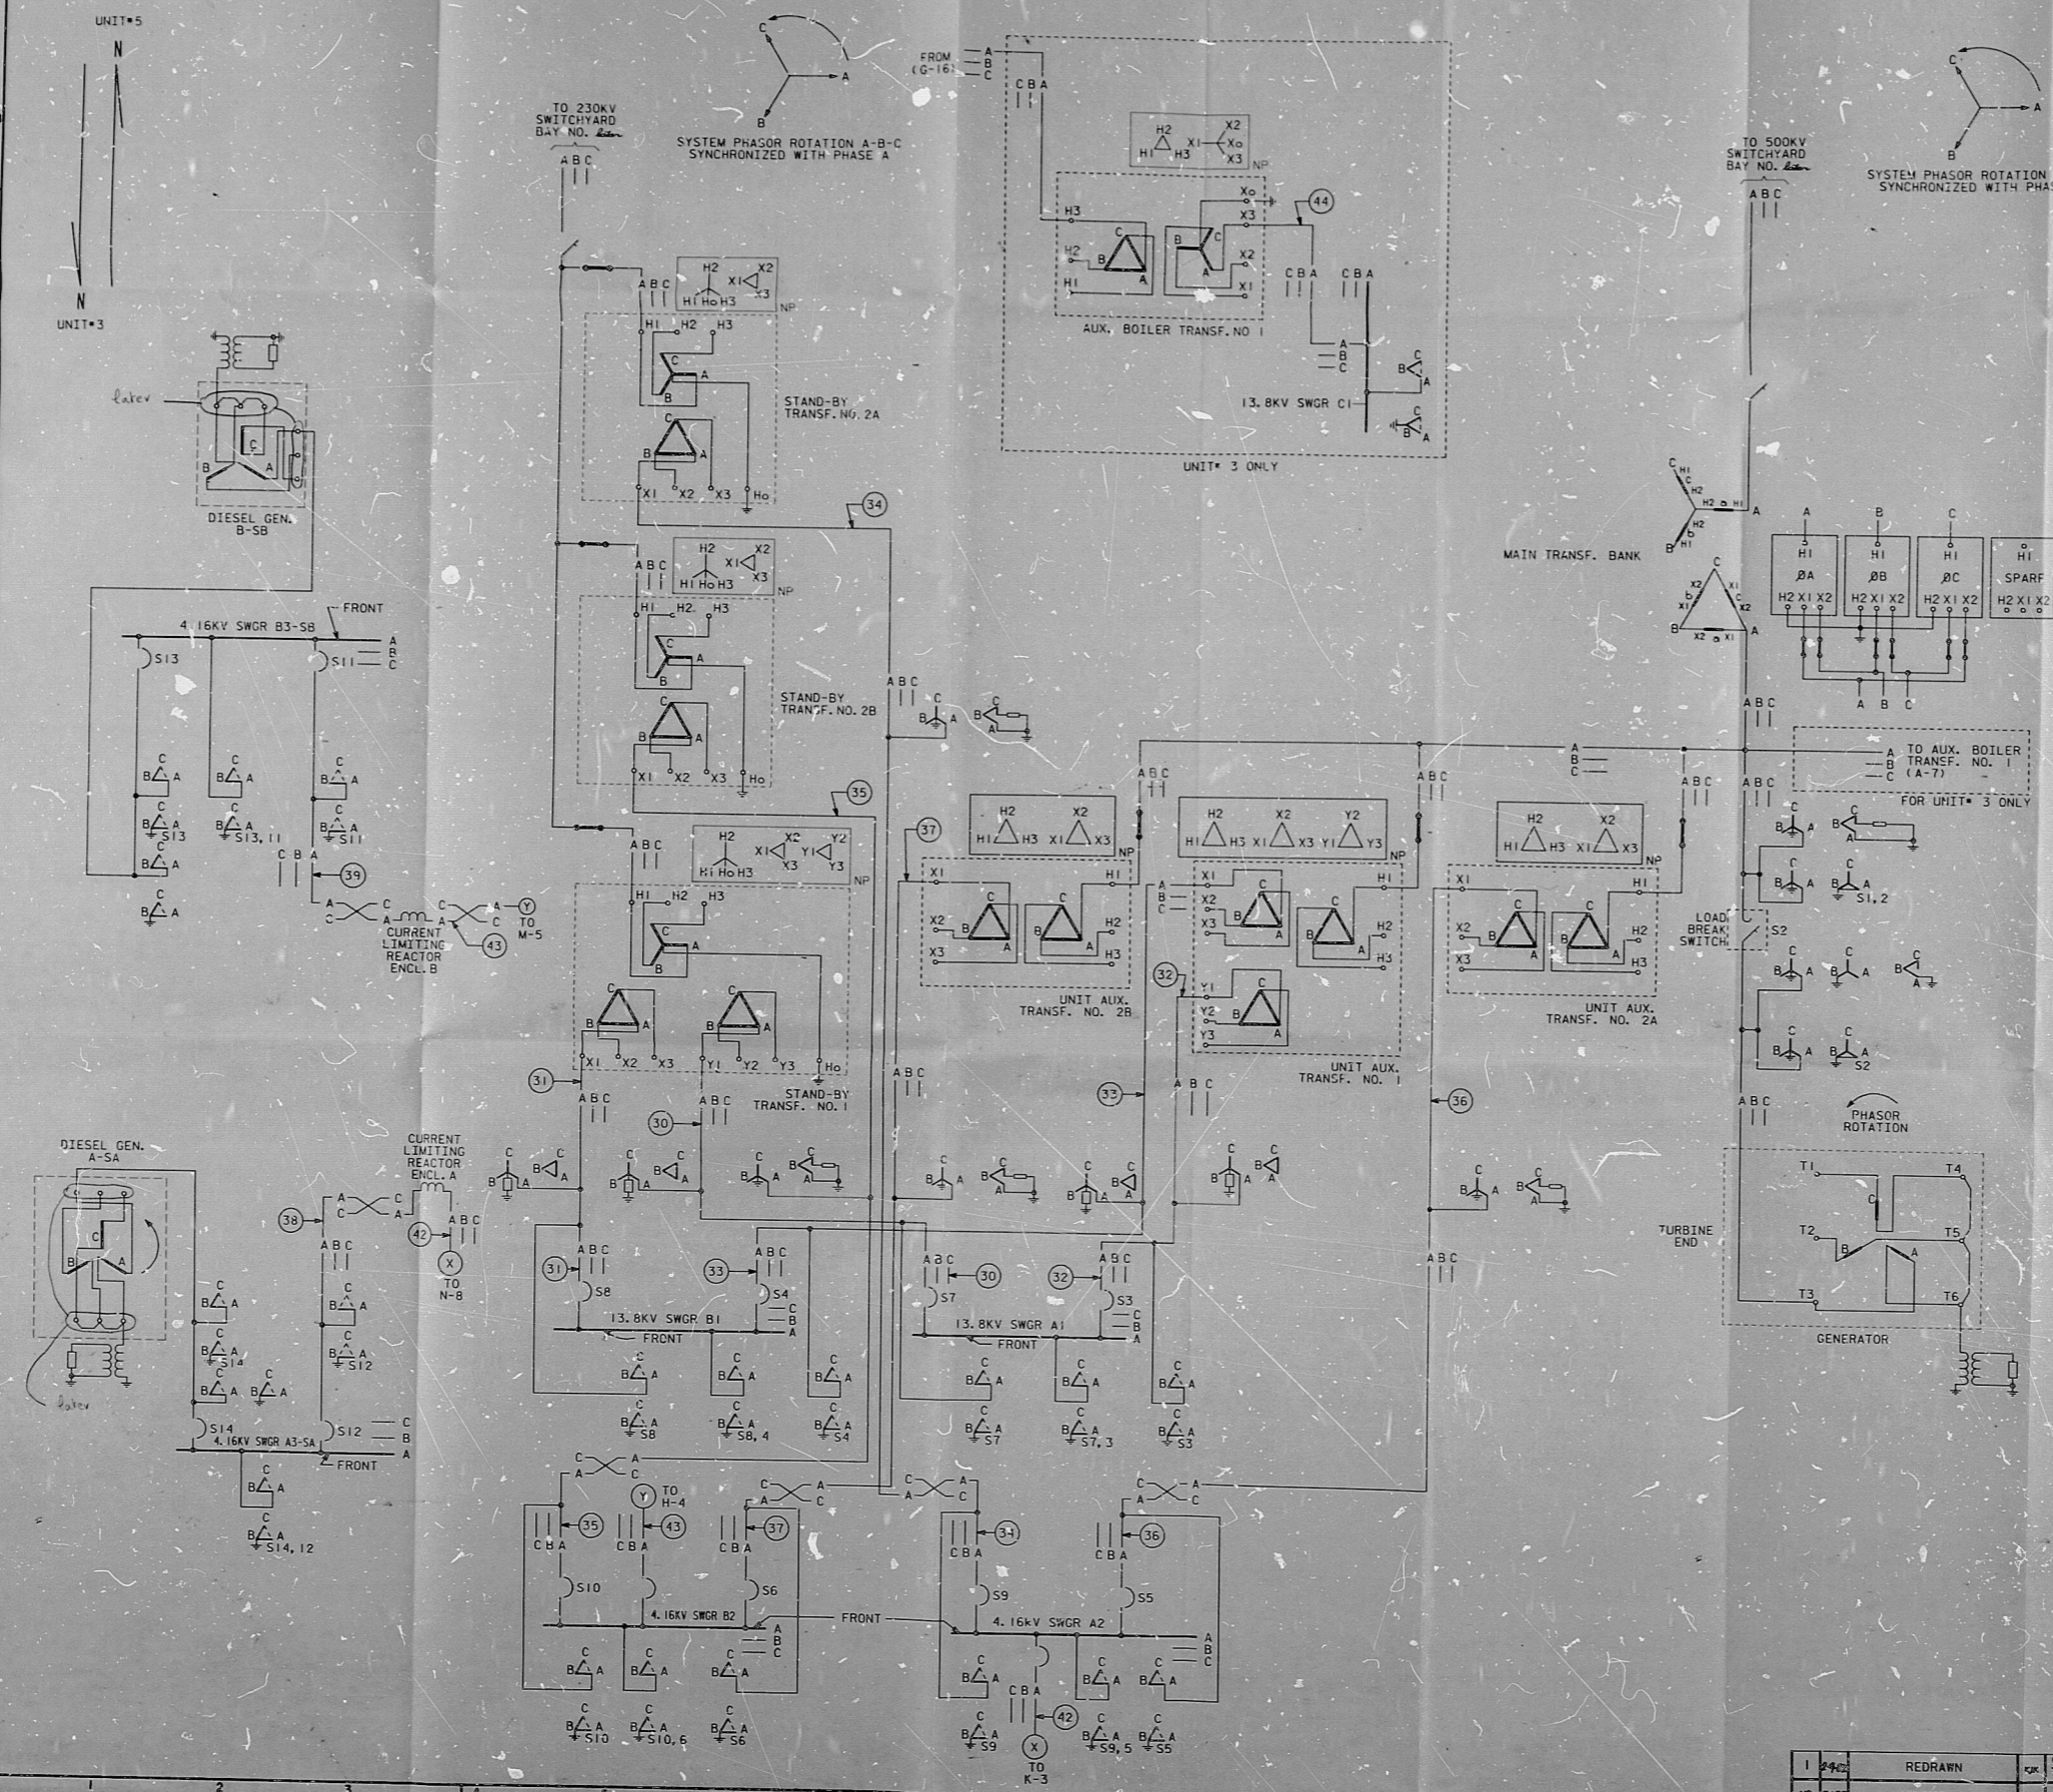

SYMBOLS

- DISCONNECT LINK
- (30) DENOTES NONSEG. PHASE BUS NO. 30

NOTES

- THE LETTER AL JACENT TO THE VOLTAGE PHASOR INDICATES PHASOR USED FOR SYNCHRONIZING. S1 IS FOR SYNCHRONIZING ACROSS 500KV SWITCHYARD.
- NP - MANUFACTURER'S NAMEPLATE VOLTAGE VECTOR DIAGRAM.
- DIESEL GENERATOR IS CONNECTED TO SWITCHGEAR BY CABLE.

REFERENCE DRAWINGS

- MAIN ONE LINE DIAGRAM SH. 1 G-5003
- MAIN ONE LINE DIAGRAM SH. 2 G-5004
- AUXILIARY BOILER ONE LINE DIAGRAM G-5007

WPPSS QUALITY CLASS I, II

NUCLEAR SAFETY RELATED

WASHINGTON PUBLIC POWER SUPPLY SYSTEM
 NUCLEAR PROJECTS NO. 3 & 5
 1981-1300 MW INSTALLATION
 1983-1300 MW INSTALLATION
 PHASOR DIAGRAM

EBASCO SERVICES INCORPORATED

SCALE NONE APPROVED DATE 6-13-75
 DIV. ELEC. ORIGINAL WORK
 DR. R. KAEDACH SIGNED BY J. [unclear]
 DR. [unclear] SIGNED BY [unclear]

NO.	DATE	REVISION	BY	CHK.	APPROVED	DATE
1	2-24-72	REDRAWN	SW	[unclear]	[unclear]	

PRC APERTURE CARD



RIDS

8303210138

