

34

34

22

22

17

17

11

11

8.5

8.5

8.5

8.5

11


11

17

17

22

22

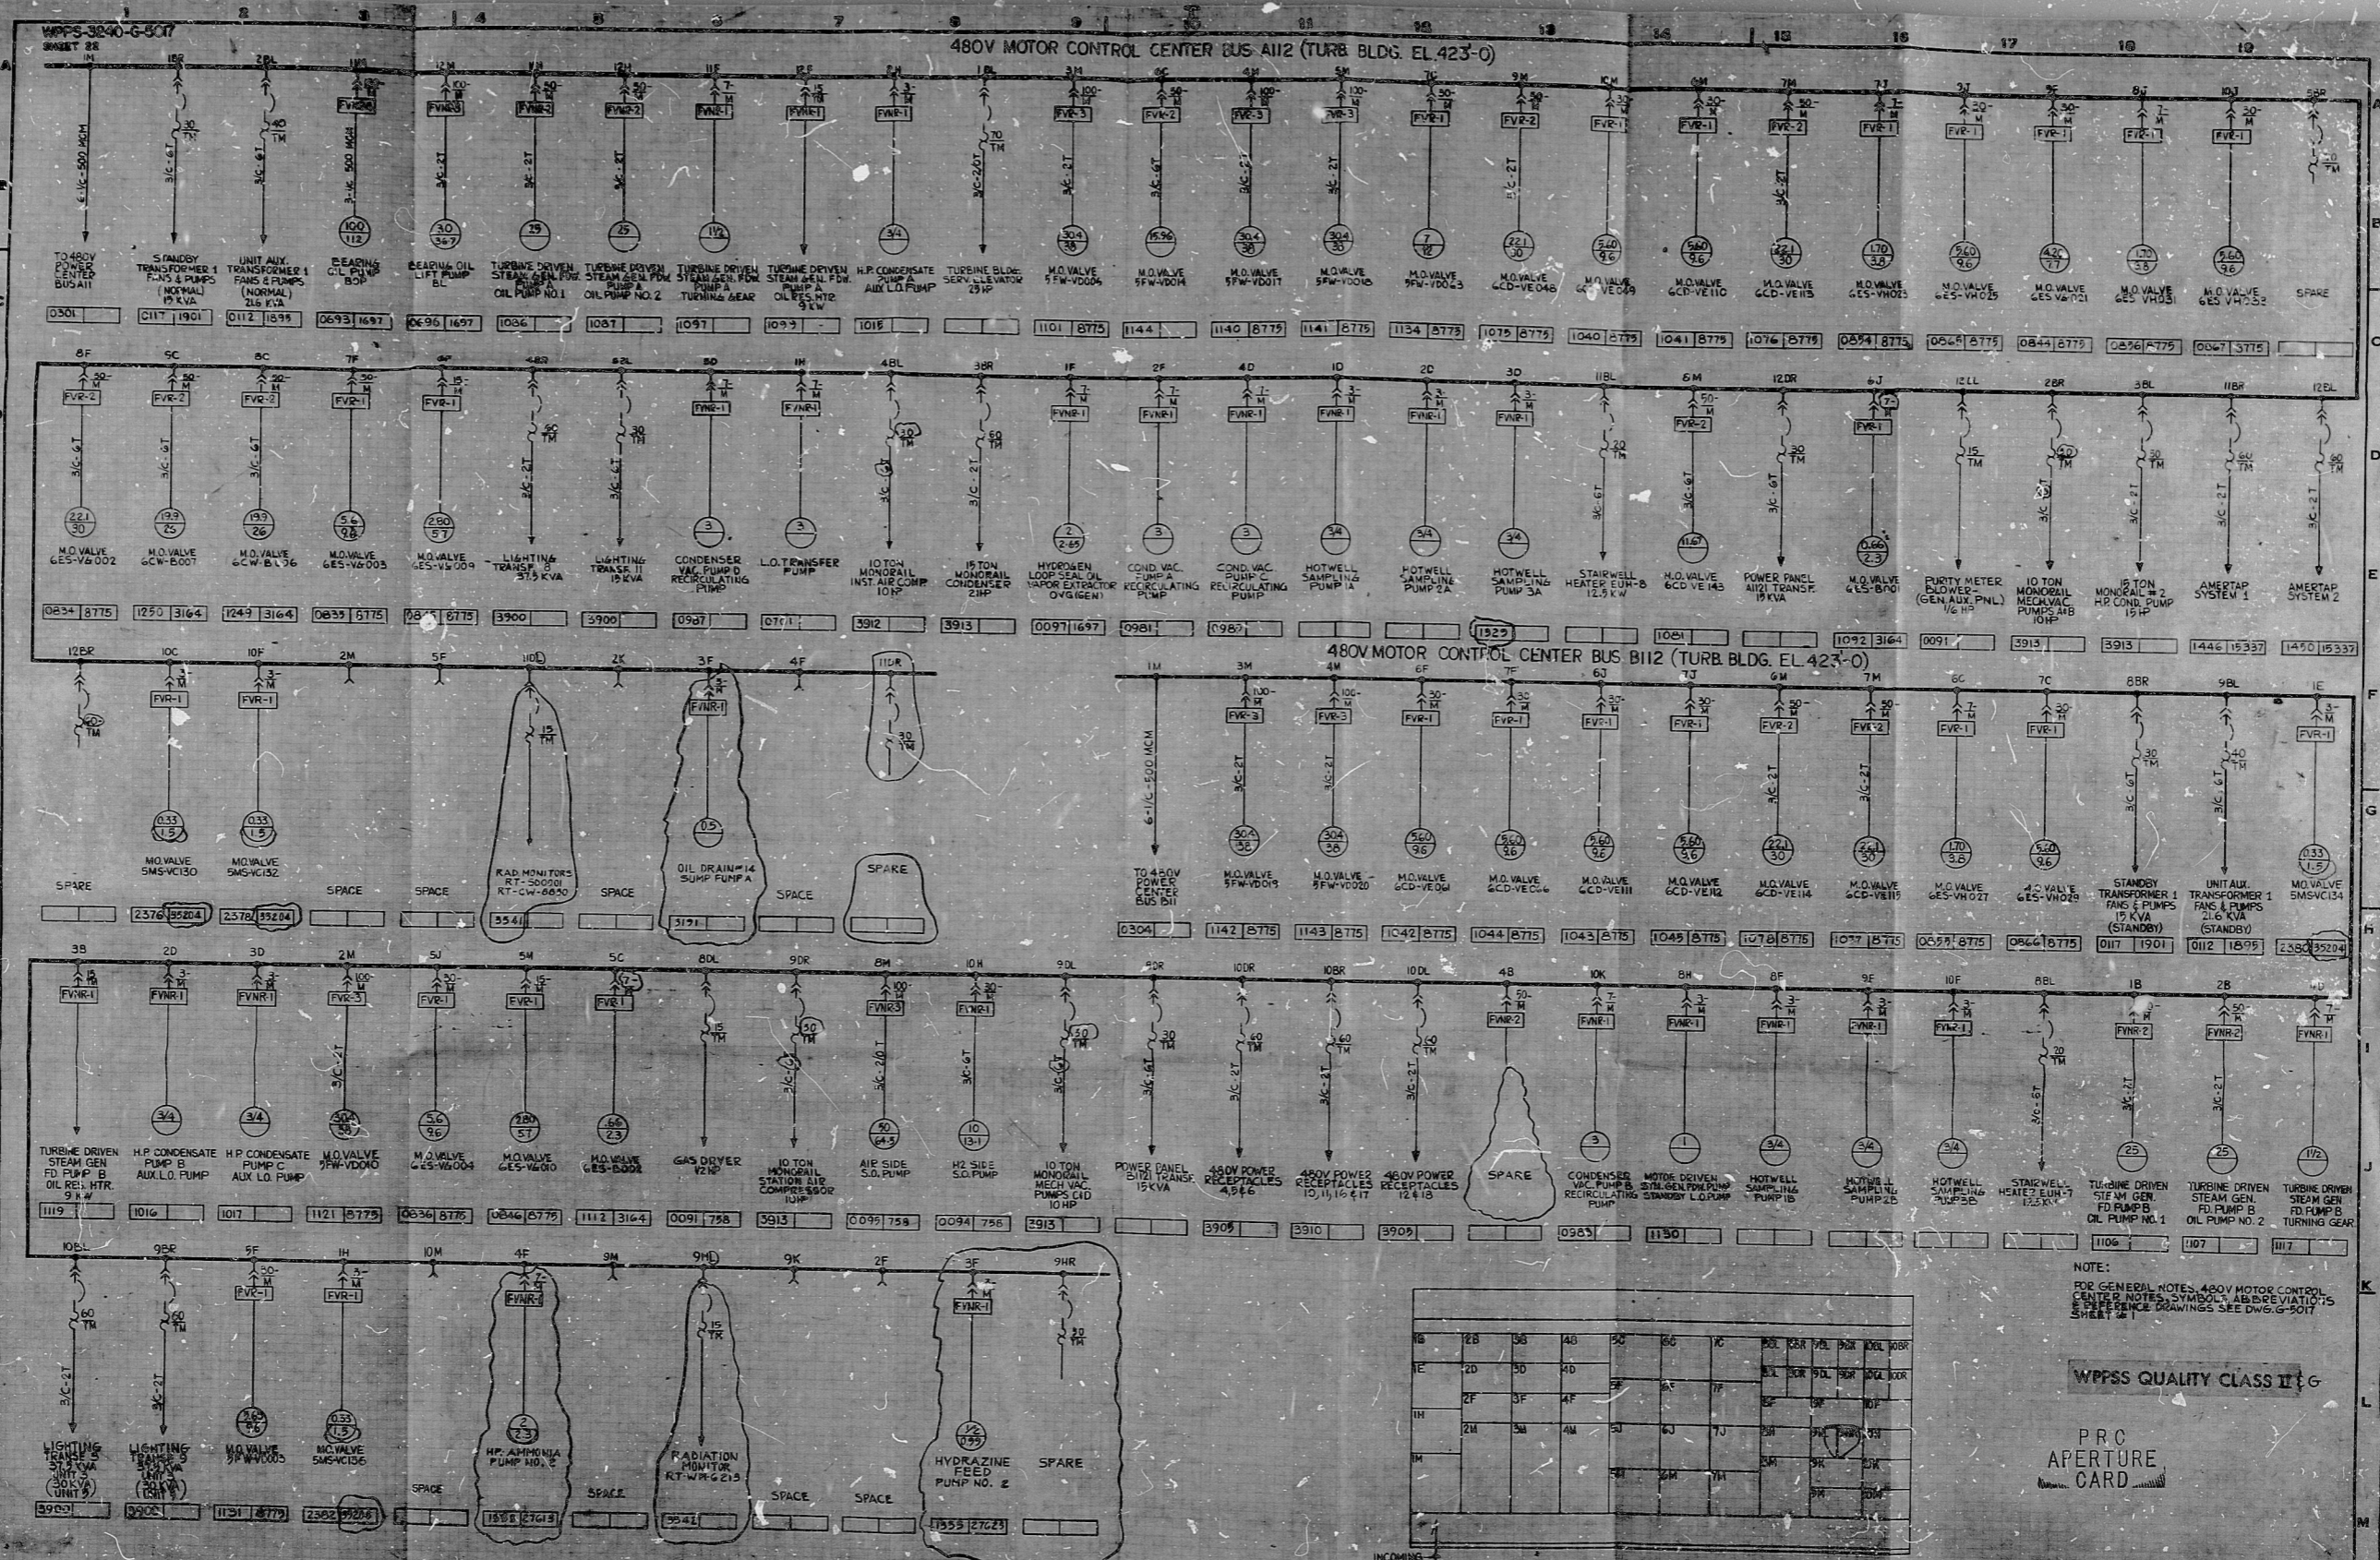

MCC A112 (FRONT VIEW)
(SEE DWG. G-907 FOR MAIN)

1B	2B	3B	4B	5B	6B	7B	8B	9B	10B	11B	12B
1C	2C	3C	4C	5C	6C	7C	8C	9C	10C	11C	12C
1D	2D	3D	4D	5D	6D	7D	8D	9D	10D	11D	12D
1E	2E	3E	4E	5E	6E	7E	8E	9E	10E	11E	12E
1F	2F	3F	4F	5F	6F	7F	8F	9F	10F	11F	12F
1G	2G	3G	4G	5G	6G	7G	8G	9G	10G	11G	12G
1H	2H	3H	4H	5H	6H	7H	8H	9H	10H	11H	12H
1I	2I	3I	4I	5I	6I	7I	8I	9I	10I	11I	12I
1J	2J	3J	4J	5J	6J	7J	8J	9J	10J	11J	12J
1K	2K	3K	4K	5K	6K	7K	8K	9K	10K	11K	12K
1L	2L	3L	4L	5L	6L	7L	8L	9L	10L	11L	12L
1M	2M	3M	4M	5M	6M	7M	8M	9M	10M	11M	12M

NOTE:
FOR GENERAL NOTES, 480V MOTOR CONTROL CENTER NOTES, SYMBOLS AND NOTATIONS, SEE REFERENCE DRAWINGS SEE DWG. G-907 SWEET 21

WPSS QUALITY CLASS II-G

PRC APERTURE CARD

WASHINGTON PUBLIC POWER SUPPLY SYSTEM
NUCLEAR PROJECTS NO. 808
480V MOTOR CONTROL CENTER A112 & B112
480V MOTOR CONTROL CENTER A112 & B112
480V MOTOR CONTROL CENTER A112 & B112

34

KODAK

8303210174

