

FIG. 1  
5 KV CABLE CONNECTION  
TO MOTOR LEAD

RATED VOLTAGE PHASE TO PHASE	INCHES
5000V	1/4
15000V	5/8

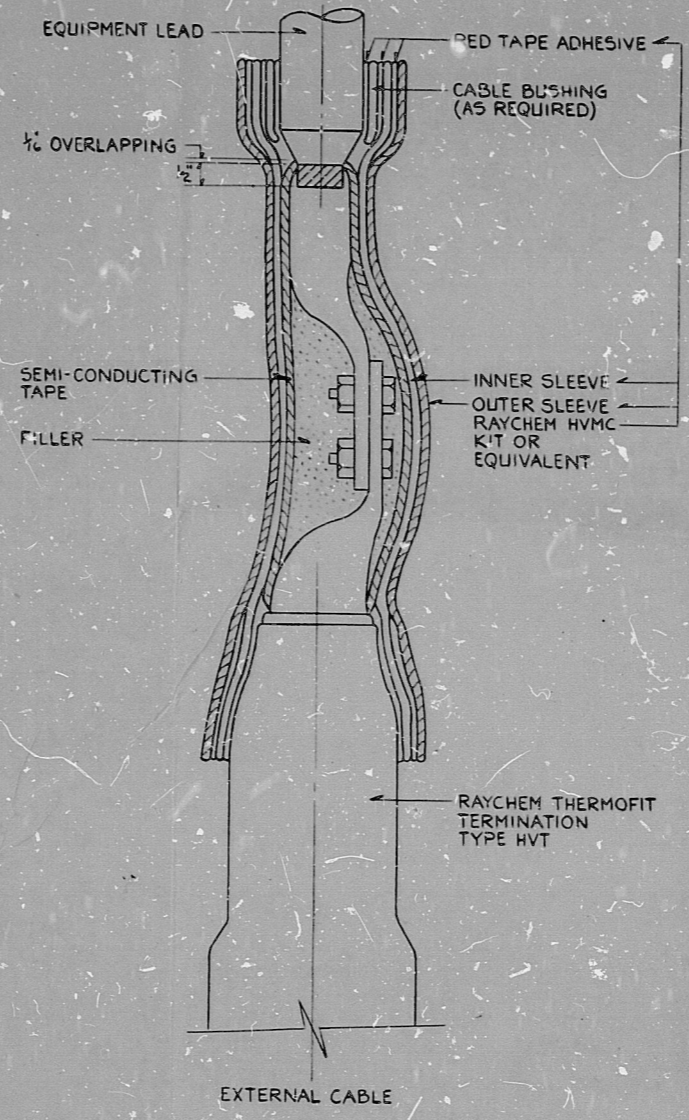


FIG. 2  
5 KV CABLE CONNECTION  
TO MOTOR LEAD

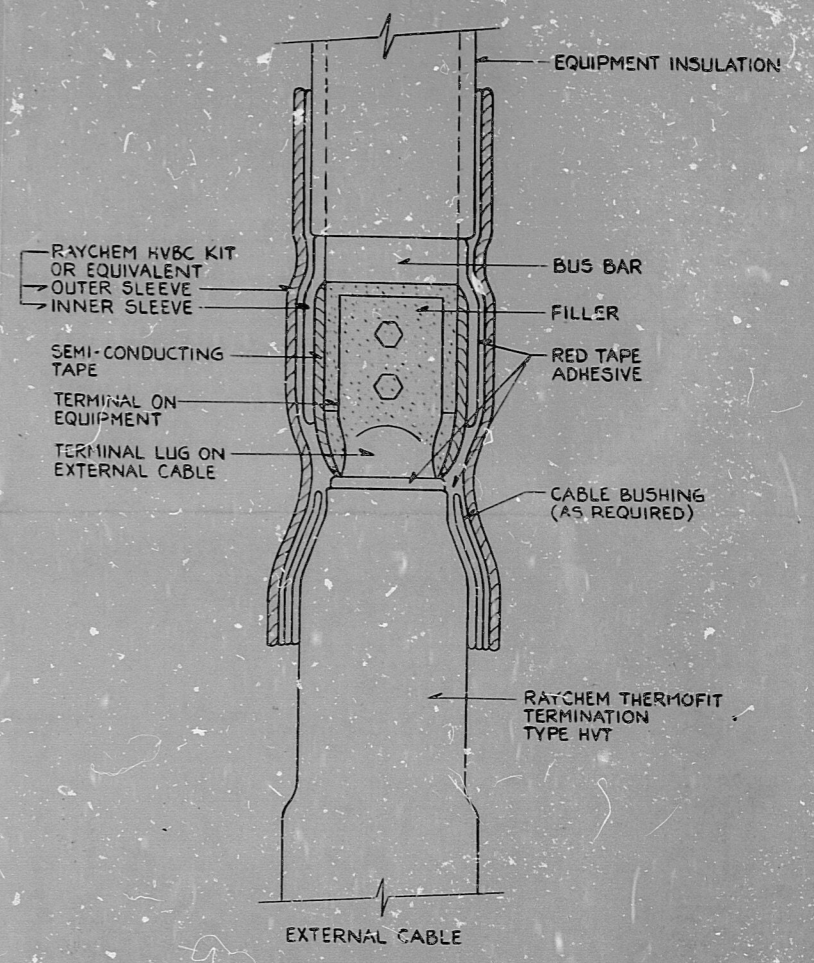


FIG. 3  
5 KV & 15KV CABLE CONNECTION  
TO BUS BAR  
(90° AND STRAIGHT CONNECTION)

PRC  
APERTURE  
CARD

5					
4					
3					
2					
1	SP				
REV.	DATE	BY	APPROVED	DATE	APR 10, 1979

EBASCO SERVICES INCORPORATED

DIV. ELEC. DR. H. RIMAR  
CH. E. SENKUS

APPROVED  
*[Signature]*

DATE APR 10, 1979  
*[Signature]*

NUCLEAR SAFETY RELATED

WPPSS QUALITY CLASS I, II & G

WASHINGTON PUBLIC POWER  
SUPPLY SYSTEM

NUCLEAR PROJECTS NO. 3 & 5

GENERAL NOTES, SYMBOLS AND  
REFERENCE DRAWINGS

WPPS-3240  
D-5023

SHEET 14

60

17"

