

FIG. 4  
TERMINATION OF 5KV CABLE  
SHIELDS IN MOTOR CONNECTION BOX

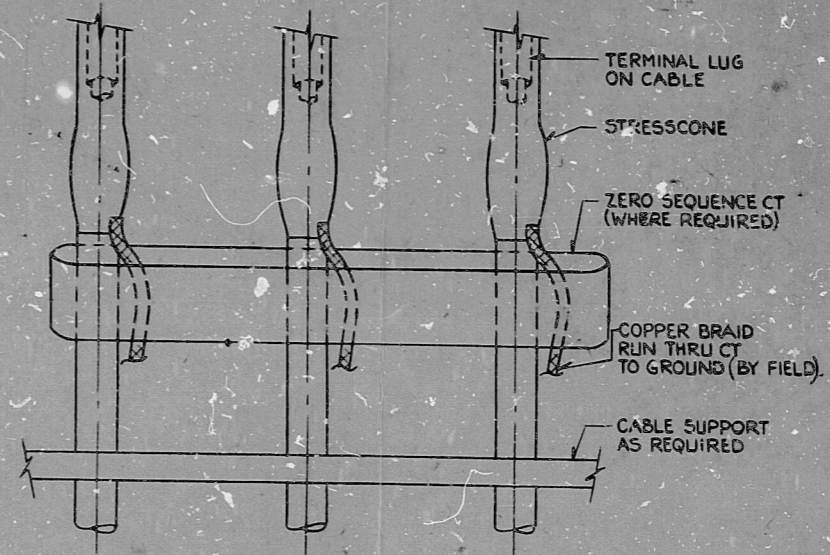


FIG. 5  
TERMINATION OF 5KV IN 15KV CABLE  
SHIELDS IN SWITCHGEAR ENCLOSURES  
WITH BUS BARS

PRC  
APERTURE  
CARD

PCP 35Q-2420 INCORPORATED IN REV 1

5			
4			
3			
2			
1	5-7-82	SP	SP
REV.	DATE	BY	APPROVED

EBASCO SERVICES INCORPORATED  
DIV. ELECT. DR. H. KIMAR  
CH. E. SENKUS  
DATE APR 10 1979

NUCLEAR SAFETY RELATED WPPSS QUALITY CLASS II B6

WASHINGTON PUBLIC POWER  
SUPPLY SYSTEM  
NUCLEAR PROJECTS NO. 3 & 5  
GENERAL NOTES, SYMBOLS AND  
REFERENCE DRAWINGS

WPPS-3240  
D-5023

**RIDS**

8303240221

