


34

34

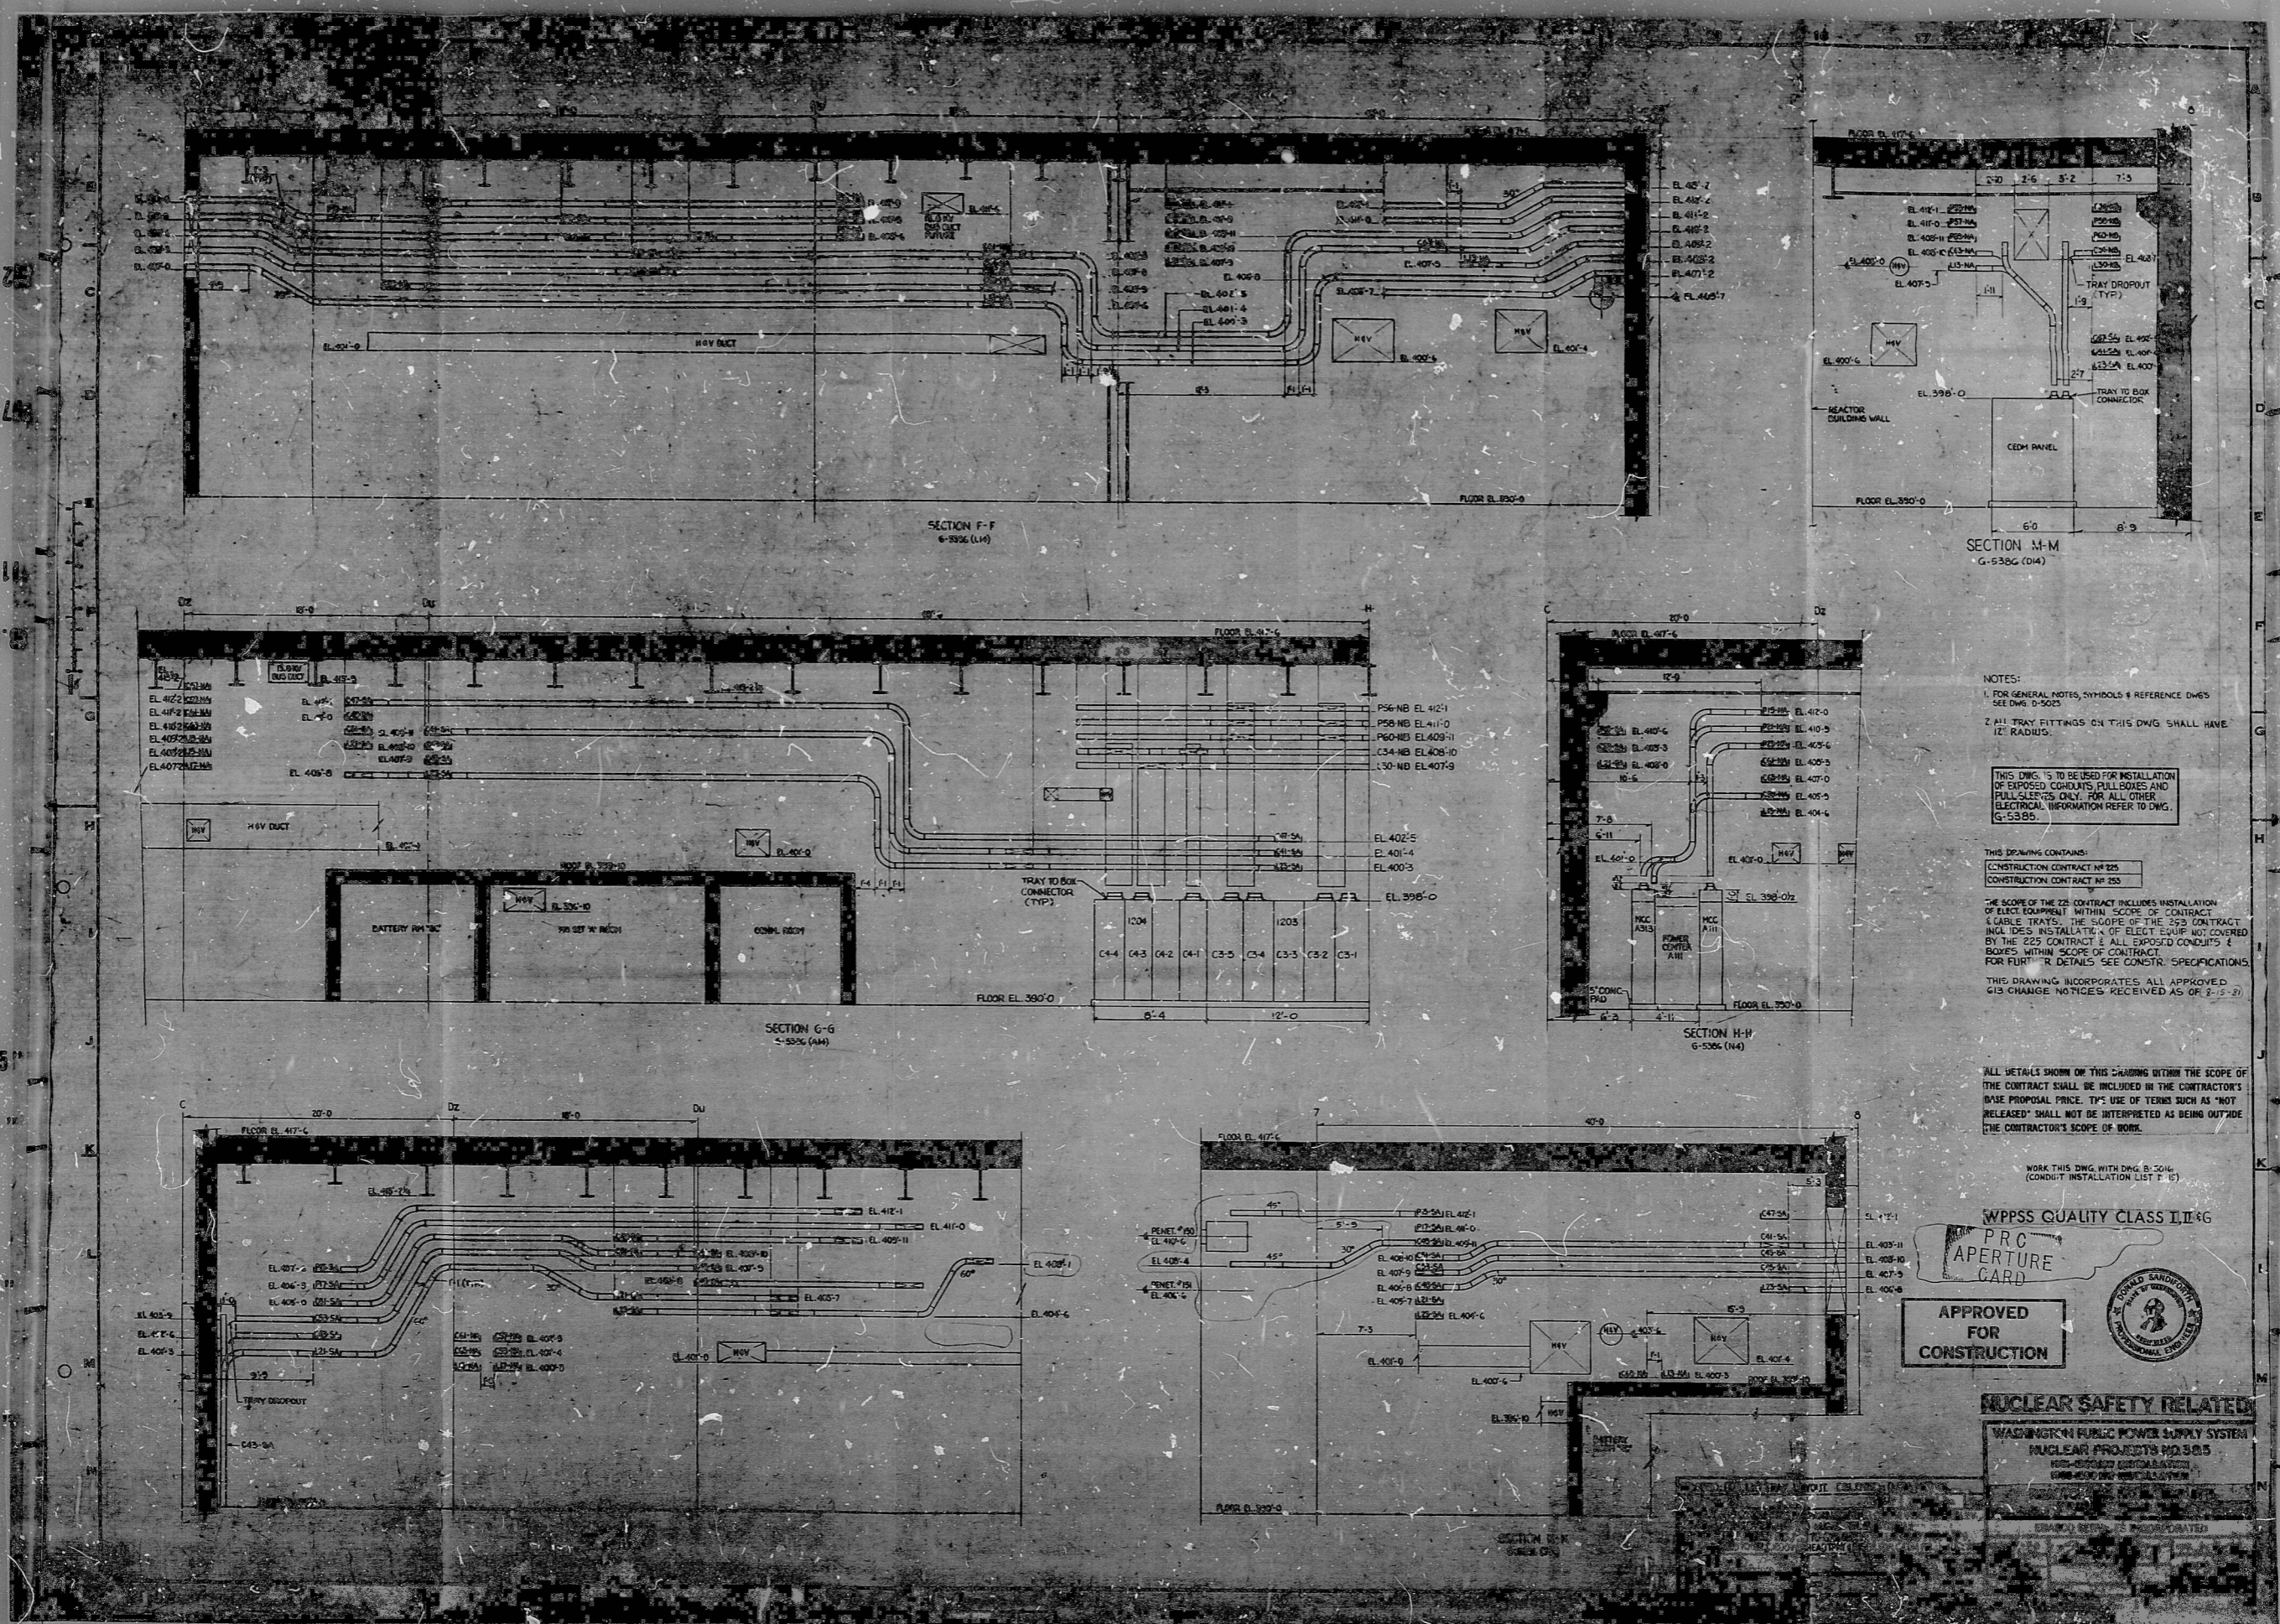

72"  
48"  
11"  
5'8"  
8.5"  
11"  
17"  
22"

72"  
11"  
5'8"  
8.5"  
11"  
17"  
22"

NOTES:  
1. FOR GENERAL NOTES, SYMBOLS & REFERENCE DWGS SEE DWG. G-5025  
2. ALL TRAY FITTINGS ON THIS DWG SHALL HAVE 12" RADIUS.  
  
THIS DWG. IS TO BE USED FOR INSTALLATION OF EXPOSED CONDUITS, PULL BOXES AND PULL SLEEVES ONLY. FOR ALL OTHER ELECTRICAL INFORMATION REFER TO DWG. G-5385.

THIS DRAWING CONTAINS:  
CONSTRUCTION CONTRACT # 225  
CONSTRUCTION CONTRACT # 255  
  
THE SCOPE OF THE 225 CONTRACT INCLUDES INSTALLATION OF ELECT. EQUIPMENT WITHIN SCOPE OF CONTRACT & LABEL TRAYS. THE SCOPE OF THE 255 CONTRACT INCLUDES INSTALLATION OF ELECT. EQUIP. NOT COVERED BY THE 225 CONTRACT & ALL EXPOSED CONDUITS & BOXES WITHIN SCOPE OF CONTRACT. FOR FURTHER DETAILS SEE CONSTR. SPECIFICATIONS.  
  
THIS DRAWING INCORPORATES ALL APPROVED G13 CHANGE NOTICES RECEIVED AS OF 7-15-70.

ALL DETAILS SHOWN ON THIS DRAWING OUTSIDE THE SCOPE OF THE CONTRACT SHALL BE INCLUDED IN THE CONTRACTOR'S BASE PROPOSAL PRICE. THE USE OF TERMS SUCH AS "NOT RELEASED" SHALL NOT BE INTERPRETED AS BEING OUTSIDE THE CONTRACTOR'S SCOPE OF WORK.

WORK THIS DWG. WITH DWG. B-5046 (CONDUIT INSTALLATION LIST F-15)

WPSS QUALITY CLASS II 4G  
PRC APERTURE CARD

APPROVED FOR CONSTRUCTION



NUCLEAR SAFETY RELATED  
WASHINGTON PUBLIC POWER SUPPLY SYSTEM  
NUCLEAR PROJECTS #2, 3 & 5  
HIGH-PRESSURE COOLANT SYSTEM  
REACTOR BUILDING WALL



**RIDS**

8303249237

