


34

34

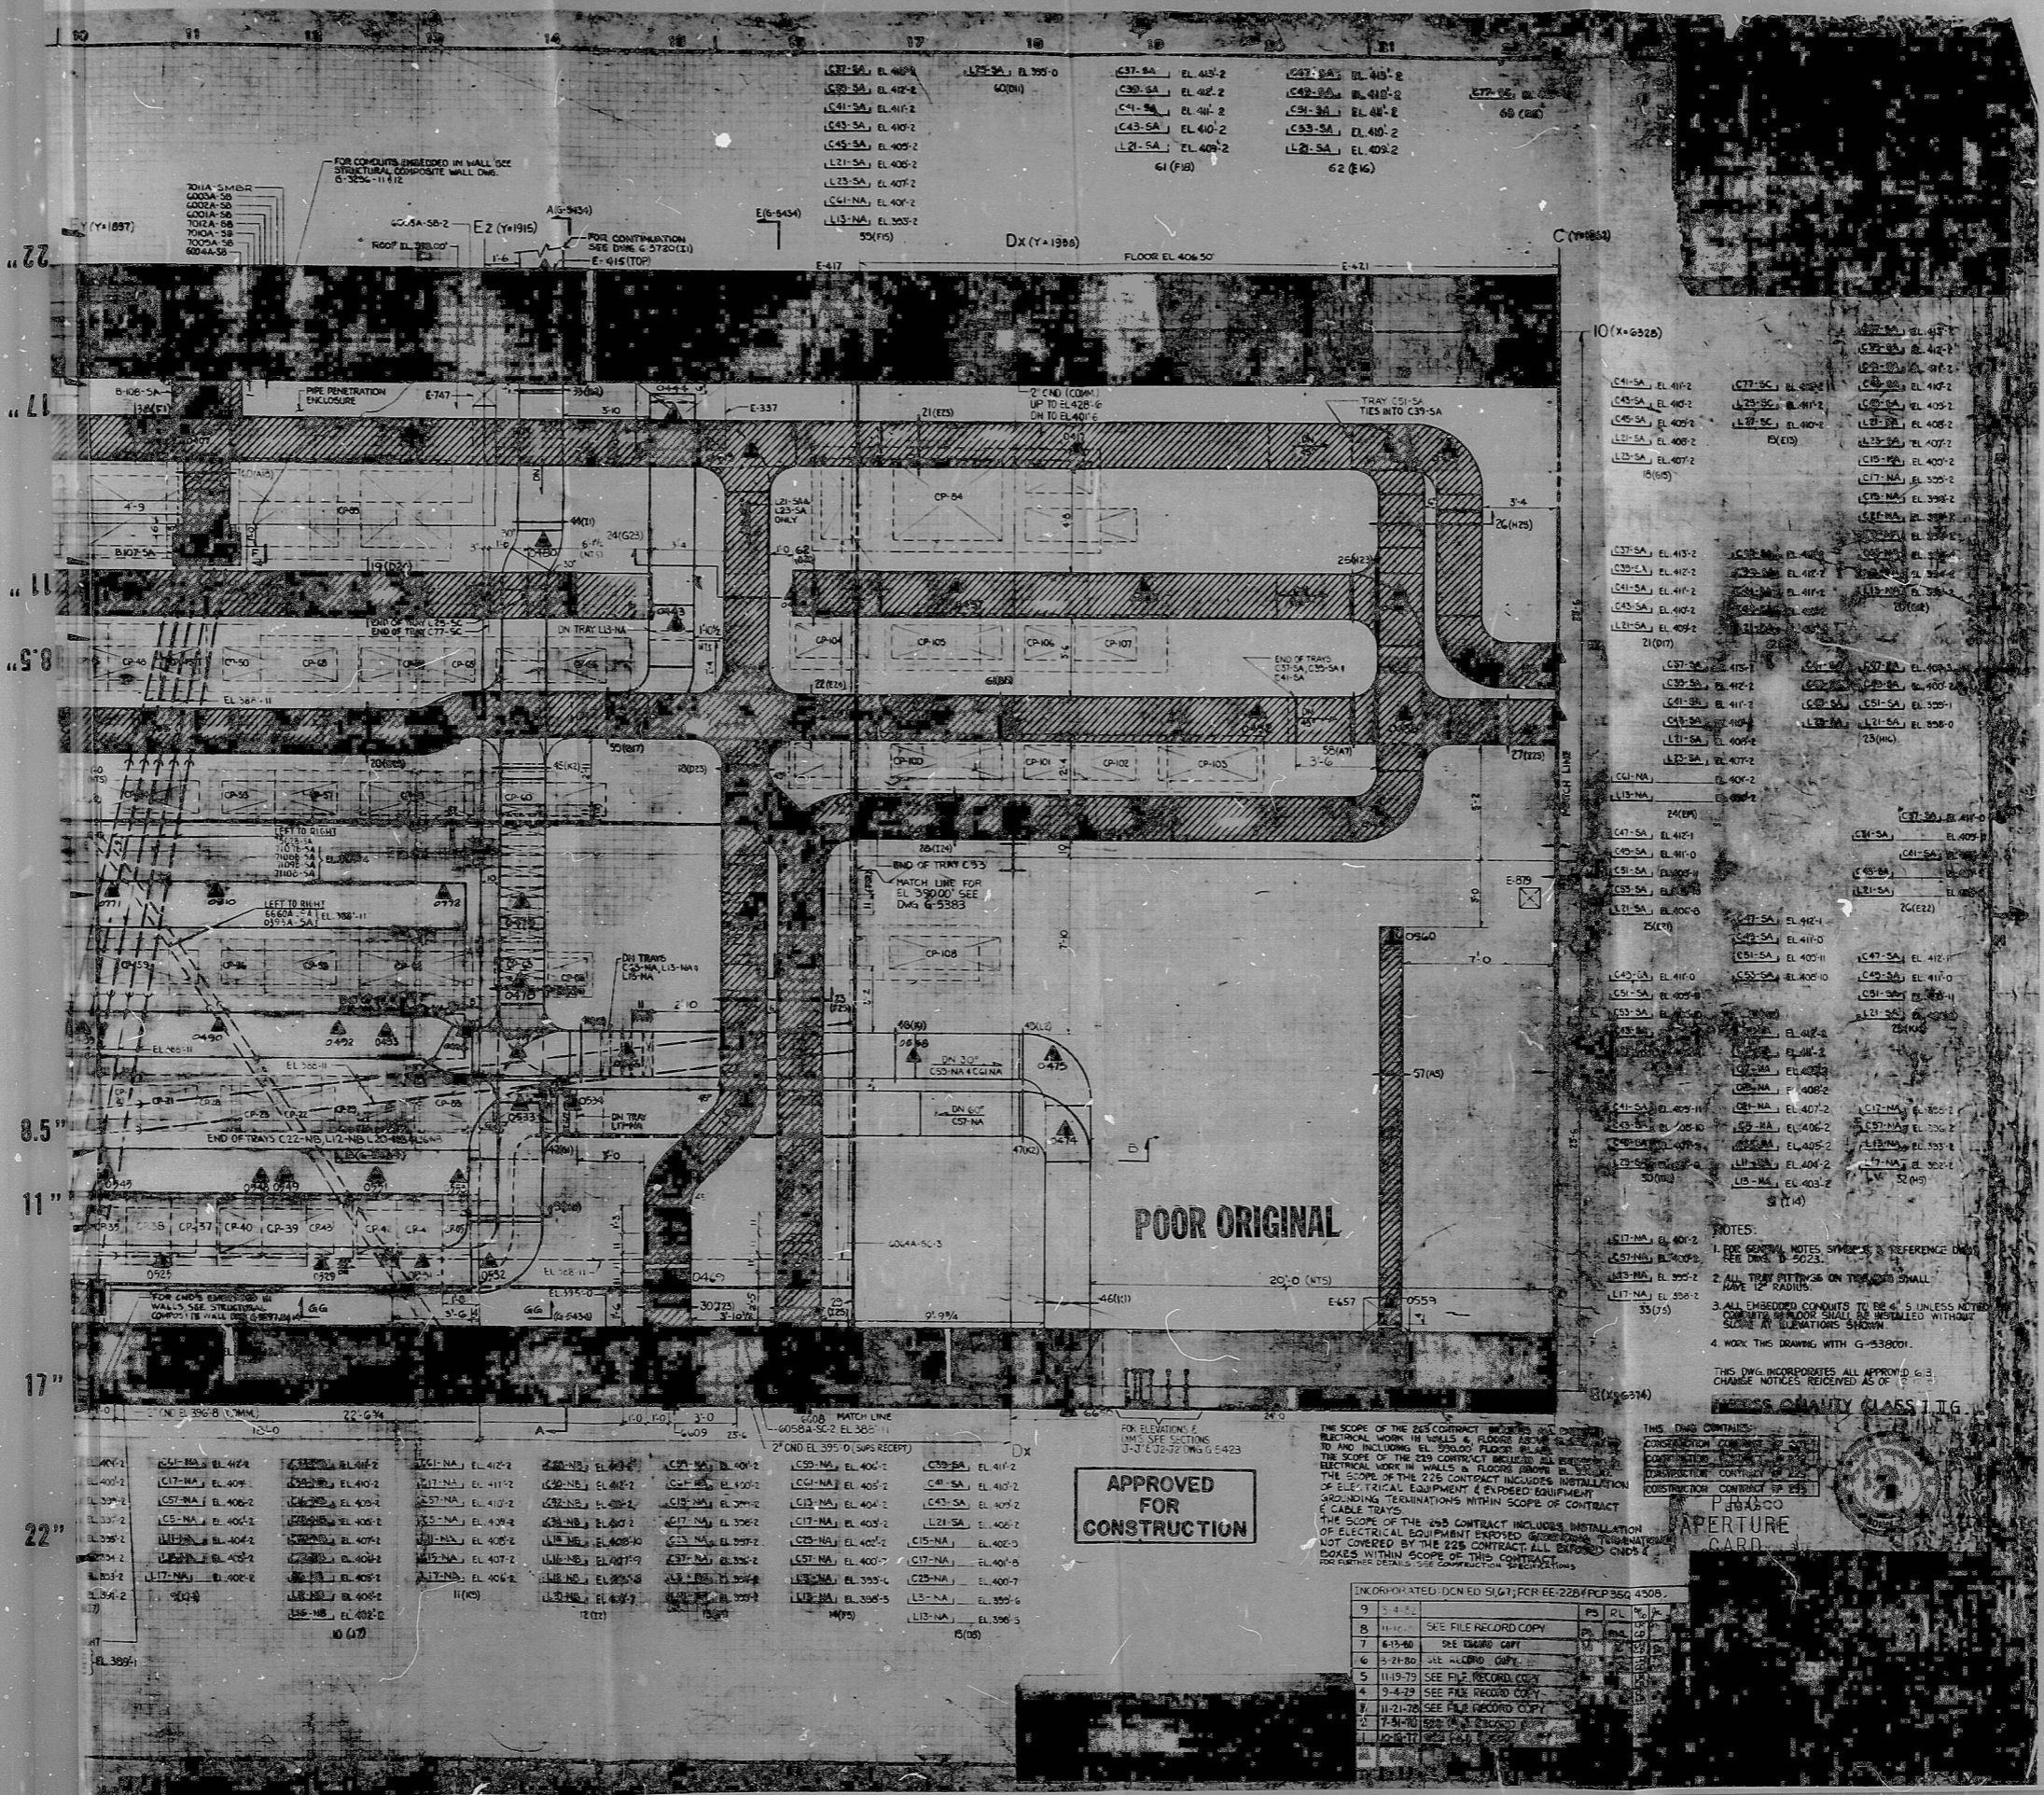

22

22

17

17

11

11

8.5

8.5

8.5

8.5

11

11

17

17

22

22

APPROVED FOR CONSTRUCTION

- NOTES:**
1. SEE GENERAL NOTES SYMBOLS & REFERENCE UNITS SEE DWG. B-5023.
 2. ALL TRAY FITTINGS ON TRAYS SHALL HAVE 12" RADII.
 3. ALL EMBEDDED CONDUITS TO BE 4" UNLESS NOTED OTHERWISE. CONDUITS TO BE INSTALLED WITHOUT SLEEVES AT ELEVATIONS SHOWN.
 4. WORK THIS DRAWING WITH G-538001.

THIS DWG. INCORPORATES ALL APPROVED G.E. CHANGE NOTICES RECEIVED AS OF 1/15/54.

PROCESS QUALITY CLASS 11 G



PERMANENT APERTURE CARD

THE SCOPE OF THE E25 CONTRACT INCLUDES THE INSTALLATION OF ELECTRICAL WORK IN WALLS & FLOORS EXCEPT PLUMBING AND TO AND INCLUDING EL. 500.00. PLUMBING IS THE SCOPE OF THE E25 CONTRACT INCLUDING ALL ELECTRICAL WORK IN WALLS & FLOORS ABOVE EL. 500.00. THE SCOPE OF THE E25 CONTRACT INCLUDES INSTALLATION OF ELECTRICAL EQUIPMENT & EXPANDED EQUIPMENT INCLUDING TERMINATIONS WITHIN SCOPE OF CONTRACT.

THE SCOPE OF THE E25 CONTRACT INCLUDES INSTALLATION OF ELECTRICAL EQUIPMENT ENCLOSED IN EXPANDED EQUIPMENT NOT COVERED BY THE E25 CONTRACT. ALL EXPANDED EQUIPMENT BOXES WITHIN SCOPE OF THIS CONTRACT.

FOR ELEVATIONS & DIM. SEE SECTIONS 3-7 & 3-72 DWG. G-5423

INCORPORATED (DWN ED 5/6/54) FOR EE-228/FCLP 356 4300.

NO.	DATE	DESCRIPTION	BY	CHKD.	APP'D.
9	5-4-54				
8	1-13-54	SEE FILE RECORD COPY			
7	6-13-50	SEE RECORD COPY			
6	5-7-50	SEE RECORD COPY			
5	11-27-49	SEE FILE RECORD COPY			
4	3-4-49	SEE FILE RECORD COPY			
3	11-21-48	SEE FILE RECORD COPY			
2	7-31-48	SEE FILE RECORD COPY			
1	10-17-47	SEE FILE RECORD COPY			

RIDS

8303300521

