


34

34

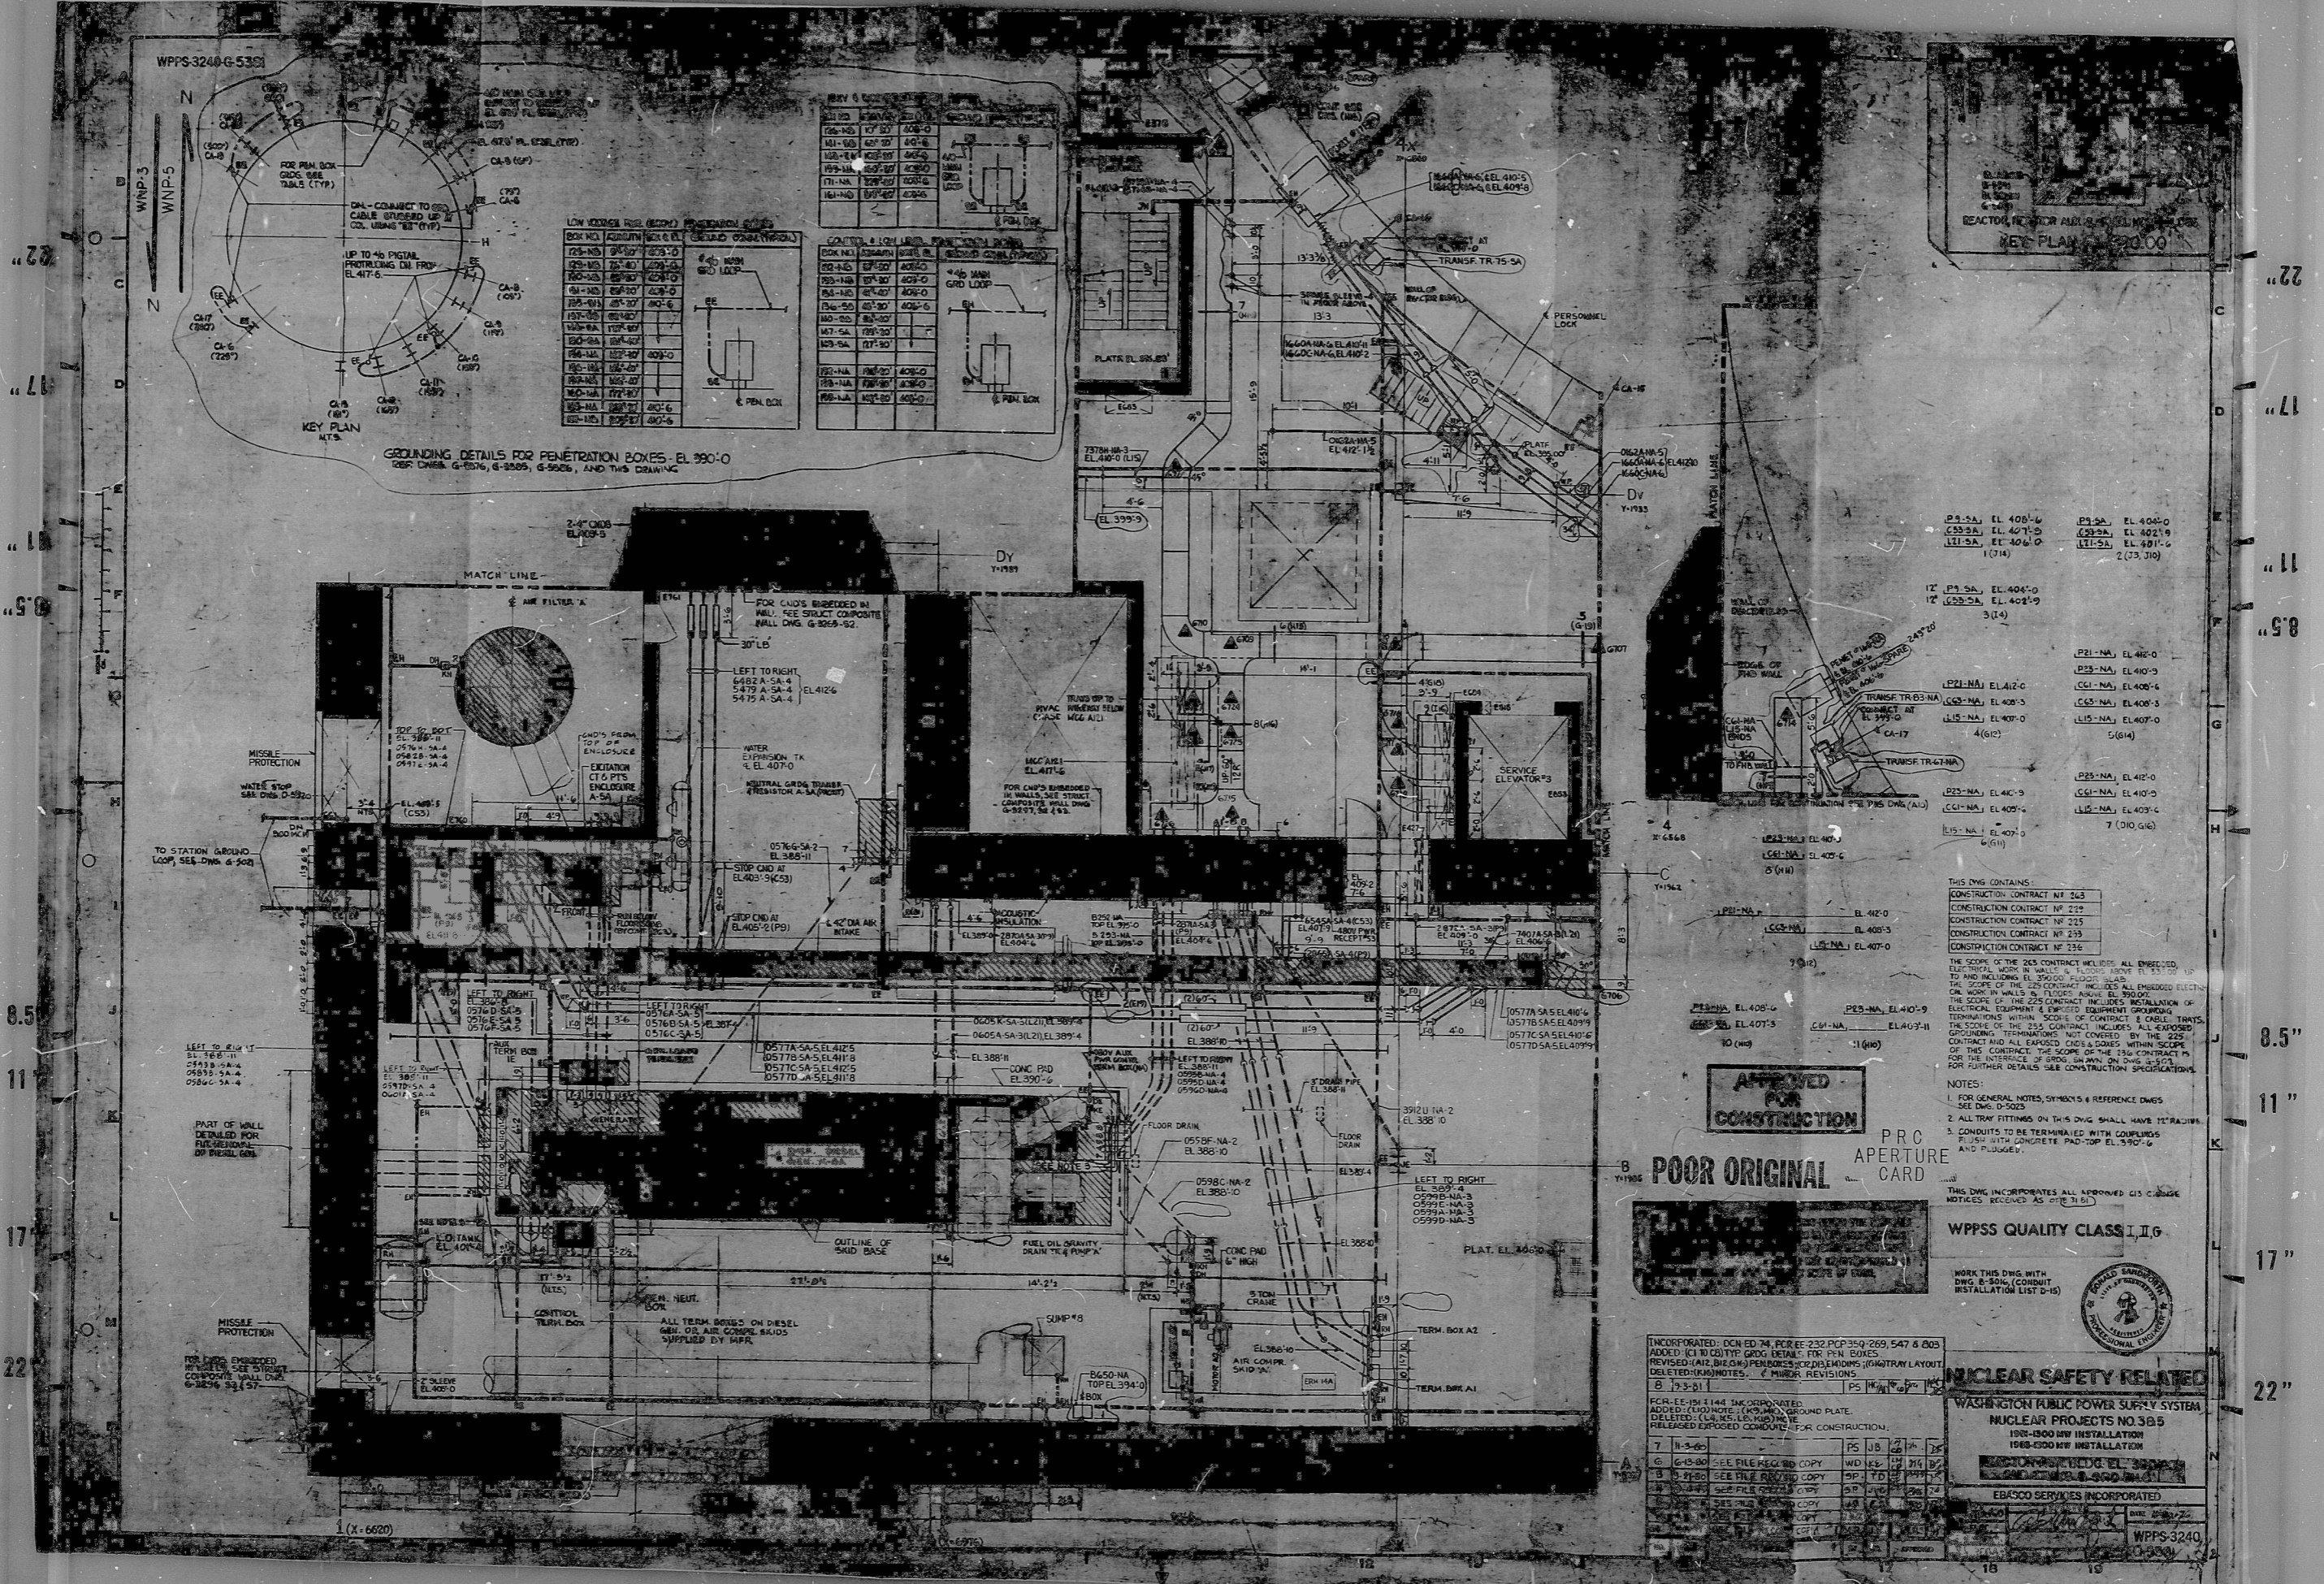

22

22

17

17

11

11

5

5

8.5

8.5

11

11

17

17

22

22

APPROVED FOR CONSTRUCTION

POOR ORIGINAL

APERTURE CARD

WPPSS QUALITY CLASS II, G

WORK THIS DWG WITH DWG 8340 (CONDUIT INSTALLATION LIST 0-15)

INCORPORATED: DCN 02 74 FOR EE-232 PEP 350 269 547 8 003 ADDED (C1 TO C2) TYP GRID DETAIL FOR PEN BOXES REVISED (AIR, BLDG) PEN BOXES FOR DIMENSIONS (CONSTR) LAYOUT DELETED DIMENSIONS, 4 MINOR REVISIONS

FOR EE-101 1144 INCORPORATED ADDED (E10) NOTE (K) 10' MIN GROUND PLATE DELETED (L) AIR, BLDG DIMS RELEASED EXPOSED CONDUIT FOR CONSTRUCTION

7	11-3-80	SEE FILE RECORD COPY	PS	UB	2	78
6	6-13-80	SEE FILE RECORD COPY	WD	EE	1	74
5	5-11-80	SEE FILE RECORD COPY	DP	TD	1	77
4	5-11-80	SEE FILE RECORD COPY	DP	TD	1	77
3	5-11-80	SEE FILE RECORD COPY	DP	TD	1	77
2	5-11-80	SEE FILE RECORD COPY	DP	TD	1	77
1	5-11-80	SEE FILE RECORD COPY	DP	TD	1	77

NUCLEAR SAFETY RELATED

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

NUCLEAR PROJECTS NO. 305

1968-1900 MW INSTALLATION

1968-1900 MW INSTALLATION

EBASCO SERVICES INCORPORATED

WPPSS-3240

18 15

KODAK

8303300523

