


34

34

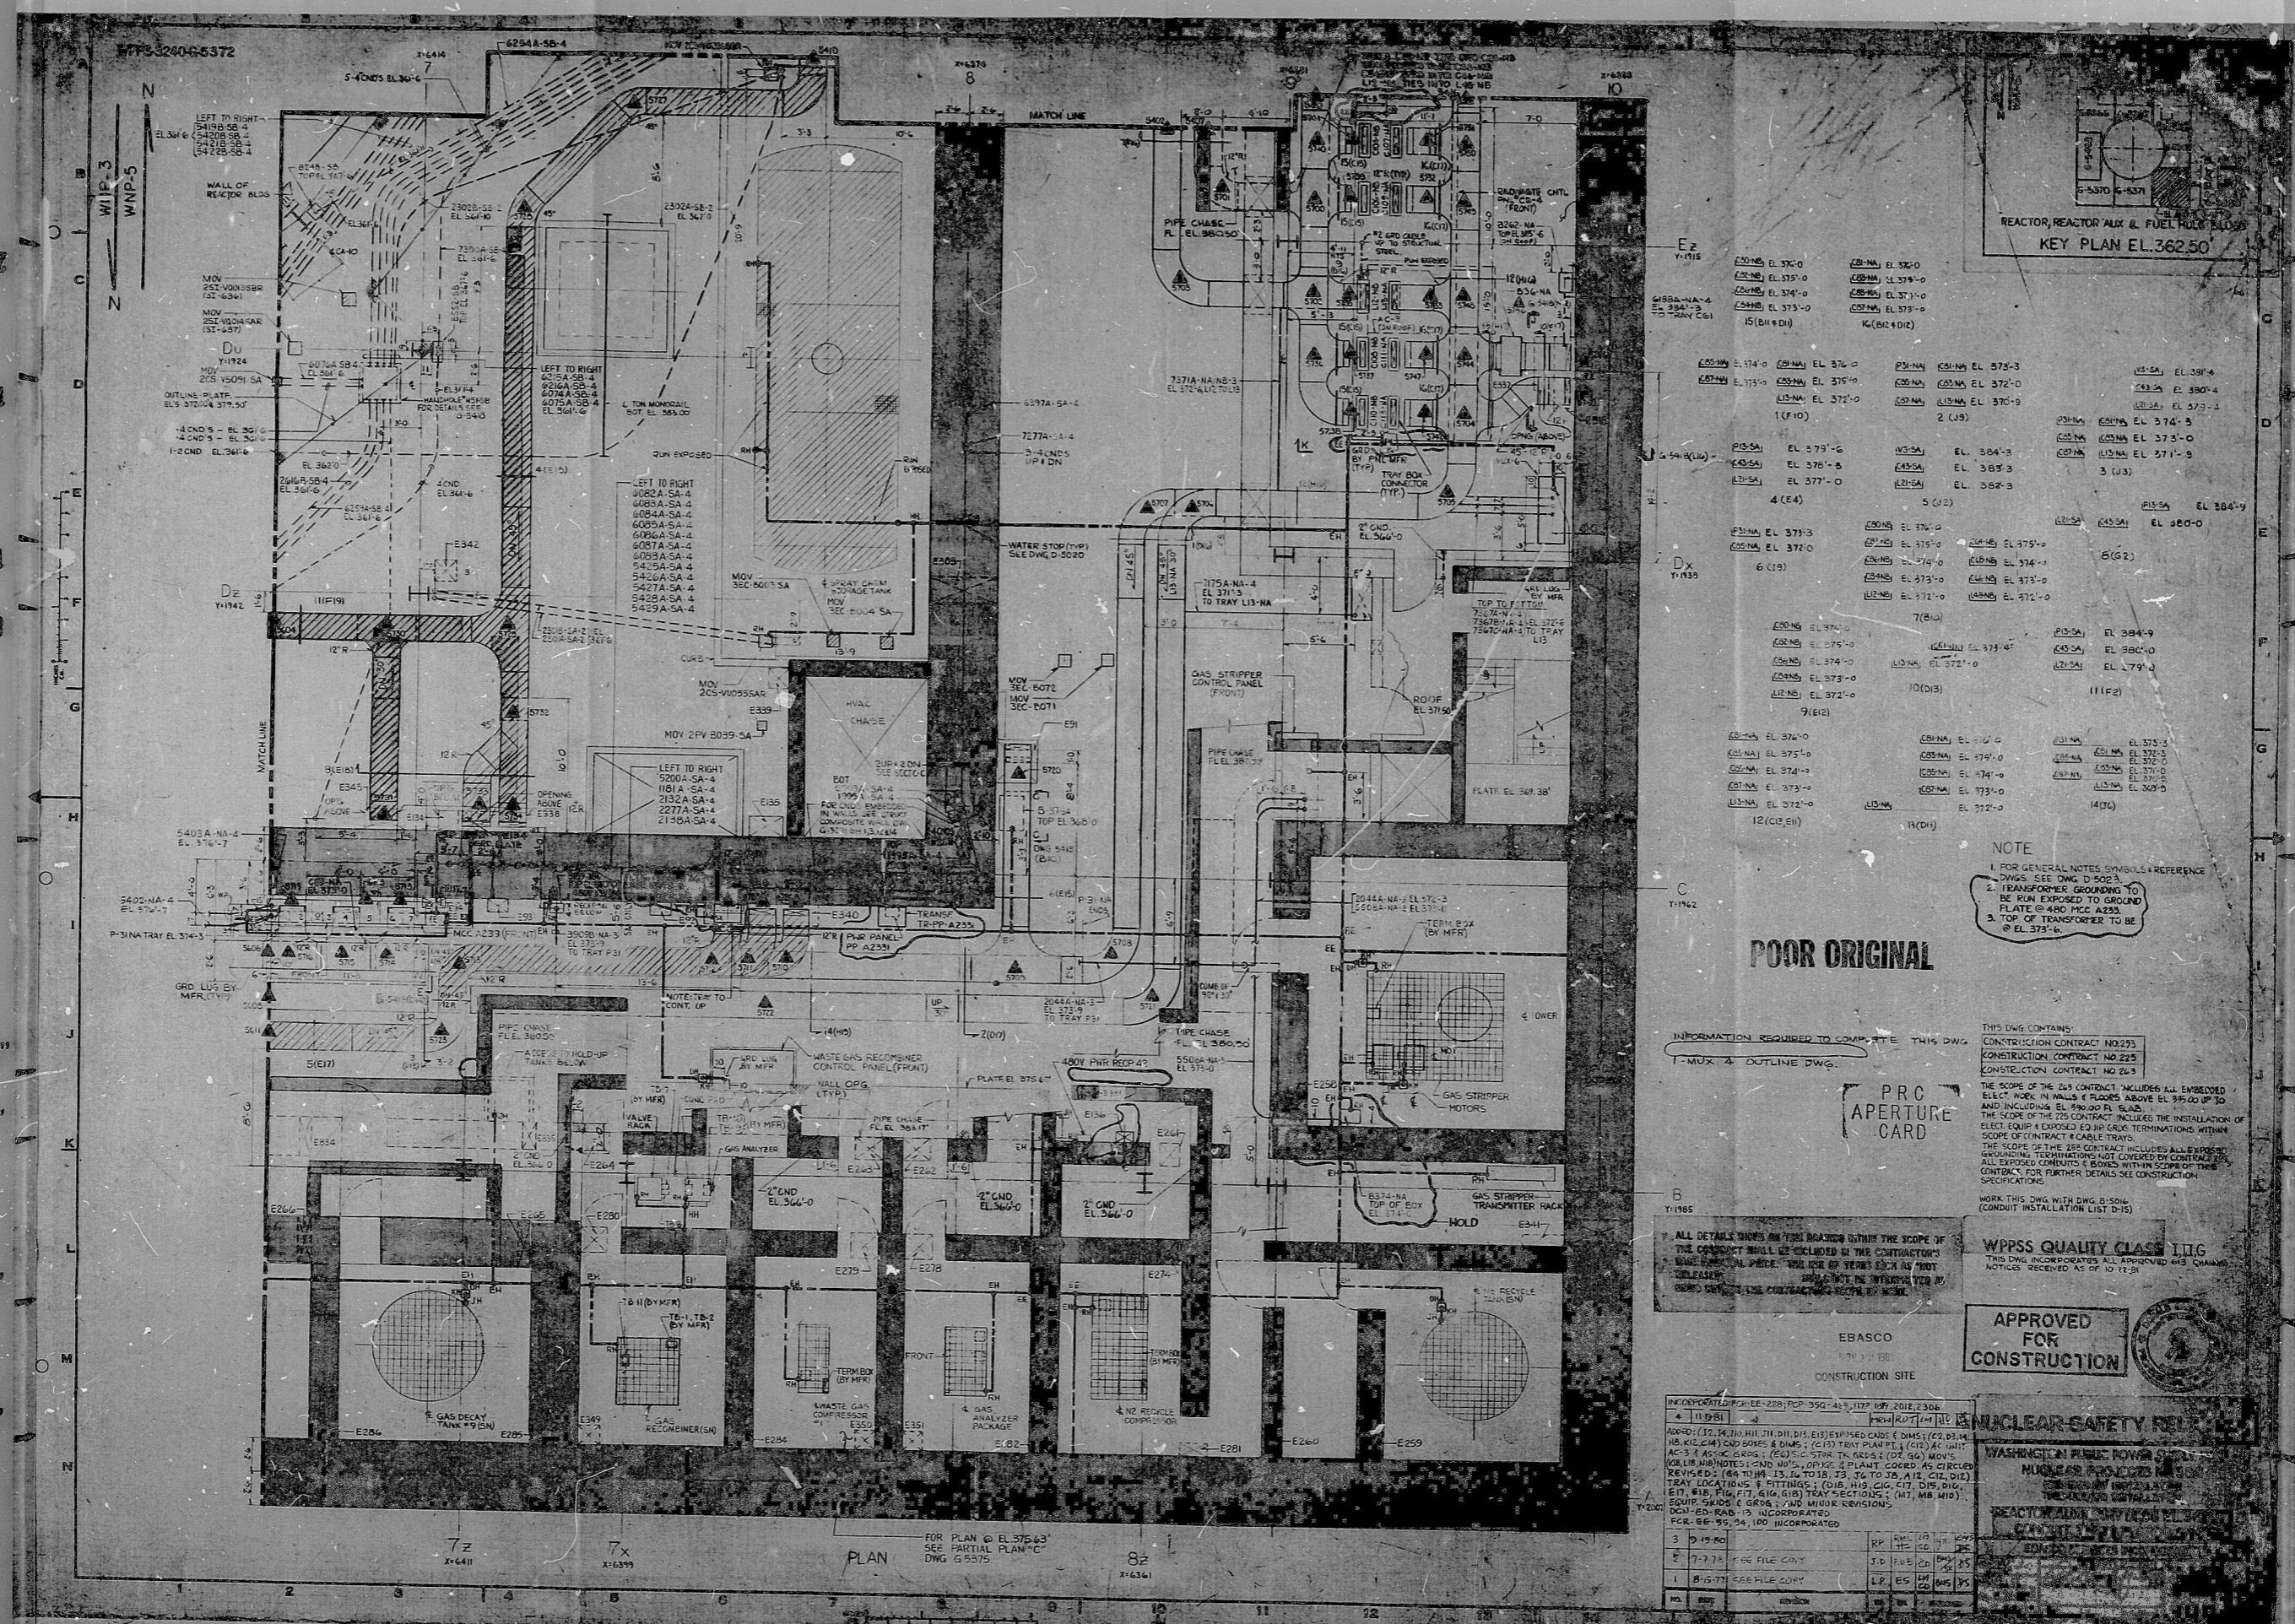

22

22

17

17

11

11

58

58

85

85

11

11

17

17

22

22

POOR ORIGINAL

PRC APERTURE CARD

NOTE

- FOR GENERAL NOTES, SYMBOLS & REFERENCE CHANGES SEE DWG. D-5003.
- TRANSFORMERS EXPOSED TO BE RUN EXPOSED TO GROUND PLATE @ 480 VDC. ACCESS.
- TOP OF TRANSFORMER TO BE @ EL. 373.6.

INFORMATION REQUIRED TO COMPLETE THIS DWG.

1. MUX 4 OUTLINE DWG.

ALL DETAILS SHOWN ON THIS DRAWING WITHIN THE SCOPE OF THE CONTRACT SHALL BE INCLUDED IN THE CONTRACTORS' BIDDING. THE PRICE OF THESE SHALL BE A "NOT TO EXCEED" BASIS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPROPRIATE AGENCIES.

WPPSS QUALITY CLASS IITG

THIS DWG INCORPORATES ALL APPROVED CHANGES NOTICED RECEIVED AS OF 10/11/81.

APPROVED FOR CONSTRUCTION



NO.	DATE	DESCRIPTION	BY	CHKD.
3	10-19-80	REV. FILE COPY	RP	RP
2	7-7-79	REV. FILE COPY	J.D.	RP
1	8-15-77	REV. FILE COPY	RP	RP

INDEPENDENT LABORER-228; POC-350-243; 11/7/80; 2012-2306

WASHINGTON PUBLIC POWER & LIGHTING CO. NUCLEAR POWER PLANT

REACTOR AUXILIARY & FUEL HANDLING BUILDING

PLAN FOR PLAN @ EL. 375.63 SEE PARTIAL PLAN "C" DWG. G-5575

82 X-6361

RIDS

8303309612

