


17"
11"
8.5"
8.5"
11"
17"

This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited or used except in the limited way and private use permitted by any written consent given by the lender to the borrower.

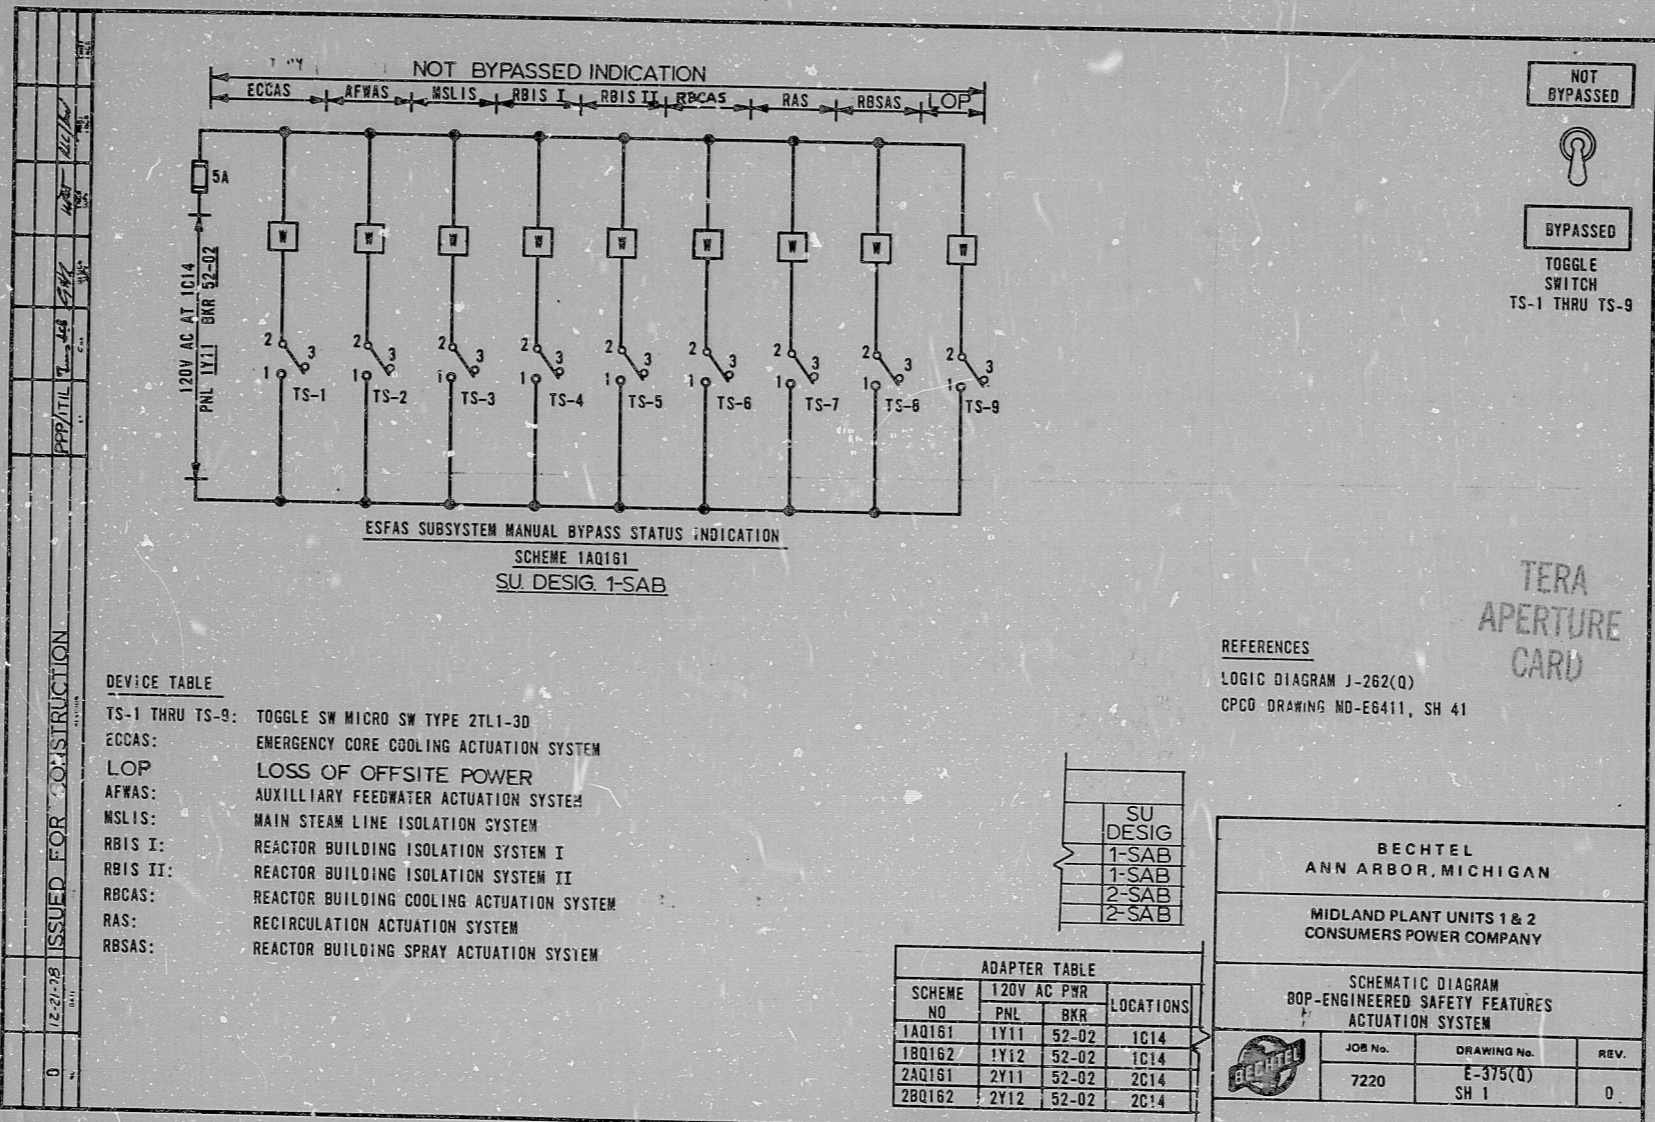

ISSUED FOR CONSTRUCTION

DEVICE TABLE

| | |
|-----------------|-------------------------------------------|
| TS-1 THRU TS-9: | TOGGLE SW MICRO SW TYPE 2TL1-3D |
| ECCAS: | EMERGENCY CORE COOLING ACTUATION SYSTEM |
| LOP: | LOSS OF OFFSITE POWER |
| AFWAS: | AUXILIARY FEEDWATER ACTUATION SYSTEM |
| MSLIS: | MAIN STEAM LINE ISOLATION SYSTEM |
| RBIS I: | REACTOR BUILDING ISOLATION SYSTEM I |
| RBIS II: | REACTOR BUILDING ISOLATION SYSTEM II |
| RBCAS: | REACTOR BUILDING COOLING ACTUATION SYSTEM |
| RAS: | RECIRCULATION ACTUATION SYSTEM |
| RBSAS: | REACTOR BUILDING SPRAY ACTUATION SYSTEM |

REFERENCES
LOGIC DIAGRAM J-262(Q)
CPCO DRAWING NO-E6411, SH 41

SU
DESIG
1-SAB
1-SAB
2-SAB
2-SAB

ADAPTER TABLE

| SCHEME NO | 120V AC PWR | | LOCATIONS |
|-----------|-------------|-------|-----------|
| | PNL | BKR | |
| 1AQ161 | 1Y11 | 52-02 | 1C14 |
| 1BQ162 | 1Y12 | 52-02 | 1C14 |
| 2AQ161 | 2Y11 | 52-02 | 2C14 |
| 2BQ162 | 2Y12 | 52-02 | 2C14 |


BECHTEL
ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS 1 & 2
CONSUMERS POWER COMPANY

SCHEMATIC DIAGRAM
BOP-ENGINEERED SAFETY FEATURES
ACTUATION SYSTEM

| JOB No. | DRAWING No. | REV. |
|---------|------------------|------|
| 7220 | E-375(D) SH 1 | 0 |

TERA
APERTURE
CARD



16X

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document submitted to reprographics.

17"
11"
8.5"
8.5"
11"
17"

RIDS

811130143

