


12179-EH-122A-1

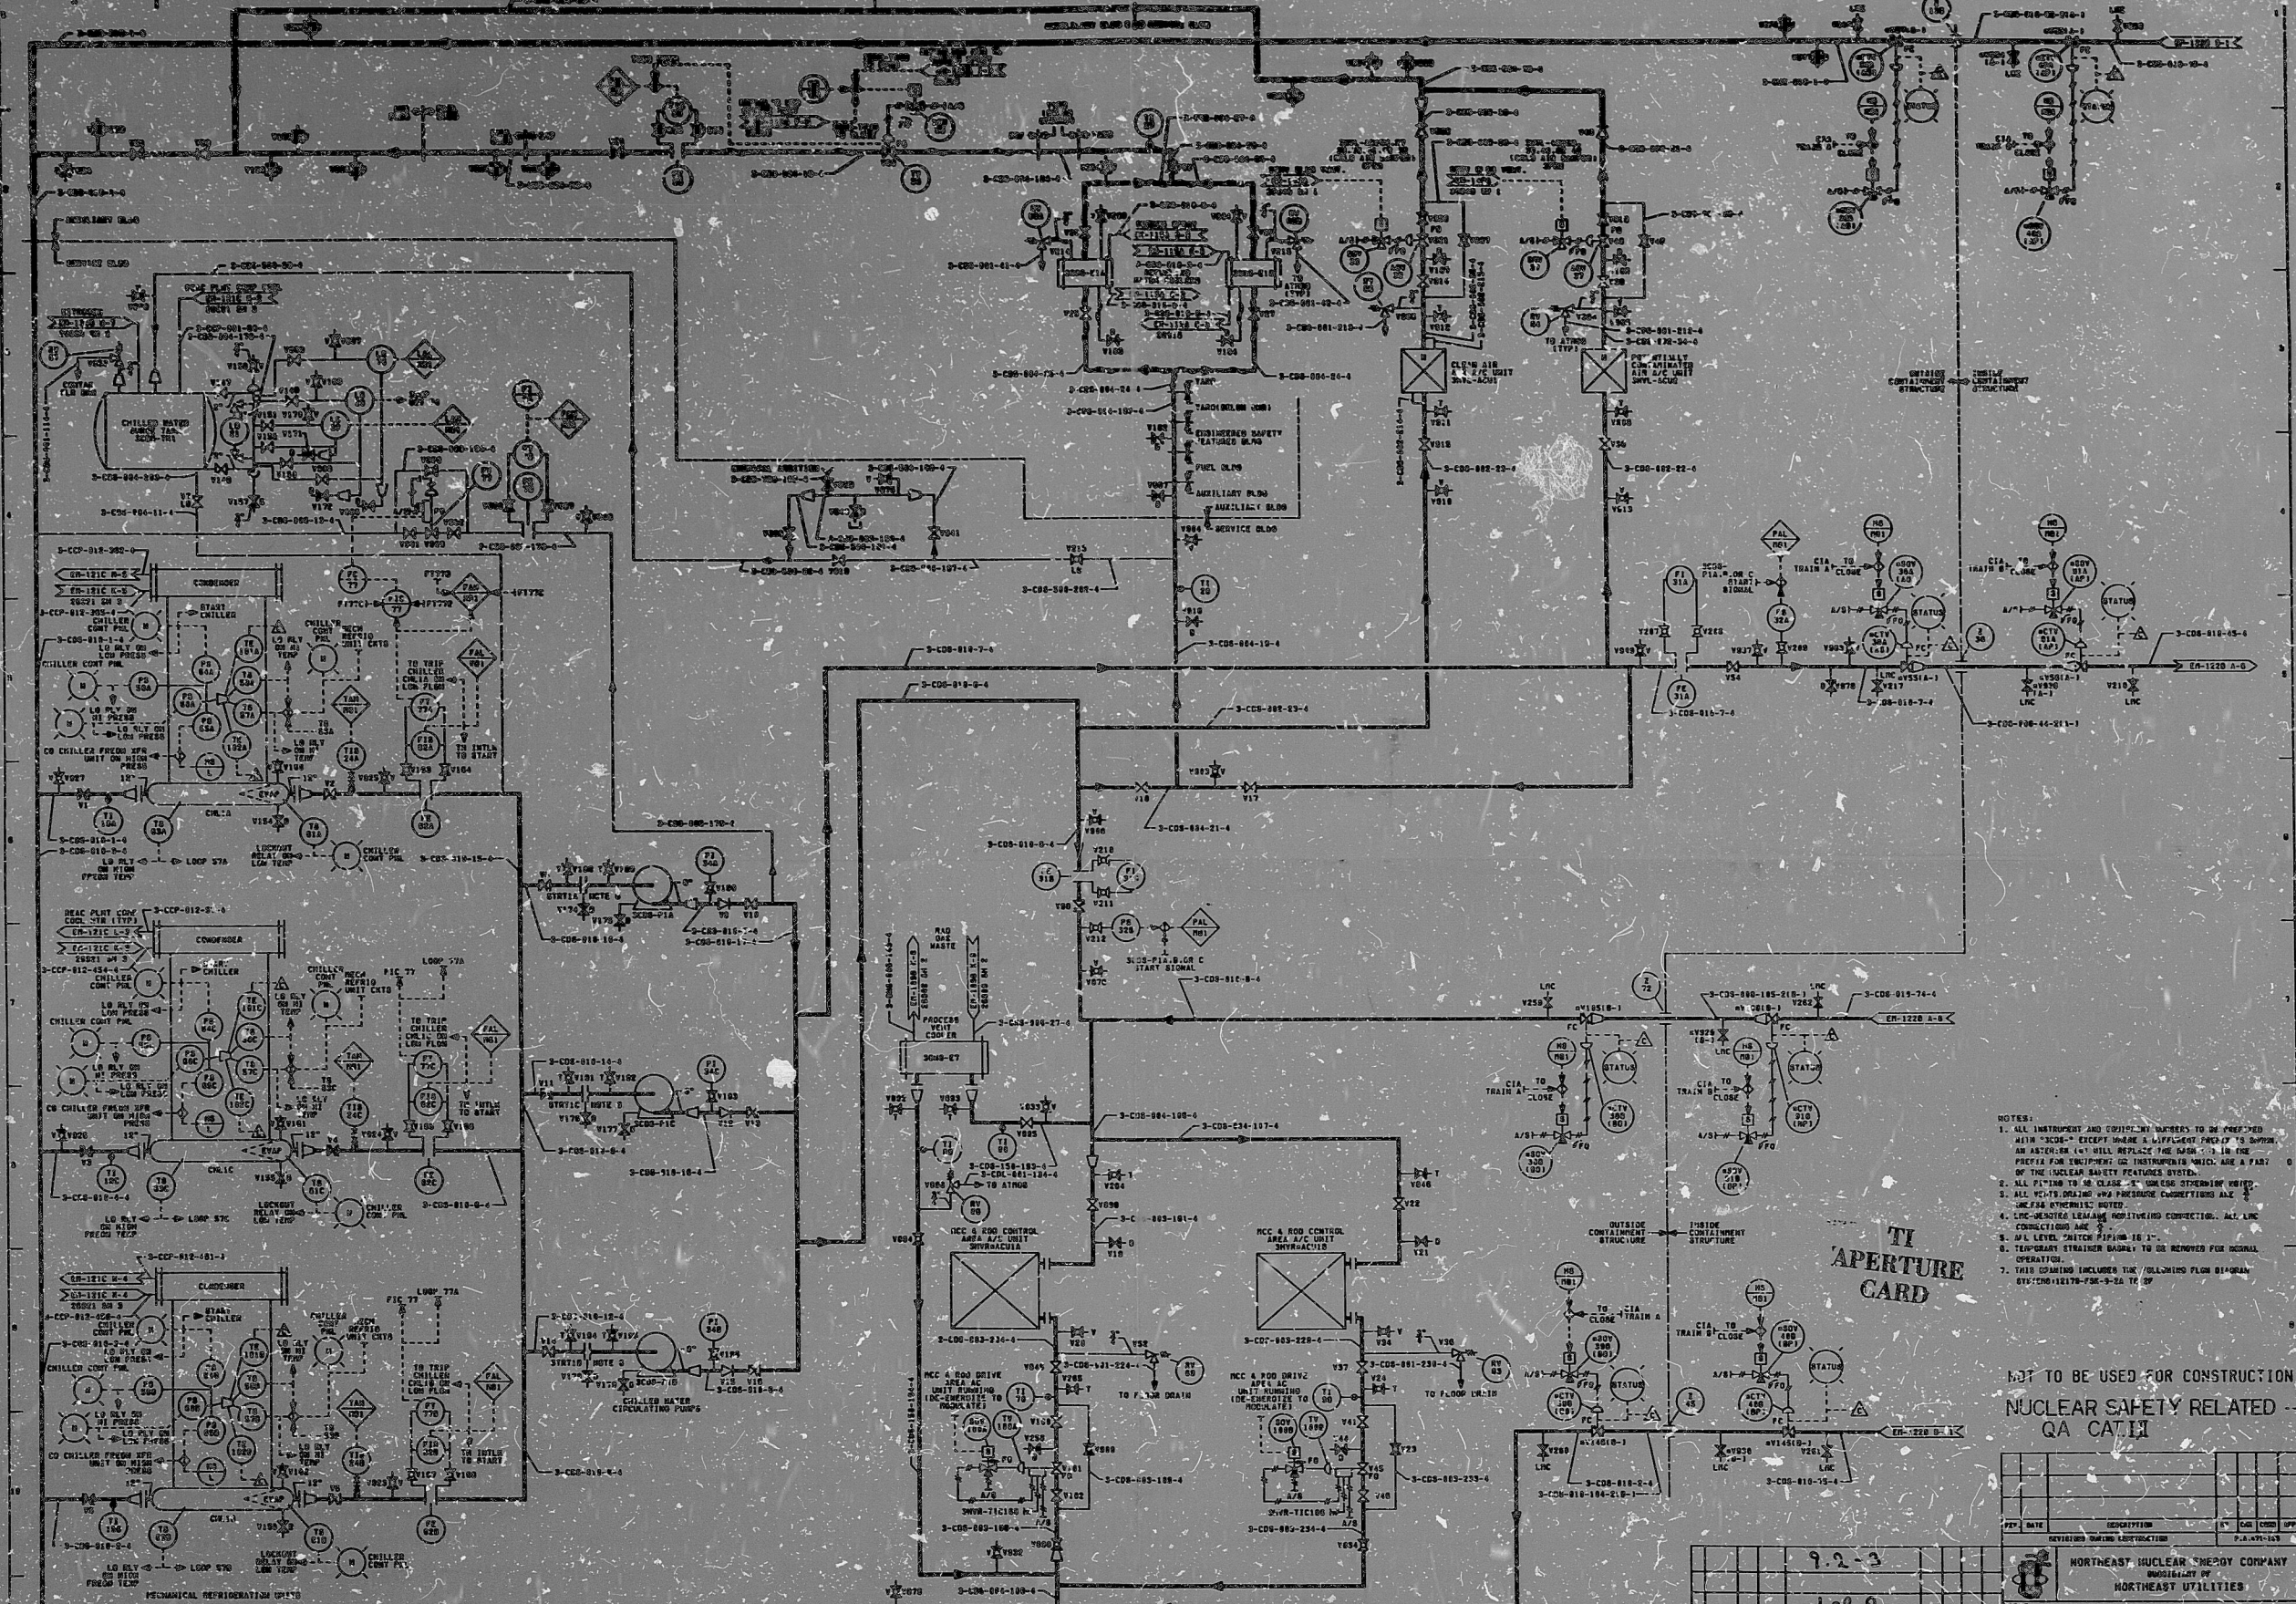

- NOTES:
1. ALL INSTRUMENT AND CONTROL SYMBOLS TO BE PROVIDED WITH "CODE" EXCEPT WHERE A DIFFERENT SYMBOL IS SHOWN. AN APOSTROPHE (') WILL REPLACE THE NUMBER 1 IN THE PREFIX FOR INSTRUMENTS OF THIS TYPE WHICH ARE A PART OF THE NUCLEAR SAFETY FEATURE SYSTEM.
 2. ALL PIPING IS 2" UNLESS OTHERWISE SPECIFIED.
 3. ALL 45-Degree AND 90-Degree CONNECTIONS ARE AS SHOWN UNLESS NOTED.
 4. LINC-MENTRA LEAKAGE MONITORING CONNECTION, ALL LINC CONNECTIONS ARE 1/2" UNLESS OTHERWISE NOTED.
 5. ALL LEVEL SWITCH PIPING IS 1/2" UNLESS OTHERWISE NOTED.
 6. TEMPERATURE STRAINER BAGS TO BE REMOVED FOR NORMAL OPERATION.
 7. THIS DRAWING INCLUDES THE FOLLOWING Piping Diagrams: 3-CW-110-1-4 TO 3-CW-110-10-4

TI APERTURE CARD

NOT TO BE USED FOR CONSTRUCTION
NUCLEAR SAFETY RELATED
QA CATER

REV	DATE	DESCRIPTION	BY	CHK	APP
1	9-2-73	ISSUED FOR CONSTRUCTION			

9-2-73
1 of 2

NORTHEAST NUCLEAR COMPANY		NORTHEAST UTILITIES	
TITLE: BILLSTONE NUCLEAR POWER STATION UNIT 2 PIPING & INSTRUMENTATION DIAGRAM REACTOR PLANT CHILLED WATER SYSTEM			
DATE: 9-2-73	SCALE: AS SHOWN	PROJECT NO: 25212-REACTOR 1 OF 2	DESIGNER: STONE & HEWLETT ENGINEERING CORPORATION
S&H DWG NO 12179-EH-122A-1		CHECKED BY: B.T. LAM	

THE INFORMATION ON THIS DRAWING MAY NOT BE USED FOR ANY OTHER PURPOSE THAN THE ORIGINAL INTENT UNLESS SO INDICATED BY THE TITLE BLOCK.

LEVEL	DATE	REVISION	BY	CHK	APP
1					

PDR RIDS

8406020102

