


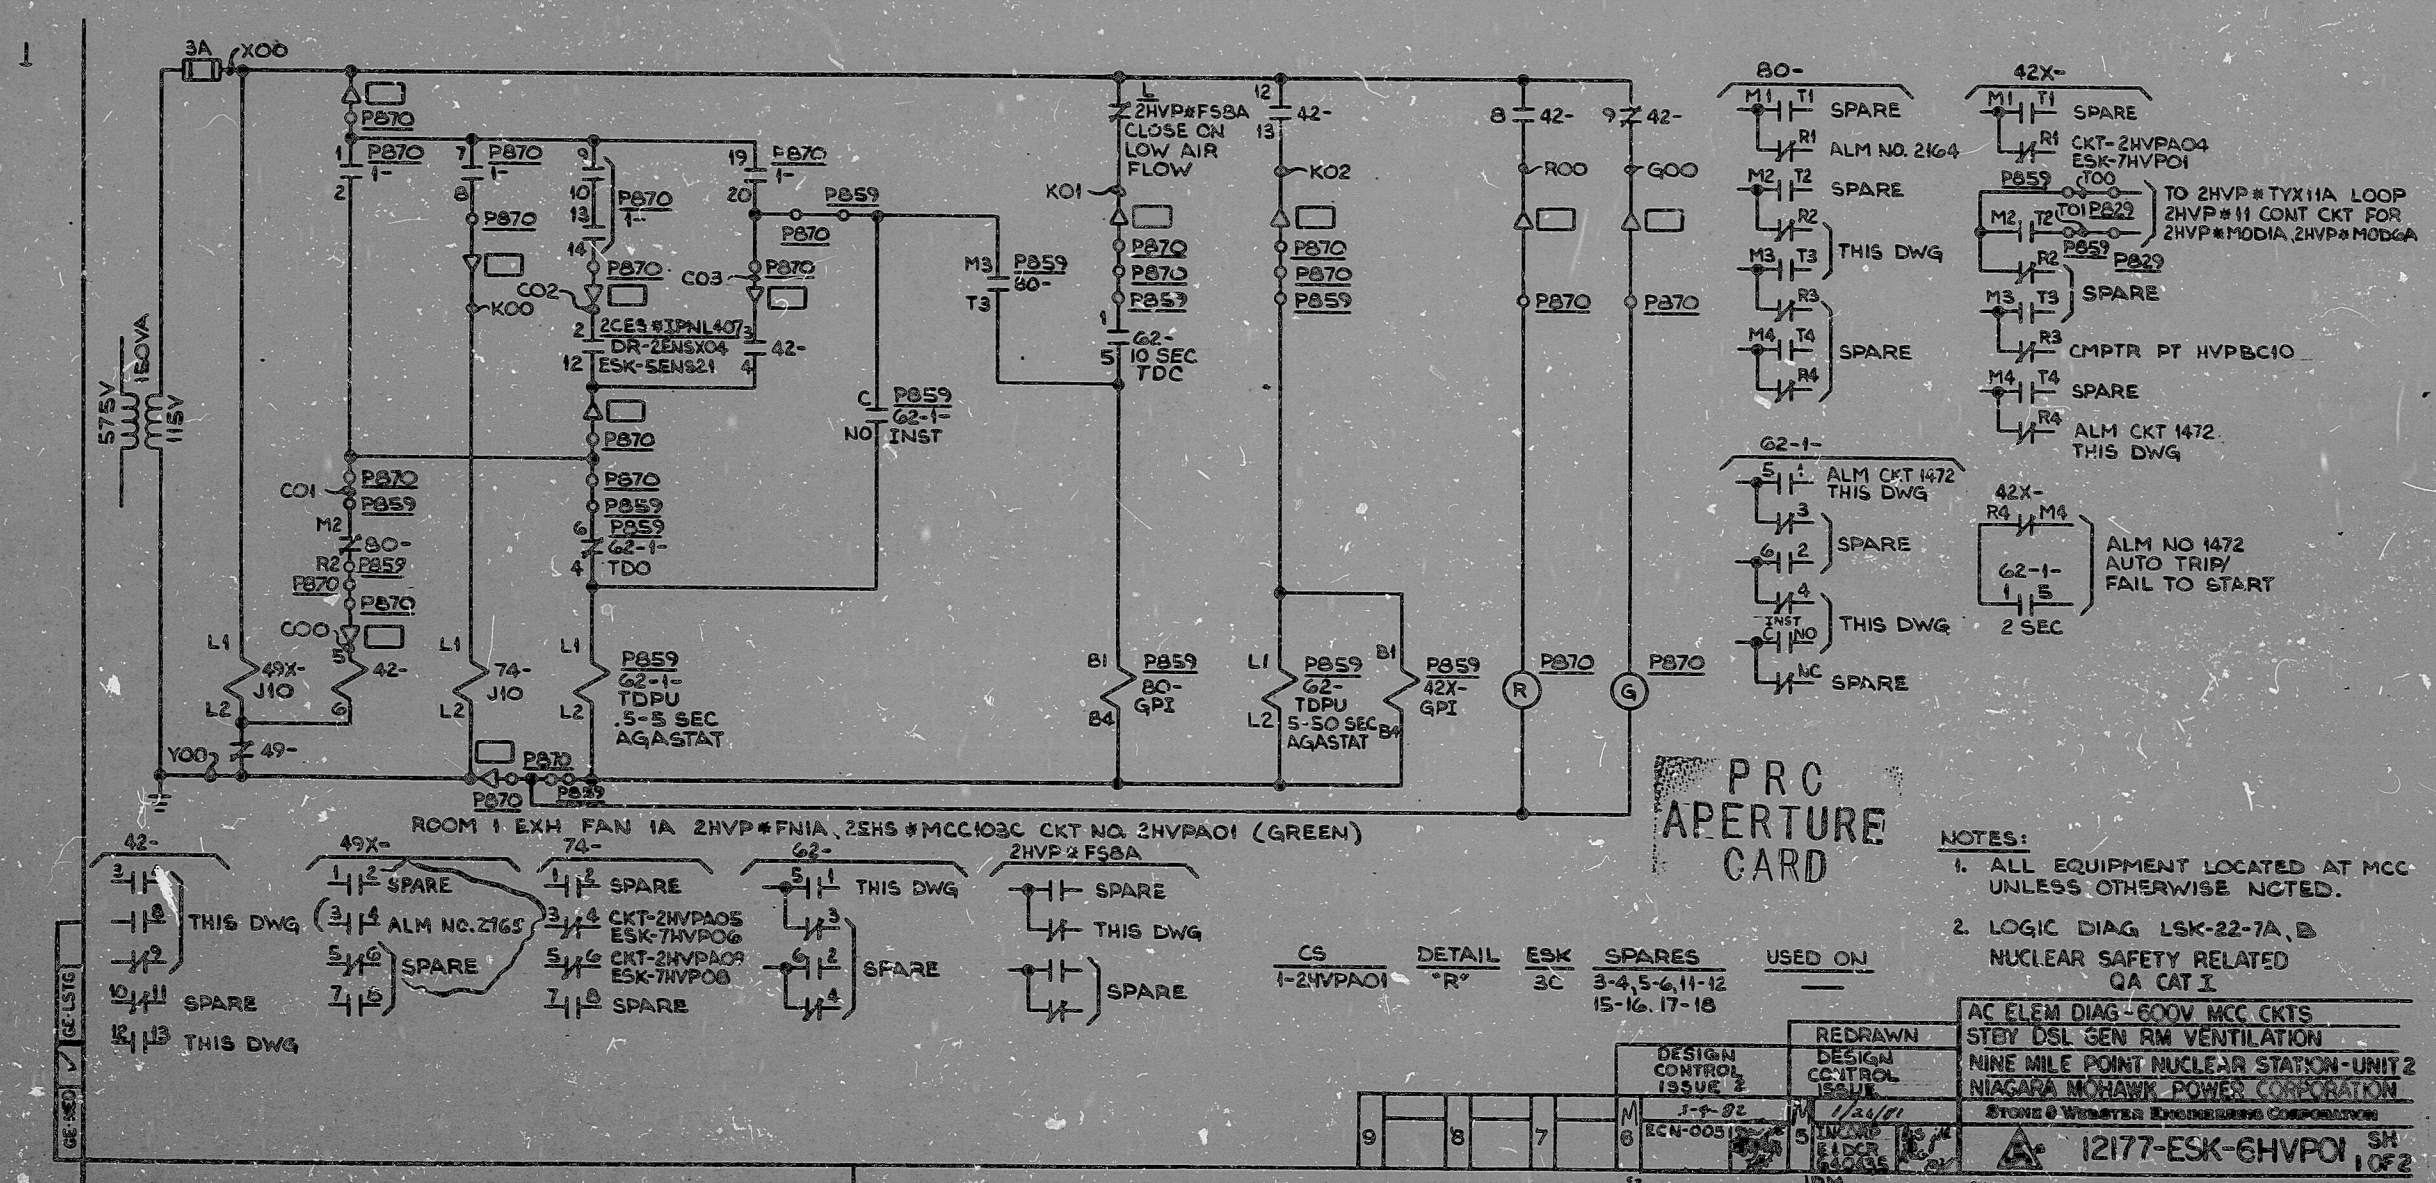

PRC
APERTURE
CARD

- NOTES:
- 1. ALL EQUIPMENT LOCATED AT MCC UNLESS OTHERWISE NOTED.
 - 2. LOGIC DIAG LSK-22-7A,B NUCLEAR SAFETY RELATED QA CAT I

CS	DETAIL	ESK	SPARES	USED ON
1-2HVP#AO1	"R"	3C	3-4, 5-6, 11-12 15-16, 17-18	

DESIGN CONTROL	REDRAWN
ISSUE 2	DESIGN CONTROL
1-9-82	1/24/81
ECN-0051	1/24/81

9	8	7	6	5	4	3	2	1
---	---	---	---	---	---	---	---	---

AC ELEM DIAG-600V MCC CKTS
STEY DSL GEN RM VENTILATION
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WINTER ENGINEERING CORPORATION
12177-ESK-6HVP01 SH
1 OF 2

RIDS

8305090294

