


POOR ORIGINAL

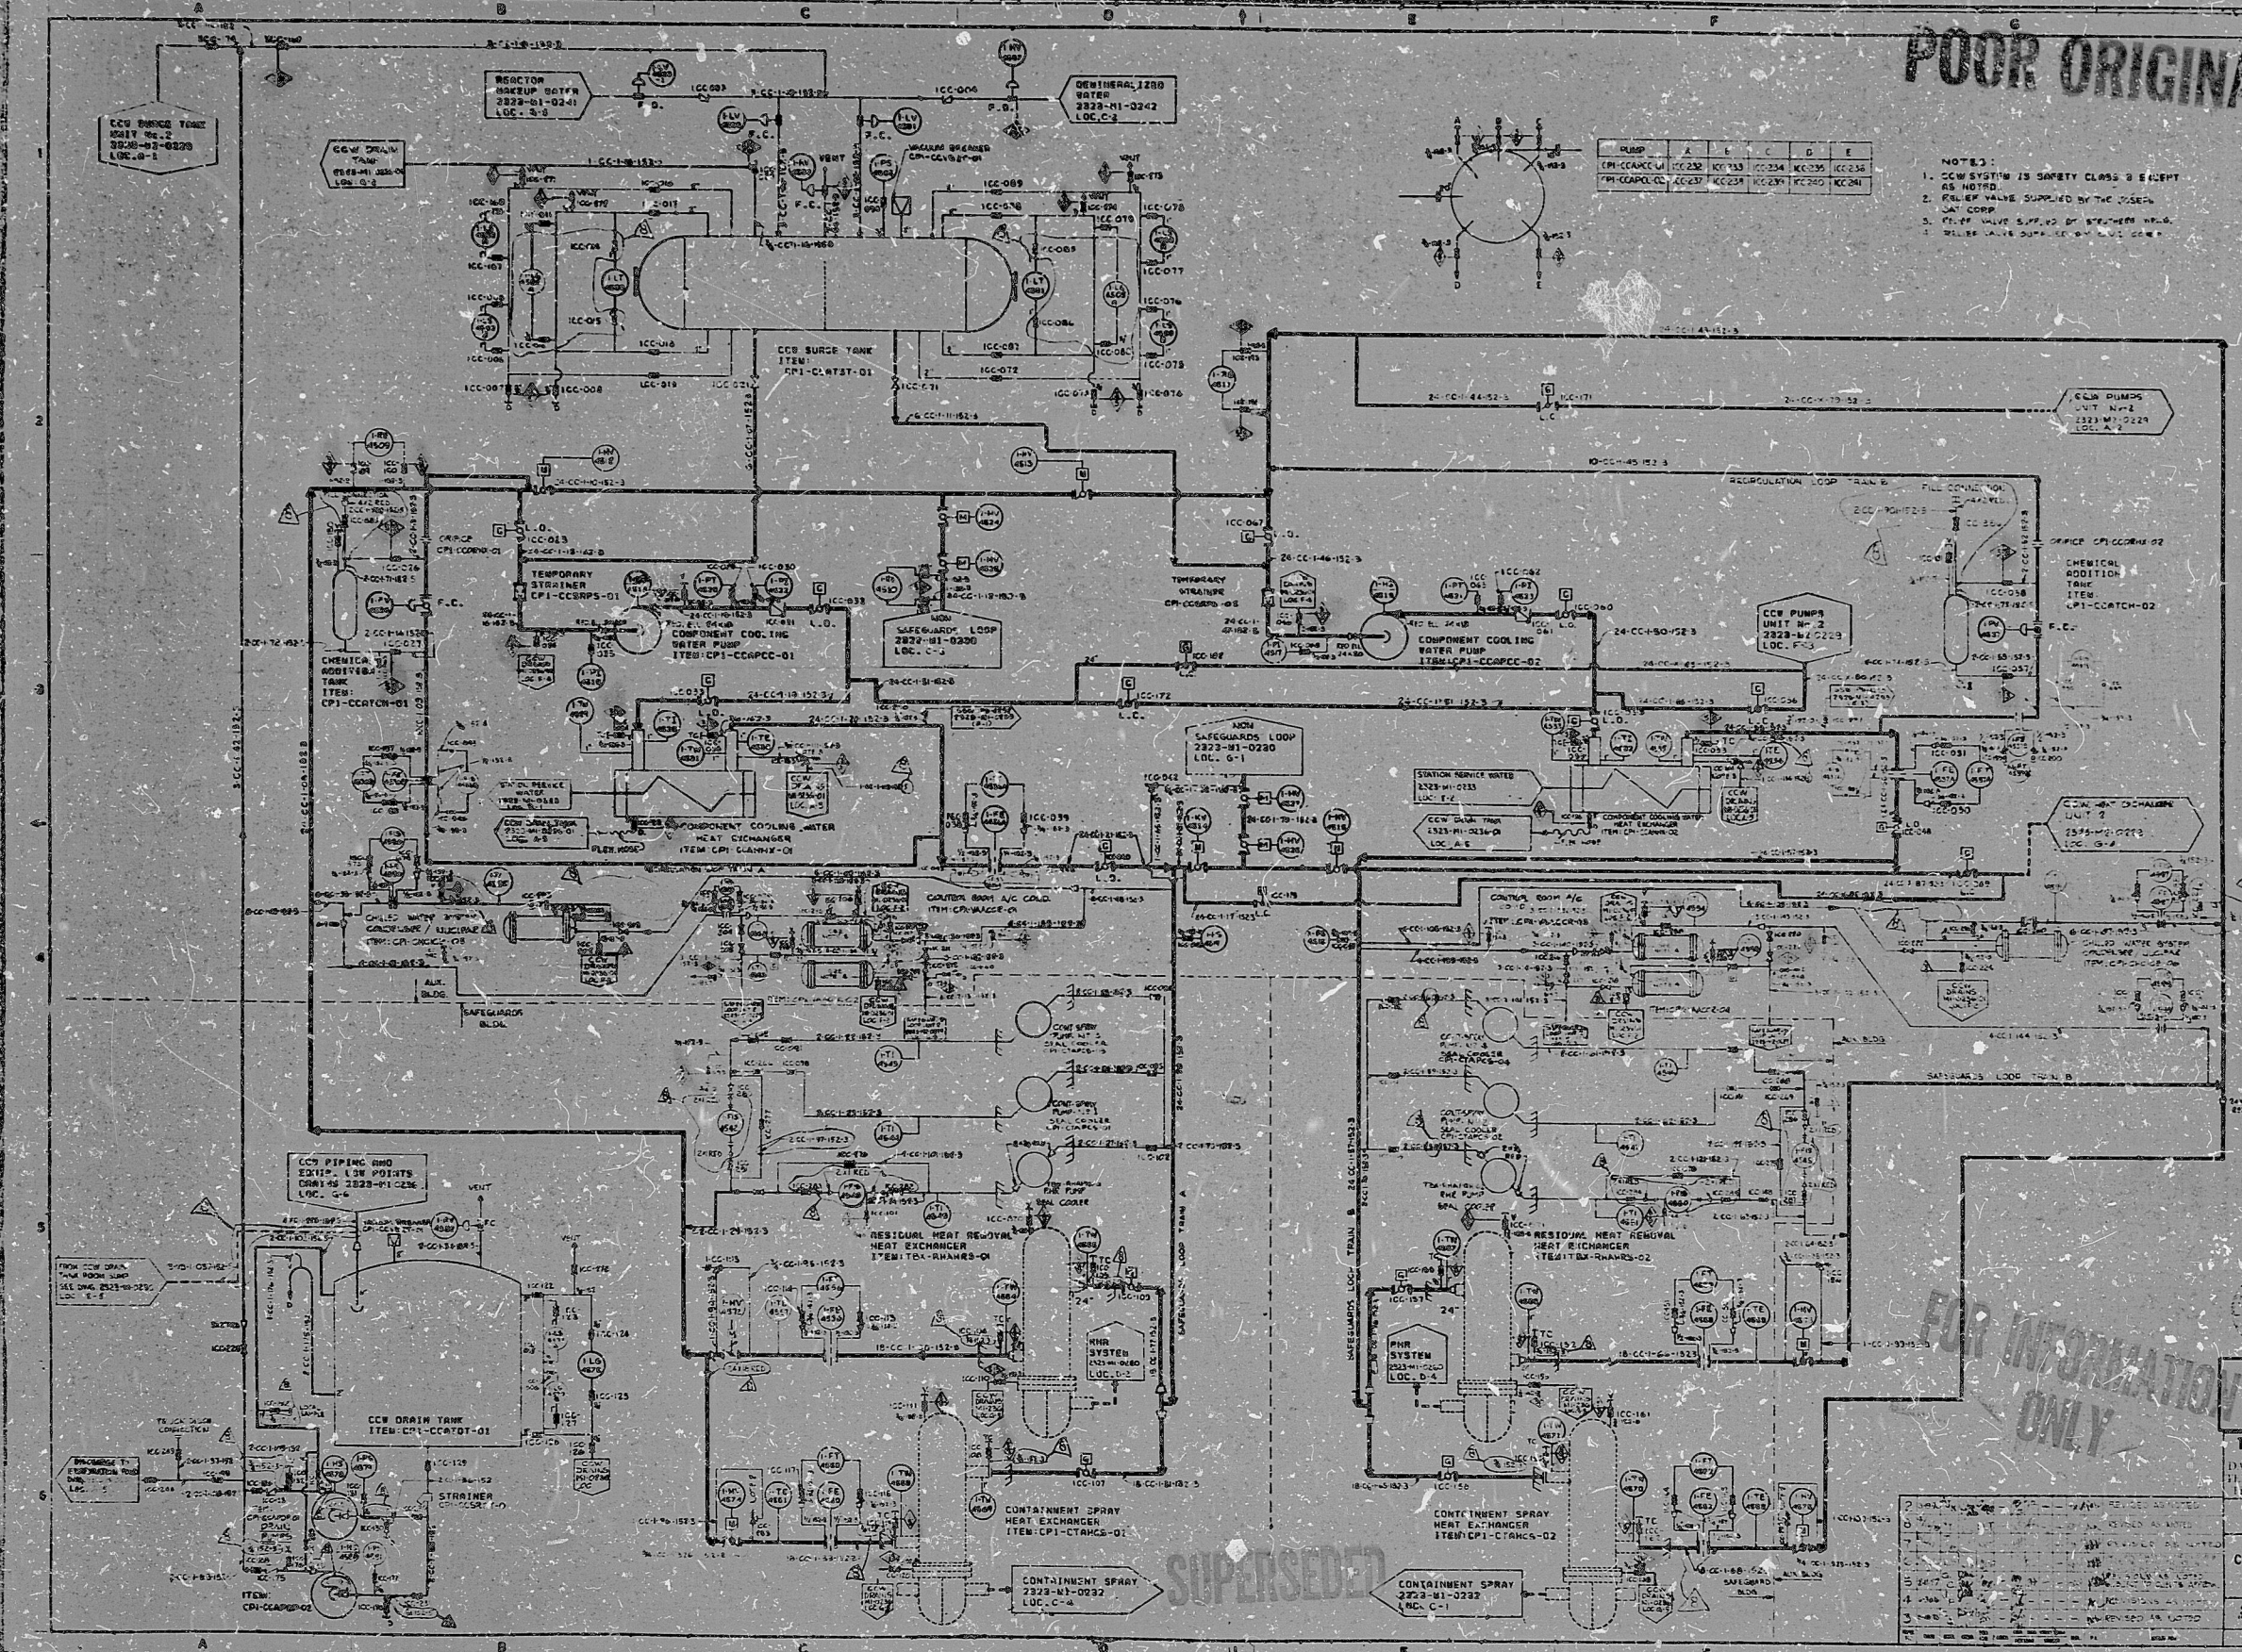

PUMP	A	B	C	D	E
CPI-CCCPCC-01	CC-230	CC-113	CC-234	CC-235	CC-236
TR-CCAPCC-01	CC-237	CC-238	CC-239	CC-240	CC-241

- NOTES:
1. CCW SYSTEM IS SAFETY CLASS 3 EXCEPT AS NOTED.
  2. RELIEF VALVE SUPPLIED BY THE USER. (AT CORP.)
  3. FLEET VALVE SUPPLIES BY STEVENSON.
  4. RELIEF VALVE SUPPLIES BY STEVENSON.

TI APERTURE CARD

FOR INFORMATION ONLY

**CLASS I**

TEKRA UTILITIES SERVICES INC.  
DALLAS POWER & LIGHT COMPANY  
PLANS & ENGINEERING SERVICE COMPANY  
PLANS ENGINEERING COMPANY

FLOW DIAGRAM  
COMPONENT COOLING WATER  
SYSTEM  
SHEET 1 OF 3

2323-MI-0229

SUPERSEDED

01-36

77  
11  
8.5"  
8.5"  
11"  
17"

PDR RIDS

8406280001

