


POOR ORIGINAL

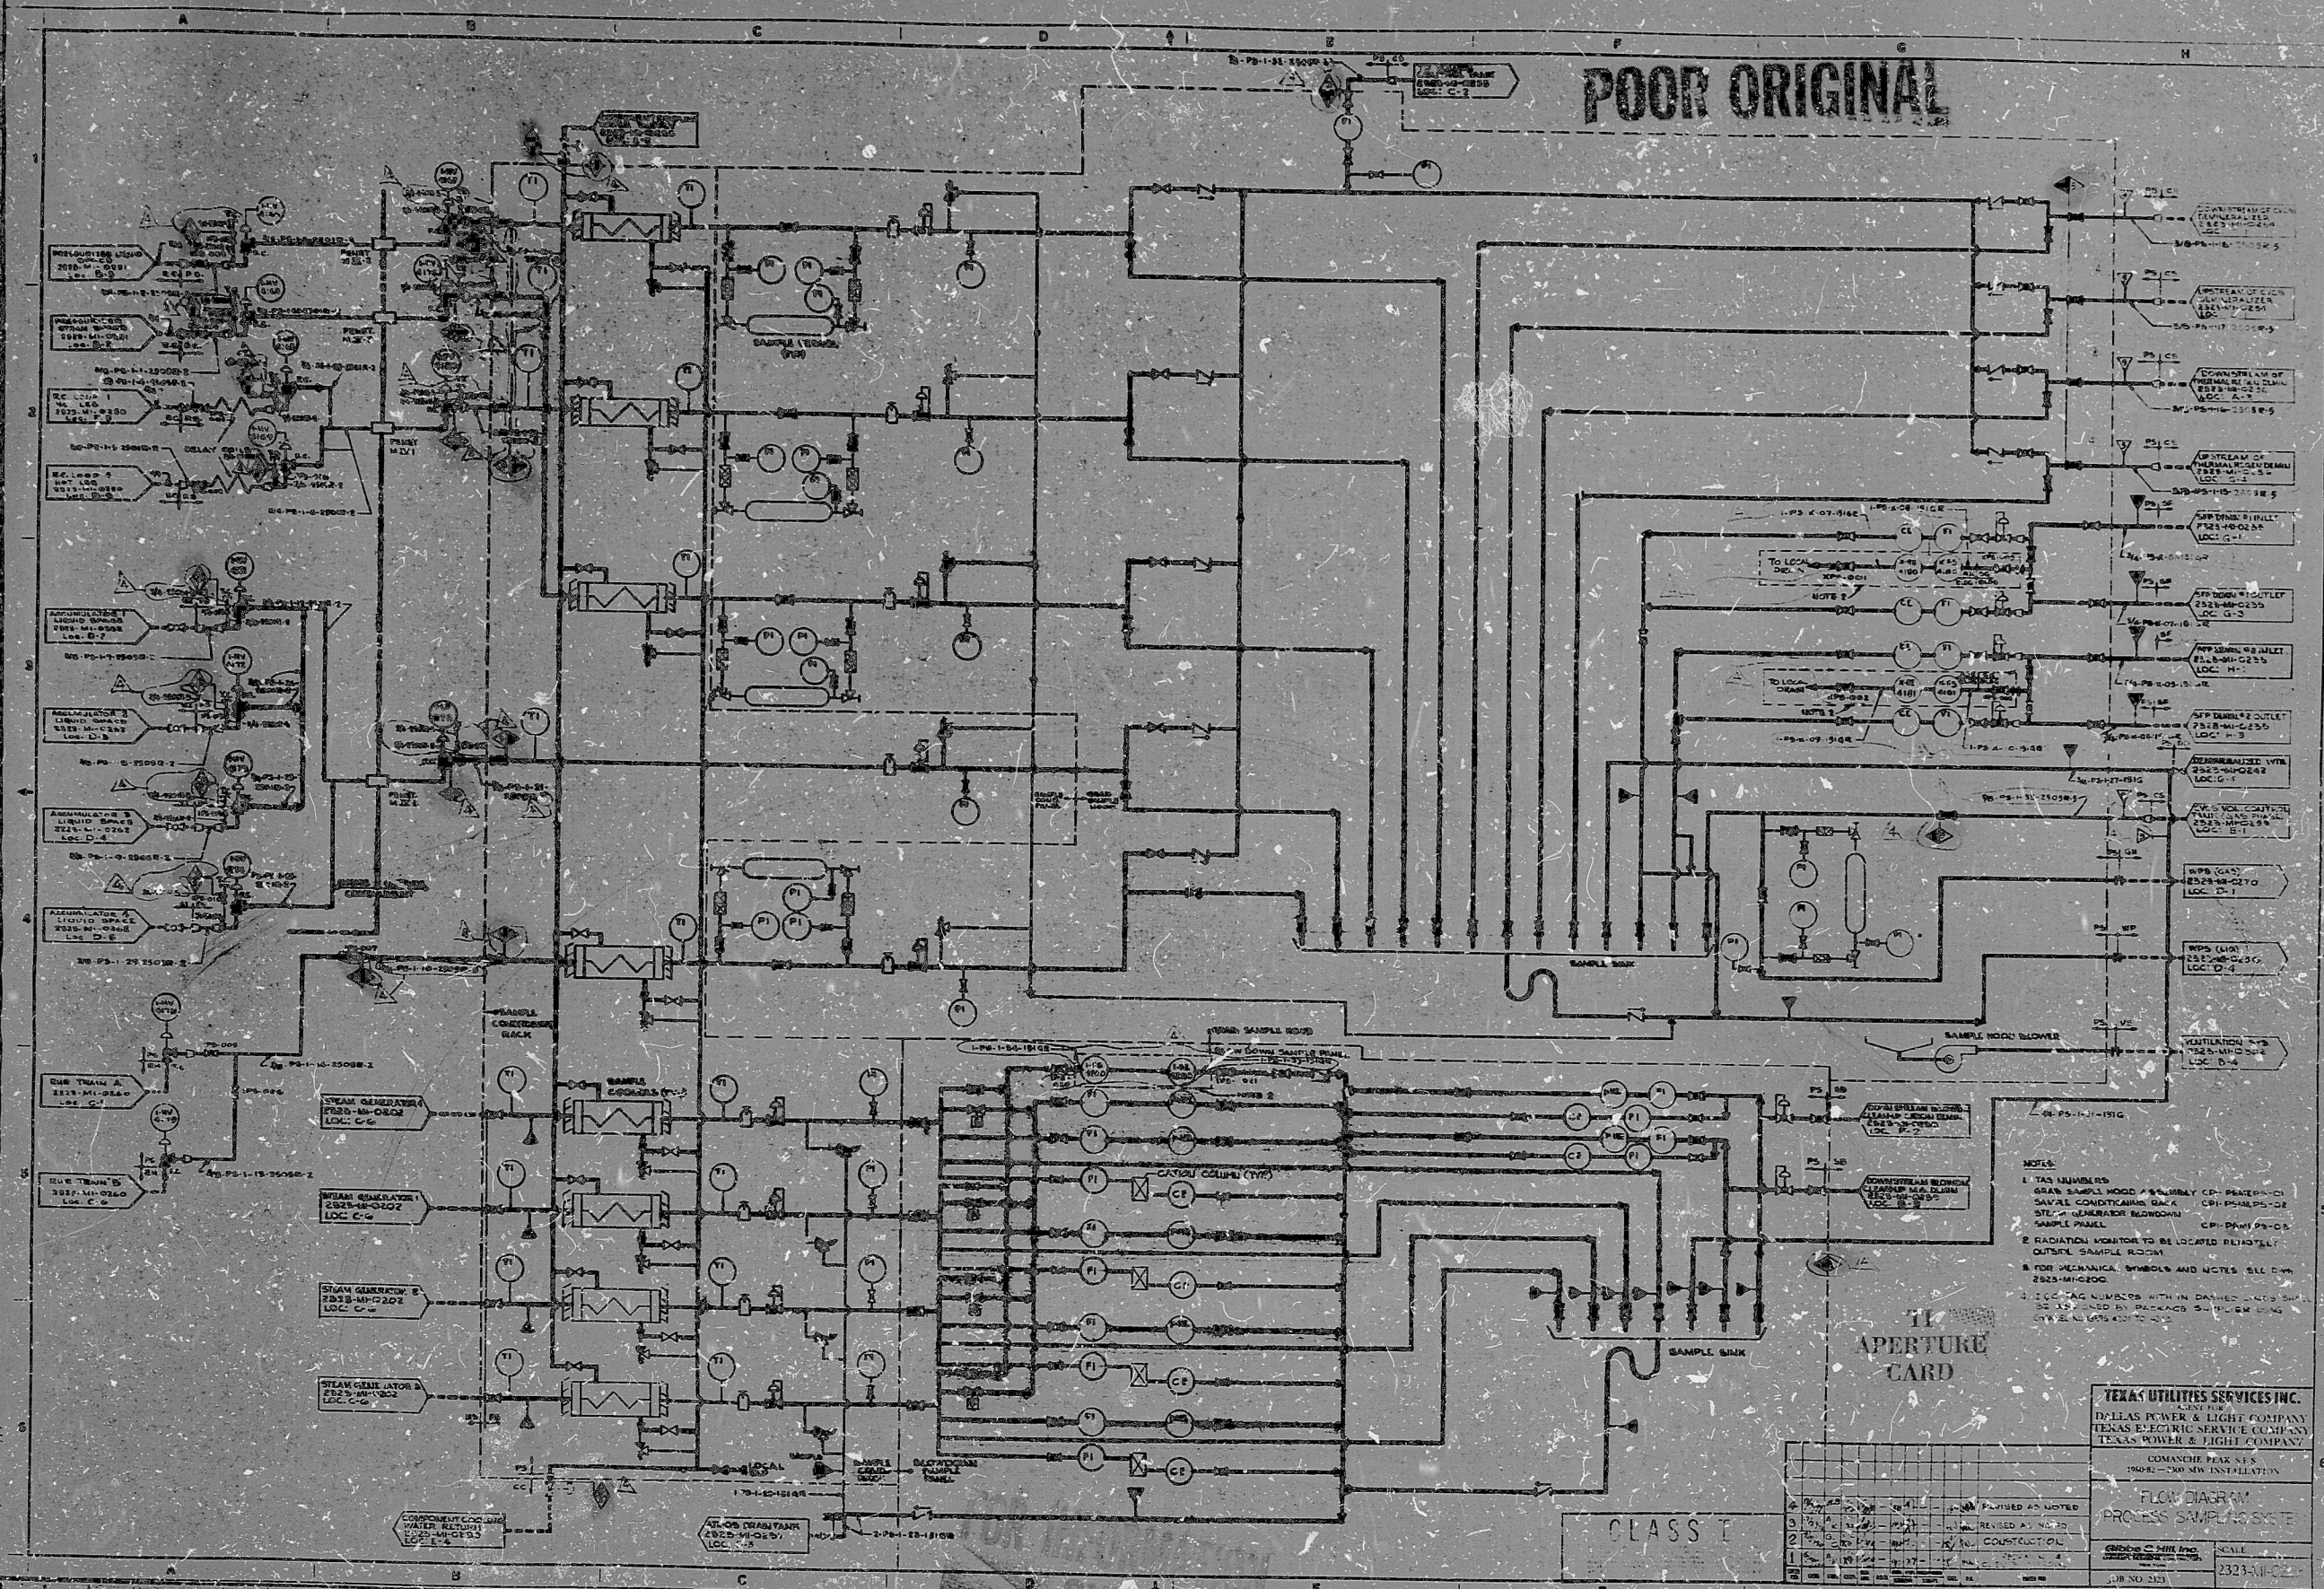

- NOTES:
- 1 TAG NUMBERS
  - 2 GRAIN SAMPLE HOOD & BATTERY CP-1000-001
  - 3 SAMPLE CONDENSING WATER CP-1000-002
  - 4 STEAM GENERATOR BLOWDOWN CP-1000-003
  - 5 SAMPLE PANEL CP-1000-004
  - 6 RADIATION MONITOR TO BE LOCATED RELATIVE TO OTHER SAMPLE HOODS
  - 7 FOR MECHANICAL SYMBOLS AND NOTES SEE DWG 2825-MH-0200
  - 8 I.D. TAG NUMBERS WITH IN DASHED LINES SHALL BE AS SHOWN IN BATTERY SUPPLY DWG 2825-MH-0200

APERTURE CARD

TEXAS UTILITIES SERVICES INC.  
 DALLAS POWER & LIGHT COMPANY  
 TEXAS ELECTRIC SERVICE COMPANY  
 TEXAS POWER & LIGHT COMPANY

COMANCHE PEAK #1  
 1960-61 - 200 MW INSTALLATION

FLOW DIAGRAM  
 PROCESS SAMPLE SYSTEM

CLASS T

|         |                 |                  |
|---------|-----------------|------------------|
| DATE    | BY              | REVISION         |
| 11/1/61 | J. H. [unclear] | REVISED AS NOTED |
| 11/1/61 | J. H. [unclear] | REVISED AS NOTED |
| 11/1/61 | J. H. [unclear] | CONSTRUCTION     |

SCALE  
 2323-MH-0200



PDR RIDS

8406280002

