




MISCELLANEOUS HVAC SYSTEM CONTROL ROOM OFFICES HEATING COIL HOT WATER RECIRCULATION

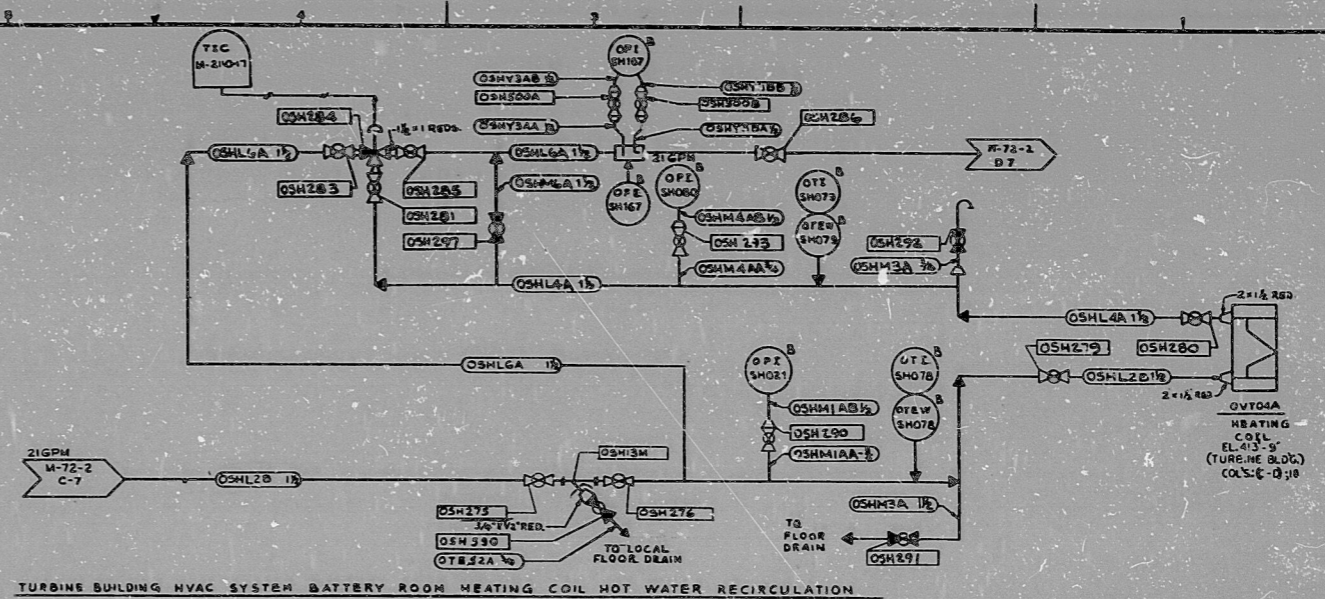

TURBINE BUILDING HVAC SYSTEM BATTERY ROOM HEATING COIL HOT WATER RECIRCULATION

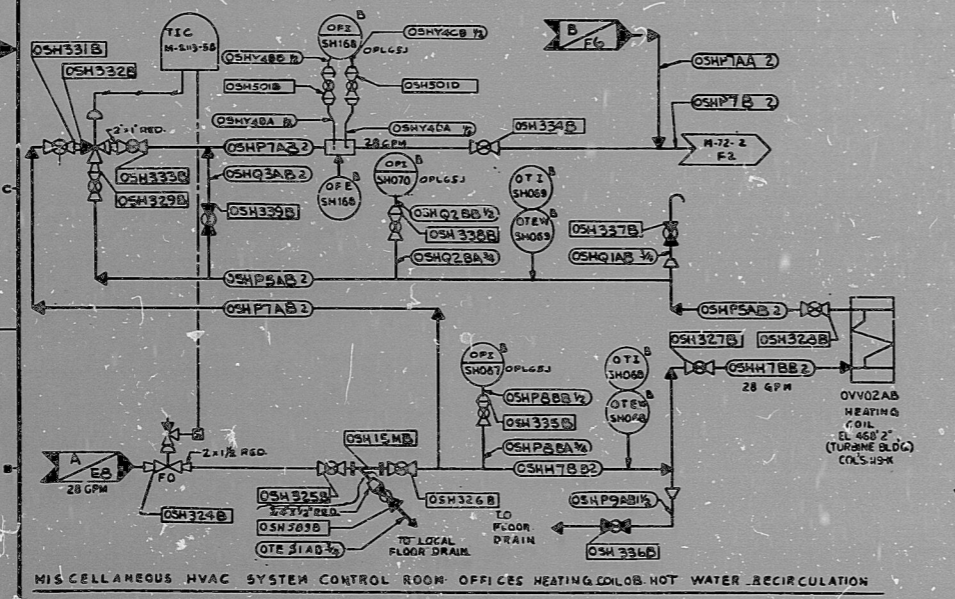

MISCELLANEOUS HVAC SYSTEM CONTROL ROOM OFFICES HEATING COIL HOT WATER RECIRCULATION

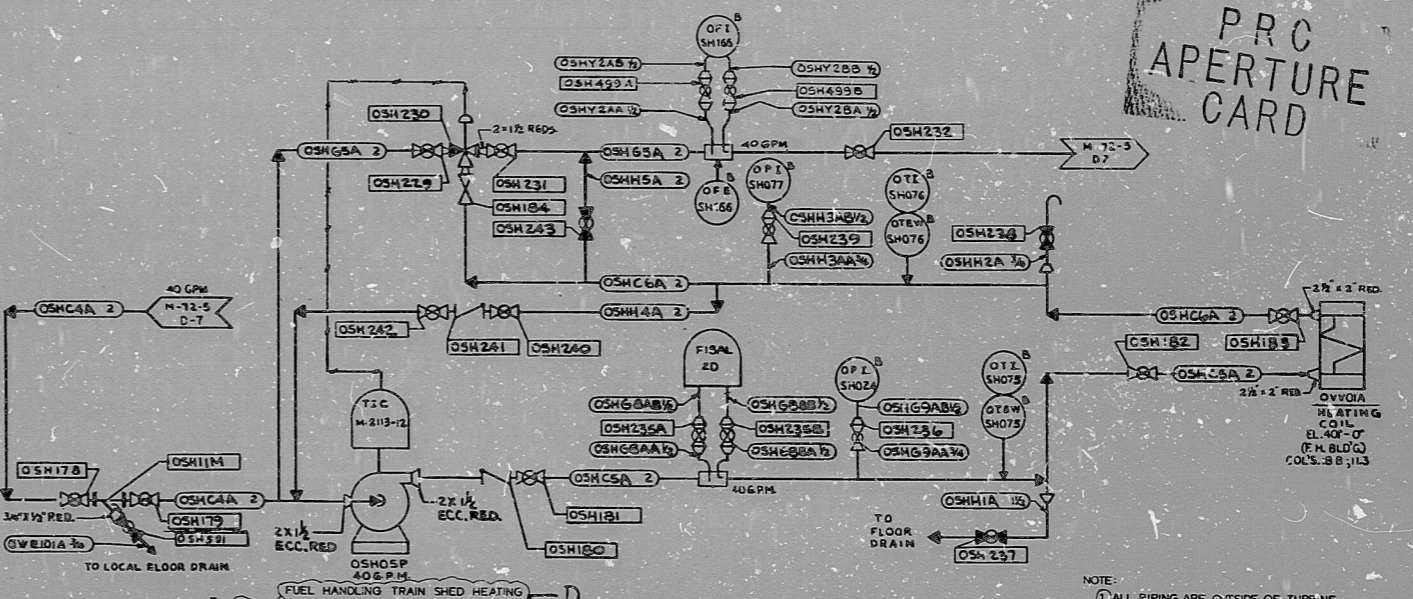

MISCELLANEOUS HVAC SYSTEM TRAIN SHED HEATING COIL HOT WATER RECIRCULATION


PRO APERTURE CARD

NOTE:  
 1 ALL PIPING ARE OUTSIDE OF TURBINE BUILDING EXCEPT AS NOTED  
 2 ALL PIPING IN THE INDOOR AREAS ARE UNDER E-2739 - FURNISHED BY 2" - 6" - Y-2739 - INSTALLED BY  
 2 1/2" - 4" - Y-2962 - FURNISHED BY LARGER - Y-2739 - INSTALLED BY

DRAWING RELEASE RECORD				DRAWING RELEASE RECORD				PROJECT NUMBER		DIAGRAM OF STATION HEATING SYSTEM HOT WATER HTG COIL DETAILS	
REV	DATE	BY	REASON	REV	DATE	BY	REASON	PROJECT NUMBER	DATE	BY	REASON
A	11-19-78										
B	11-22-78										
C	11-27-78										
D	12-11-78										
E	12-21-78										

DRAWING RELEASE RECORD				DRAWING RELEASE RECORD				PROJECT NUMBER		DIAGRAM OF STATION HTG SYS. HOT WATER HTG COIL DETAILS	
REV	DATE	BY	REASON	REV	DATE	BY	REASON	PROJECT NUMBER	DATE	BY	REASON
C	1-17-80										
D	3-3-81										



PROJECT NUMBER: M-72  
 DATE: 12-21-78  
 BY: [Signature]  
 REASON: [Text]  
 PROJECT NUMBER: M-72  
 DATE: 12-21-78  
 BY: [Signature]  
 REASON: [Text]



8305090747

**RIDS**  
1/2

