



J-101-0 S.H.T.
2

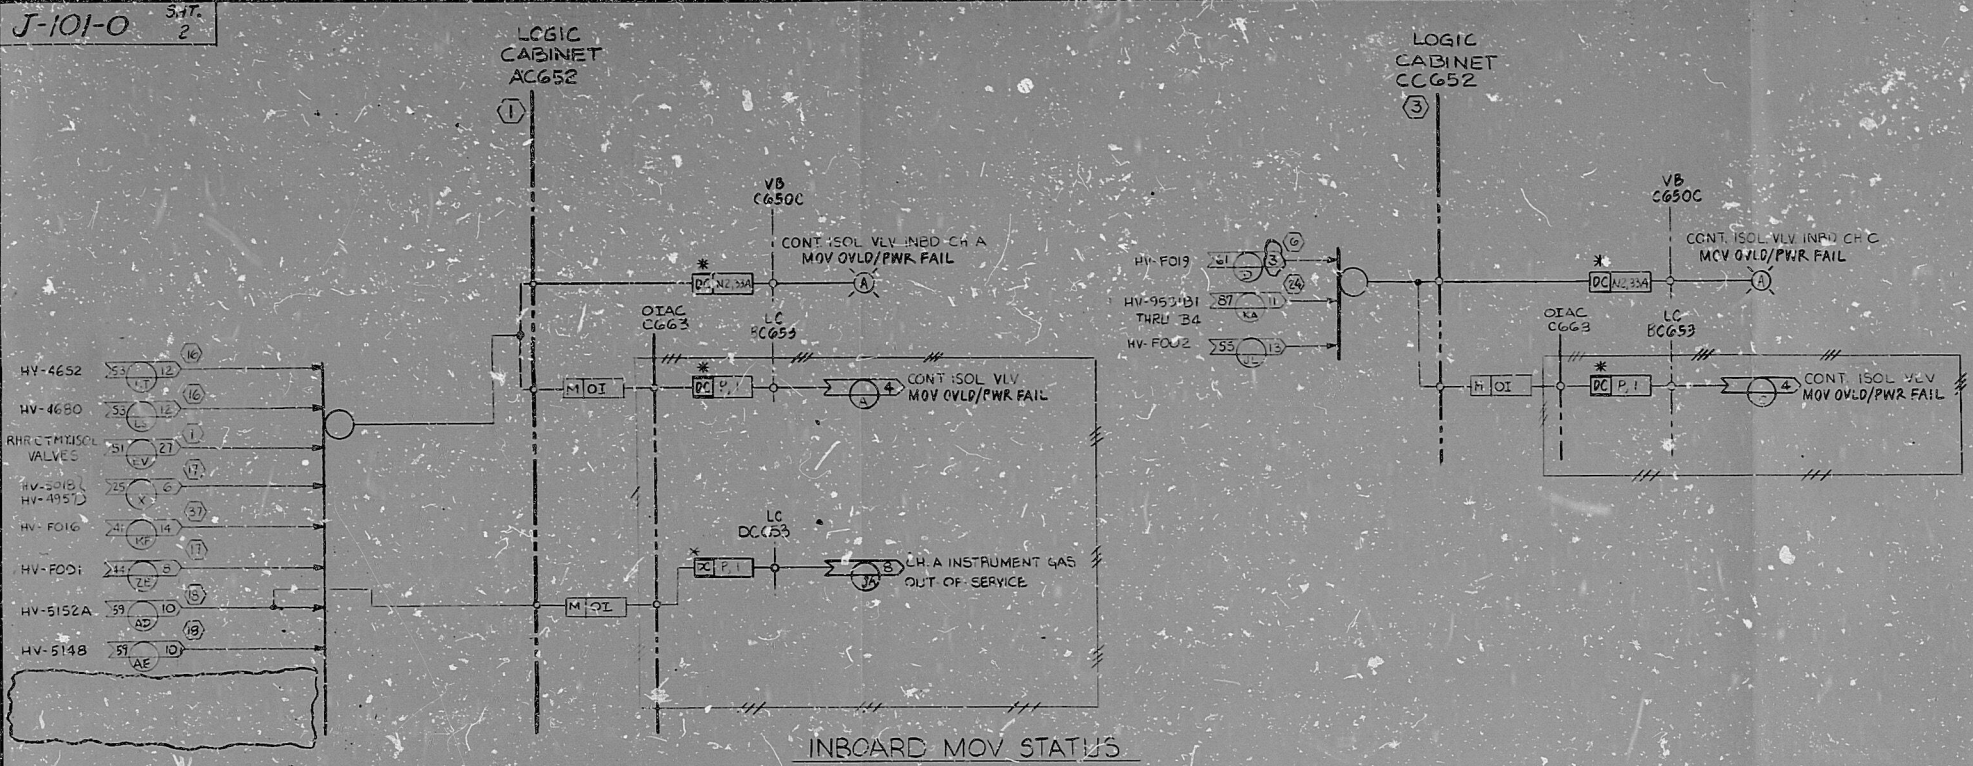

NOTES:

1. ALL CIRCUIT NUMBERS SHOWN WITH INPUT ARROWS APPLY TO AND ORIGINATE ON THE INTERFACING LOGIC DIAGRAM.

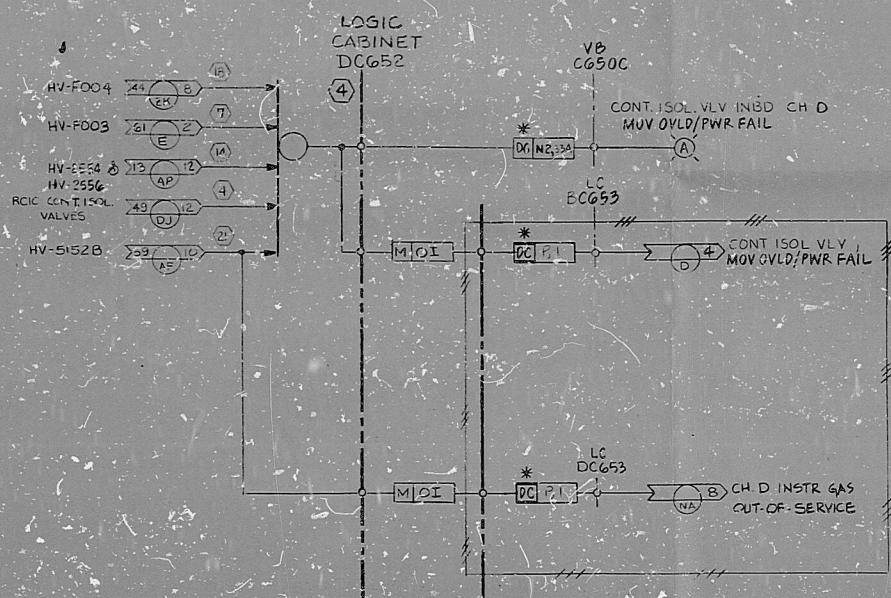

XIL-7900A	XIL-7900B	XIL-7900C	XIL-7900D
INBD CH. A (A)		INBD CH. C (A)	INBD CH. D (A)
OUTBD CH. A (A)	OUTBD CH. B (A)	OUTBD CH. C (A)	OUTBD CH. D (A)

VIS
C 6501

1/15/82	DELETED INMATE SIGNALS 3 WEEK CONSECUTIVE	NO	28	7	PM
1/14/82	DESIGN ERROR - ISSUE	1	2	PM	PM
2/10/82	REVISED BAILEY INTERFACE AND AS NOTED	1	2	PM	PM
2/11/82	REVISED PER CON #1	1	2	PM	PM
1/11/79	ISSUED FOR CONSTRUCTION	1	2	PM	PM
7/16	DATE	REVISIONS	BY	CHNO	DESIGN SUPE
SCALE	NONE	DESIGNED	SF	BRANCH	WIL
BECHTEL SAN FRANCISCO PUBLIC SERVICE ELECTRIC #10 GAS COMPANY HOPE CREEK GENERATING STATION LOG-2 DIAGRAM OUT OF SERVICE STATUS DISPLAY NBOARD 71 STATUS					
JO# No.		DRAWING No.		REV.	
10855		J-101-0 SAT 2		1 G	
					

PDR RIDS

8406290101

