


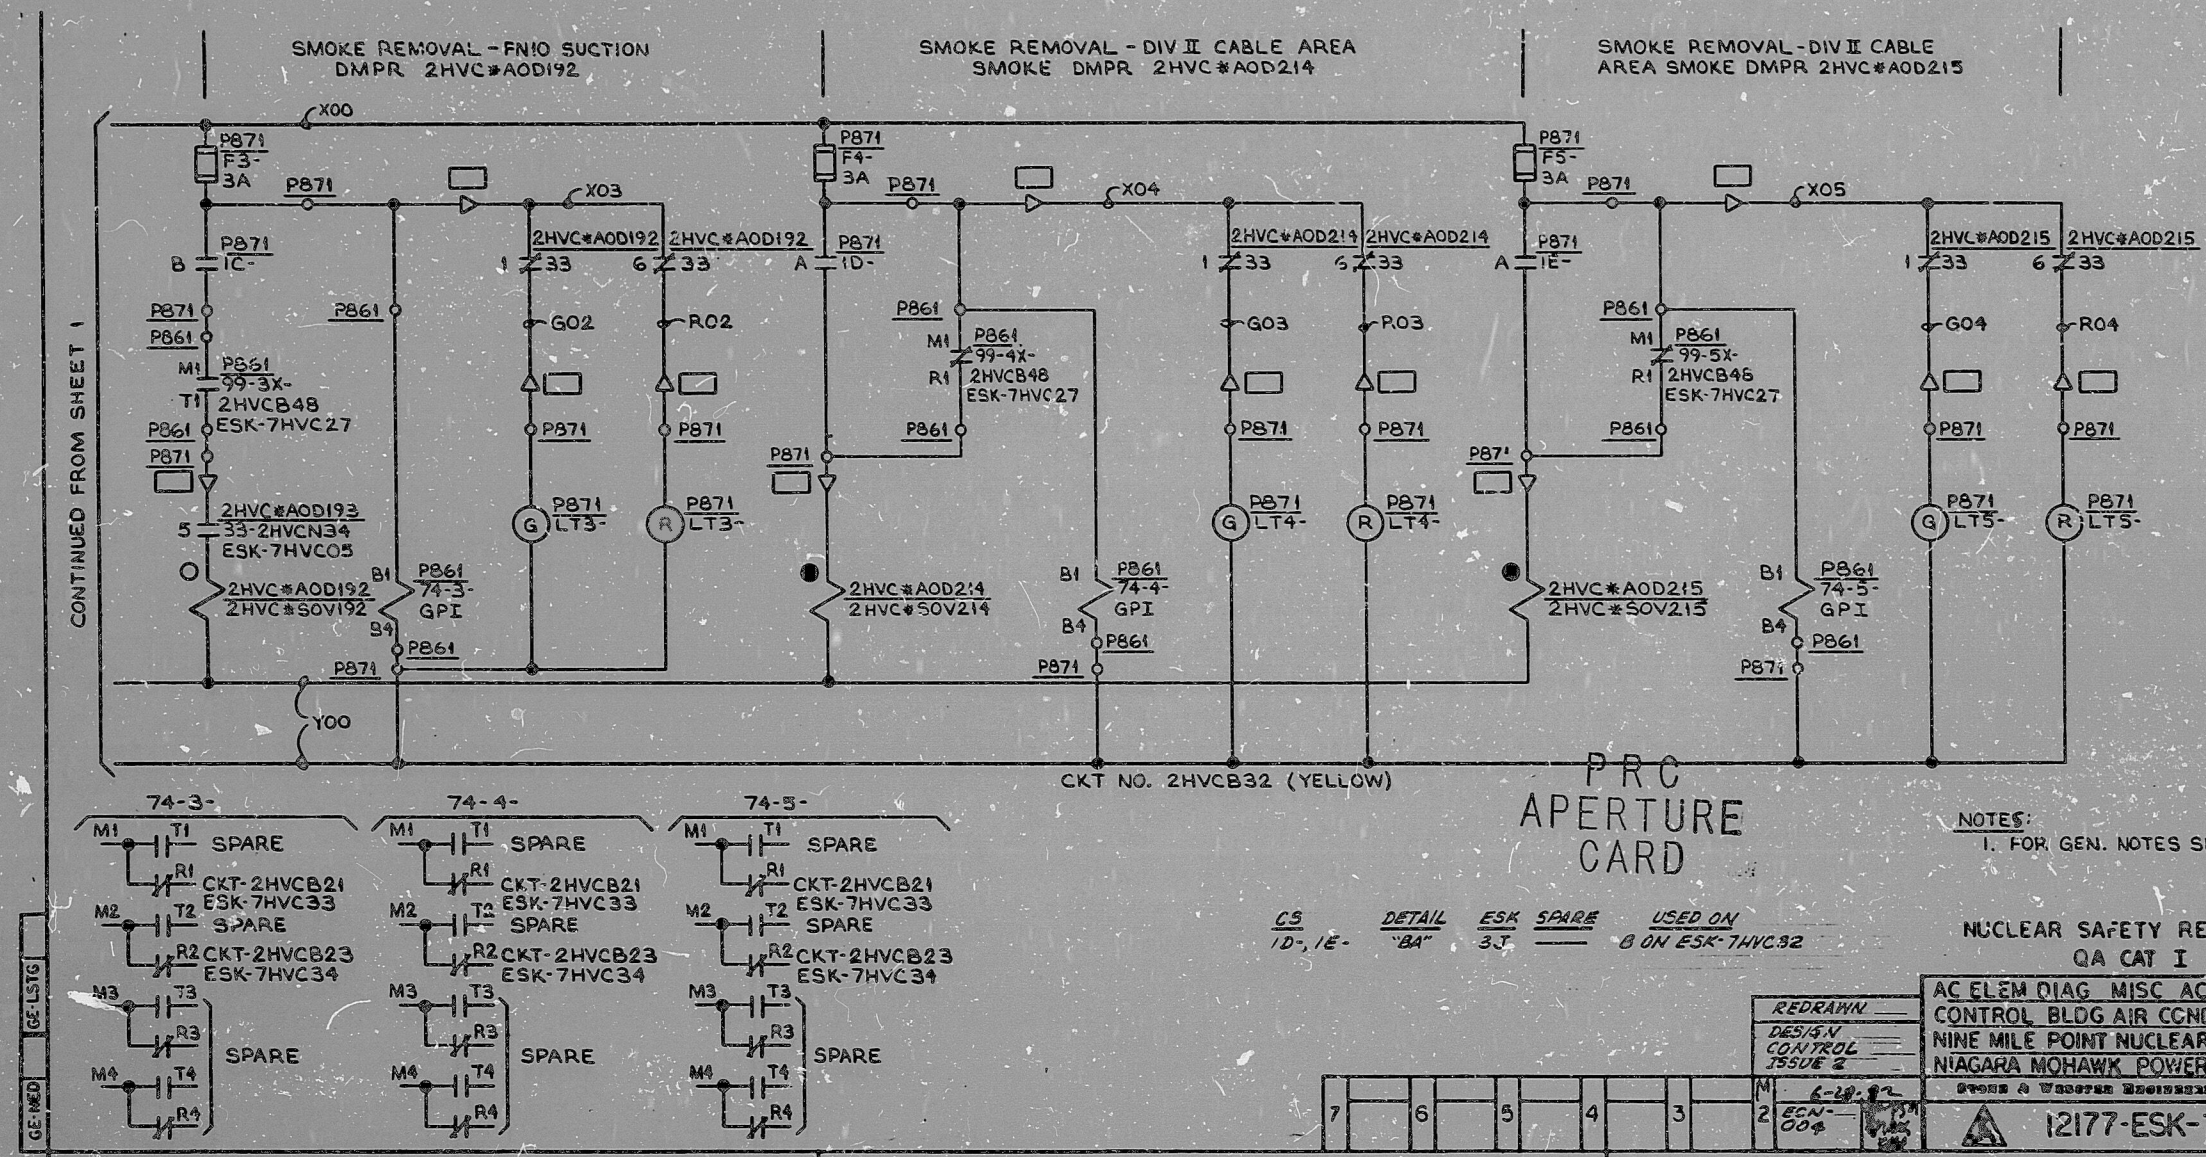

PRC
APERTURE
CARD

NOTES:
1. FOR GEN. NOTES SEE SH NO. 1

CS 1D, 1E- DETAIL "BA" ESK SPARE USED ON 3J 8 ON ESK-7HVC32

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG MISC AC CKTS
CONTROL BLDG AIR CONDITIONING
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

12177-ESK-7HVC20 SH 2 OF 2

7	6	5	4	3	2	1

RIDS

8305120133

