
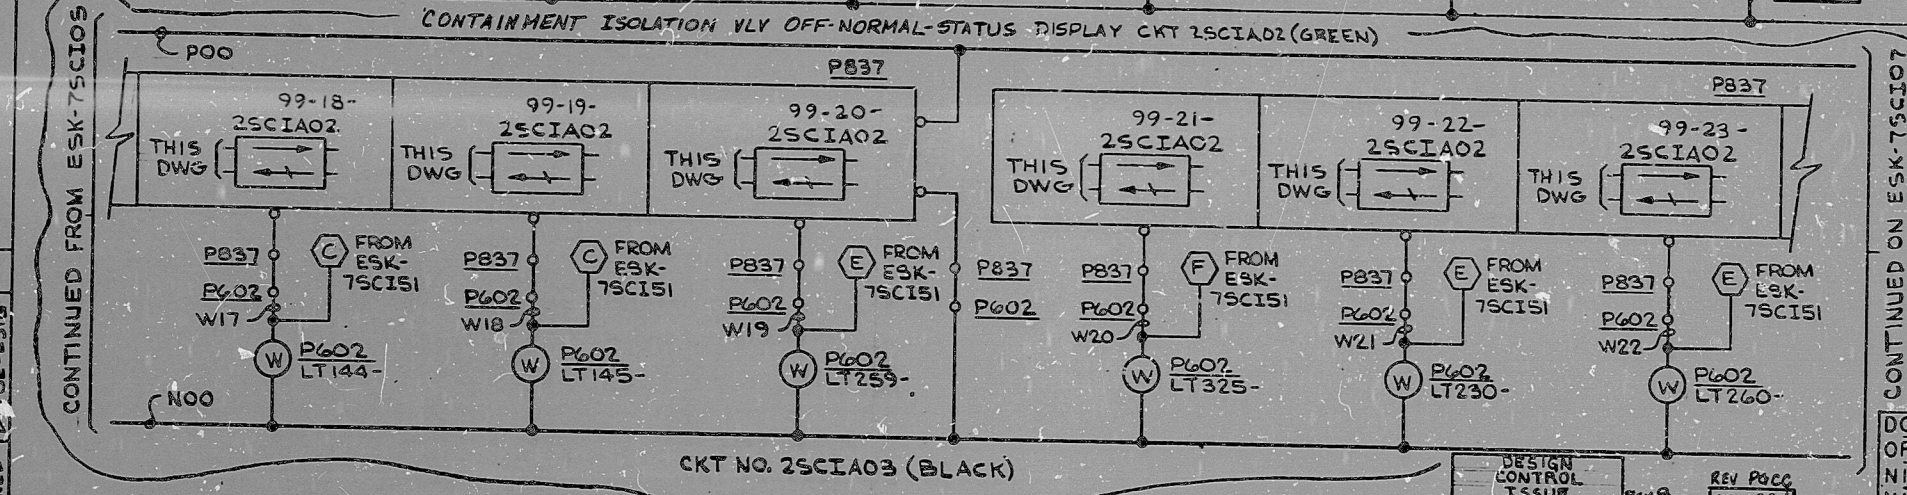


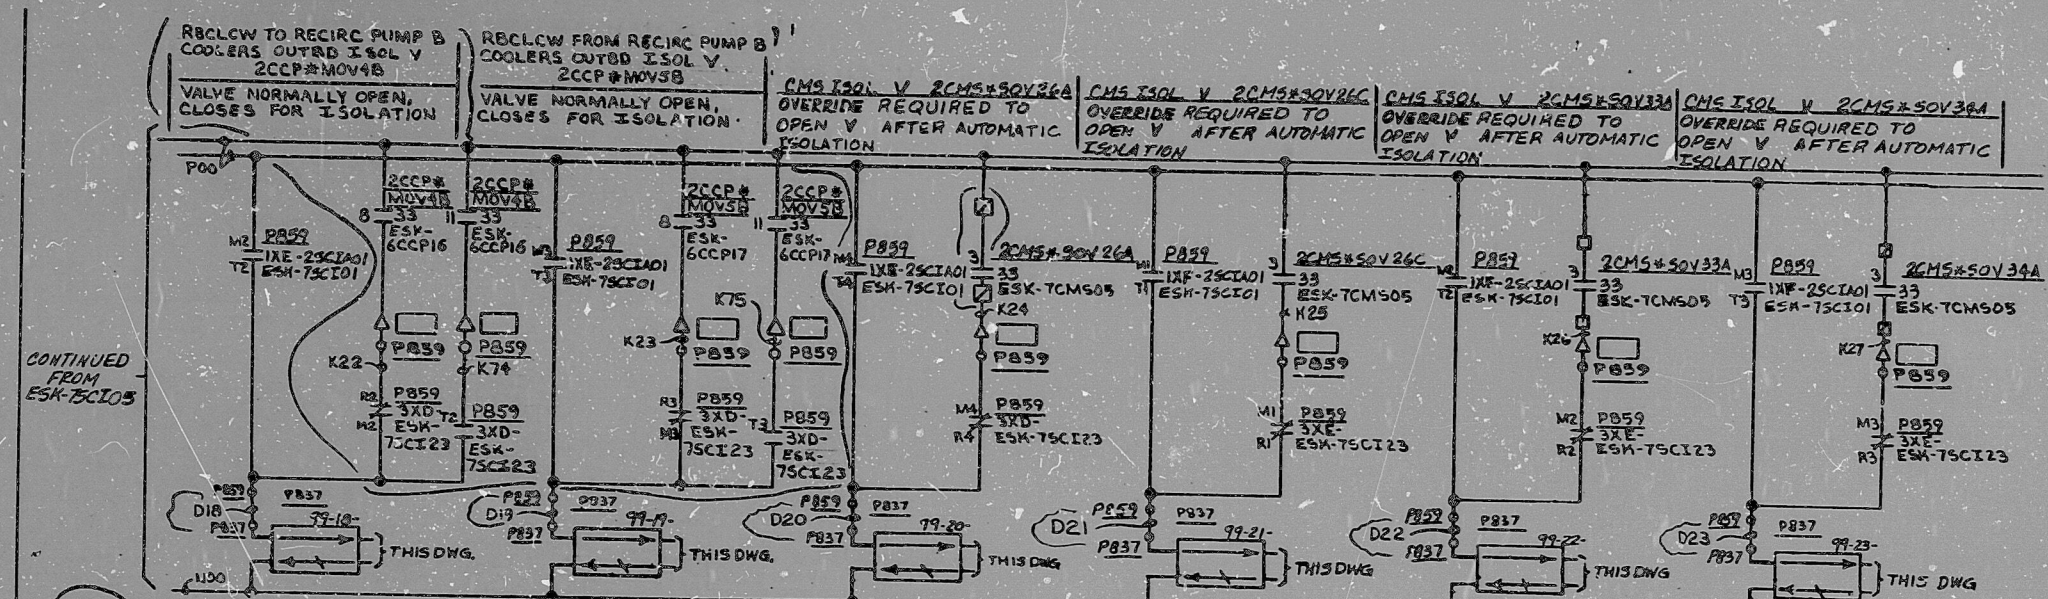

PRC
APERTURE
CARD

- NOTES:
1. ☐ - INDICATES DRYWELL PENETRATION.
 2. ☒ - INDICATES SUPPRESSION CHAMBER PENETRATION.

NUCLEAR SAFETY RELATED
QA CAT I, II

DC ELEM DIAG-MISC DC CIRCUITS
OFF-NORMAL-STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WHARTER ENGINEERING CORPORATION

12177-ESK-75CI06

REV	ISSUE	REV	ISSUE	REV	ISSUE	REV	ISSUE
1	INITIAL	2	REVISED	3	REVISED	4	REVISED
5	REVISED	6	REVISED	7	REVISED	8	REVISED
9	REVISED	10	REVISED	11	REVISED	12	REVISED

RIDS

8305170620

