


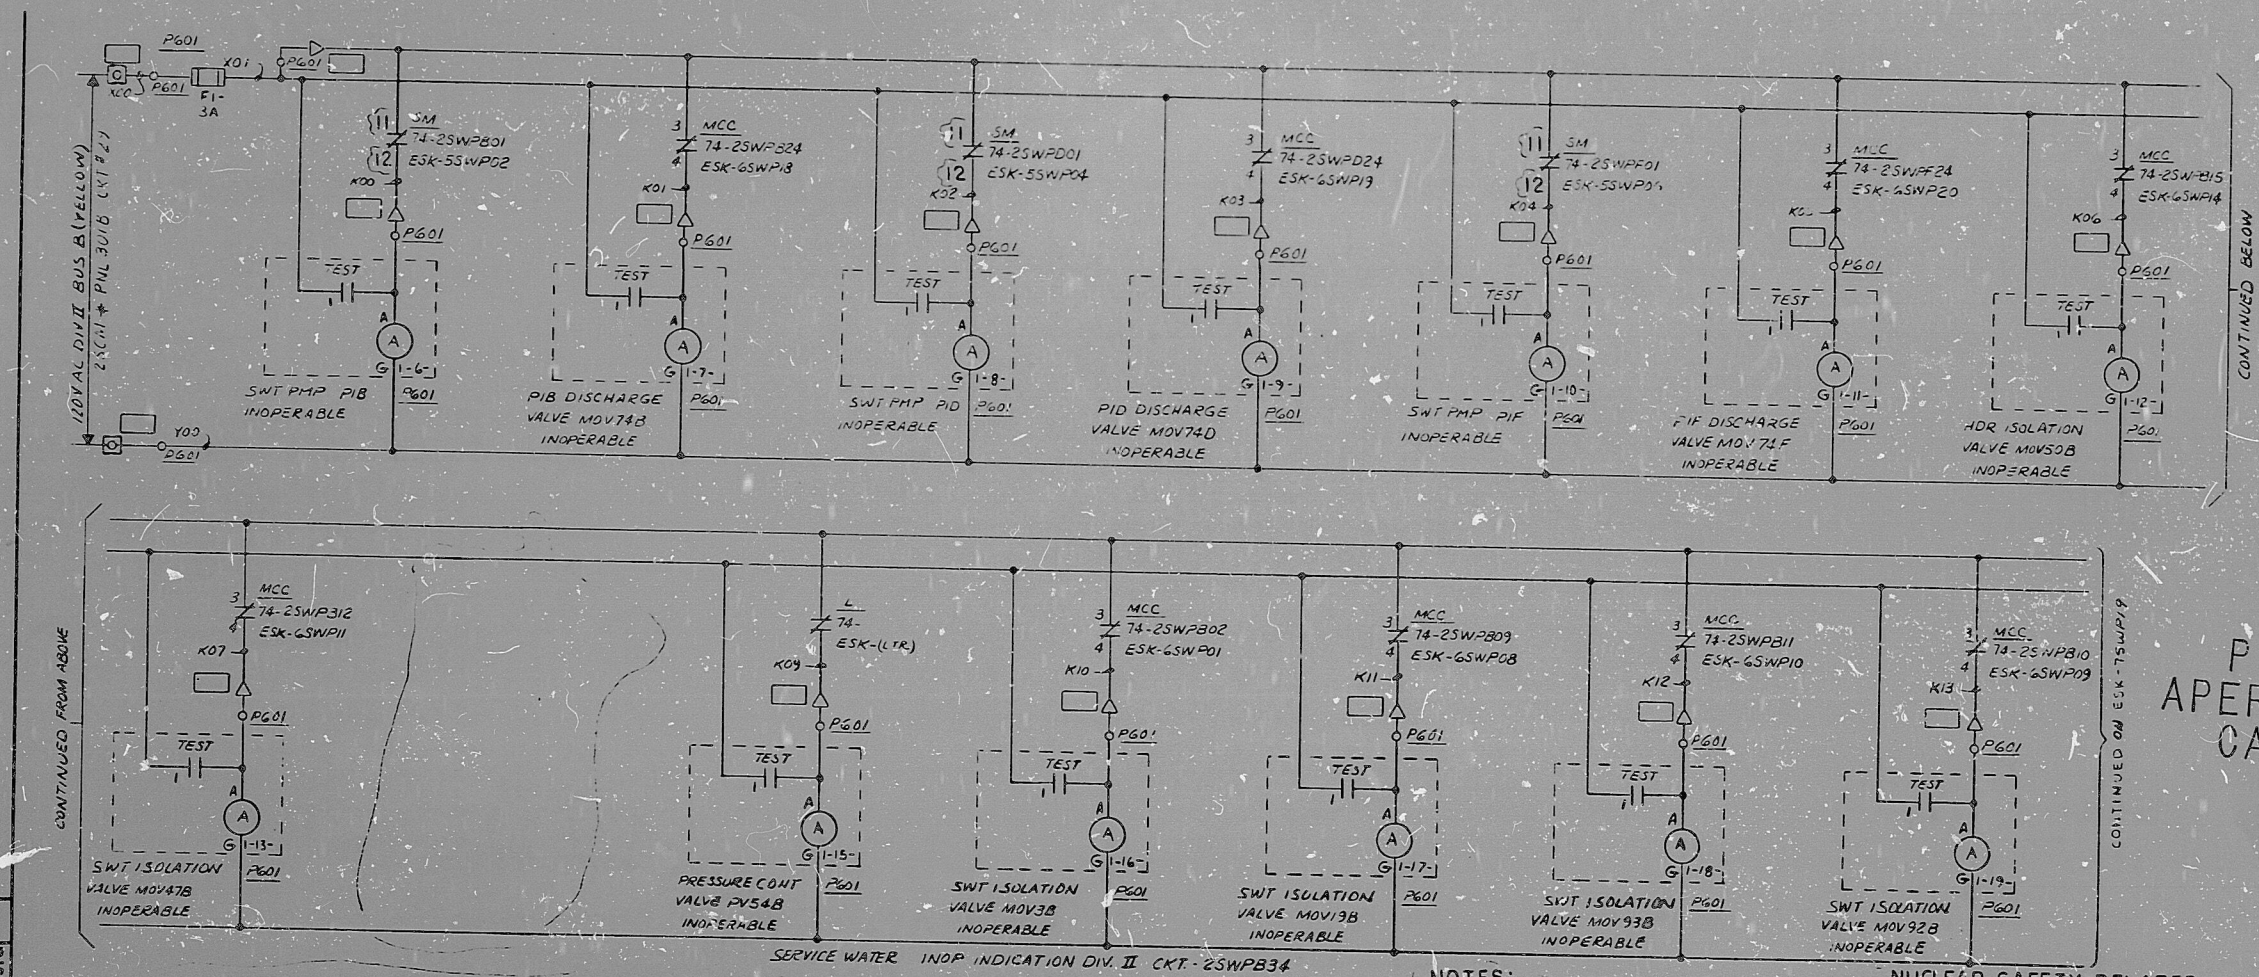

GENED  
1-19-77

| CS           | DETAIL | ESK | SPARES | USED ON |
|--------------|--------|-----|--------|---------|
| 1-6-25WPB34  | MN     | 3E  | 2      |         |
| THROUGH      |        |     |        |         |
| 1-19-25WPB34 |        |     |        |         |

SERVICE WATER INOP INDICATION DIV. II CKT-25WPB34

NOTES:  
1. LOGIC DIAG LSK-9-10

NUCLEAR SAFETY RELATED  
QA CAT I

|   |   |   |   |   |   |          |          |          |
|---|---|---|---|---|---|----------|----------|----------|
| 6 | 5 | 4 | 3 | 2 | 1 | REV      | PGCC     | PGCC     |
|   |   | 4 | 3 | 2 | 1 | 3/4/77   | 6-8-77   | 1-31-77  |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |
|   |   | 4 | 3 | 2 | 1 | REVISION | REVISION | REVISION |

AC ELEM DIAG MSC AC CKT  
SWT INOP INDICATION DIV II  
NINE MILE POINT NUCLEAR STATION UNIT 2  
NIAGARA MOHAWK POWER CORPORATION  
STEVEN A. WATSON ENGINEERING CORPORATION  
12177-ESK-7SWP07

PRO  
APERTURE  
CARD



RIDS

8305170710

