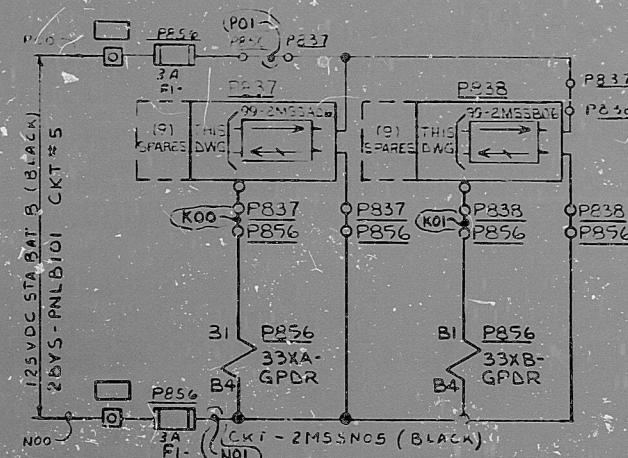
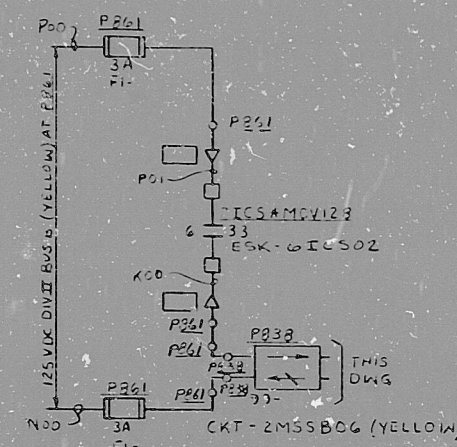
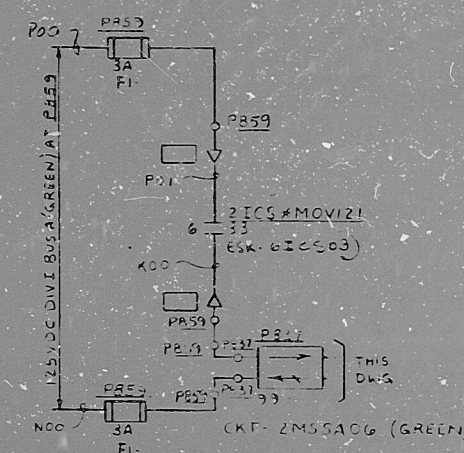


PRC APERTURE CARD

- NOTES:
1. LOGIC DIAGRAM LSK-3-13
2. □ INDICATES DRYWELL PENETRATION.

NUCLEAR SAFETY RELATED
QA CAT I, II

DC ELEM DIAG-MISC DC CKTS
STEAM DRAIN VALVES AUX CONTROL
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

12177-ESK-11MSS05

DESIGN CONTROL ISSUE 3	DESIGN CONTROL ISSUE 2	DESIGN CONTROL ISSUE 1	PGCC
5	4	3	1
ECN-013	ECN-003	ECN-001	ECN-000

RIDS

8305/80/71

