


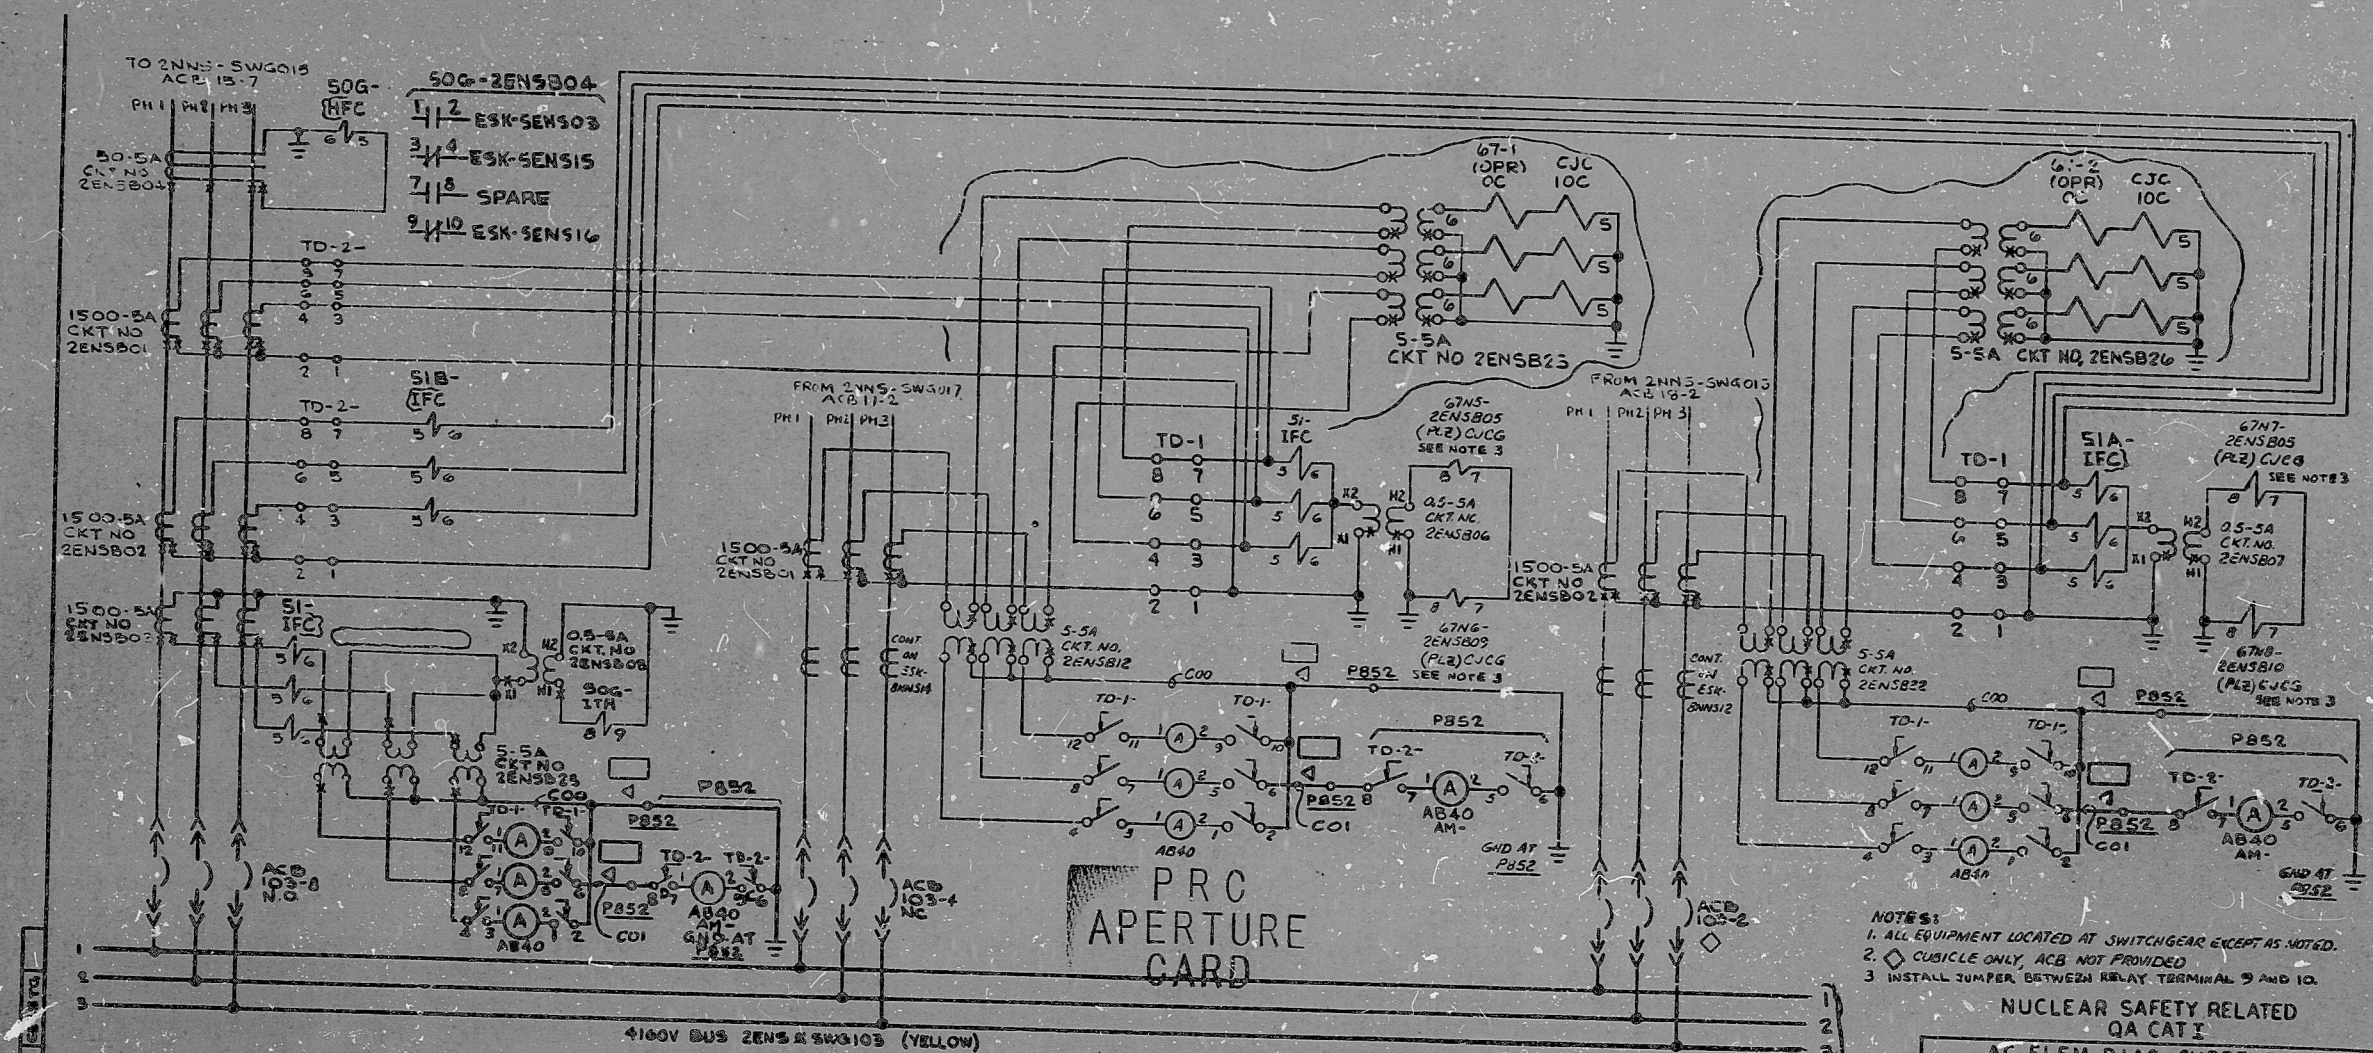

- NOTES:
1. ALL EQUIPMENT LOCATED AT SWITCHGEAR EXCEPT AS NOTED.
 2. CUSICLE ONLY, ACB NOT PROVIDED.
 3. INSTALL JUMPER BETWEEN RELAY TERMINAL 9 AND 10.

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG-CURRENT CKT
4160V EMER SWGR ZENS#SWG103 RLY SMTR
NINE MILE POINT NUCLEAR STATION UNIT-2
NIAGARA MOHAWK POWER CORPORATION
STORE & WESPER ENGINEERING CORPORATION
12177-ESK-8ENS04

DESIGN CONTROL ISSUE	REV	PACC	PACC
1	1/1/77	1/1/77	1/1/77
2	1/1/77	1/1/77	1/1/77
3	1/1/77	1/1/77	1/1/77
4	1/1/77	1/1/77	1/1/77
5	1/1/77	1/1/77	1/1/77
6	1/1/77	1/1/77	1/1/77
7	1/1/77	1/1/77	1/1/77
8	1/1/77	1/1/77	1/1/77
9	1/1/77	1/1/77	1/1/77
10	1/1/77	1/1/77	1/1/77

RK

RIDS

8305180205

