


509932

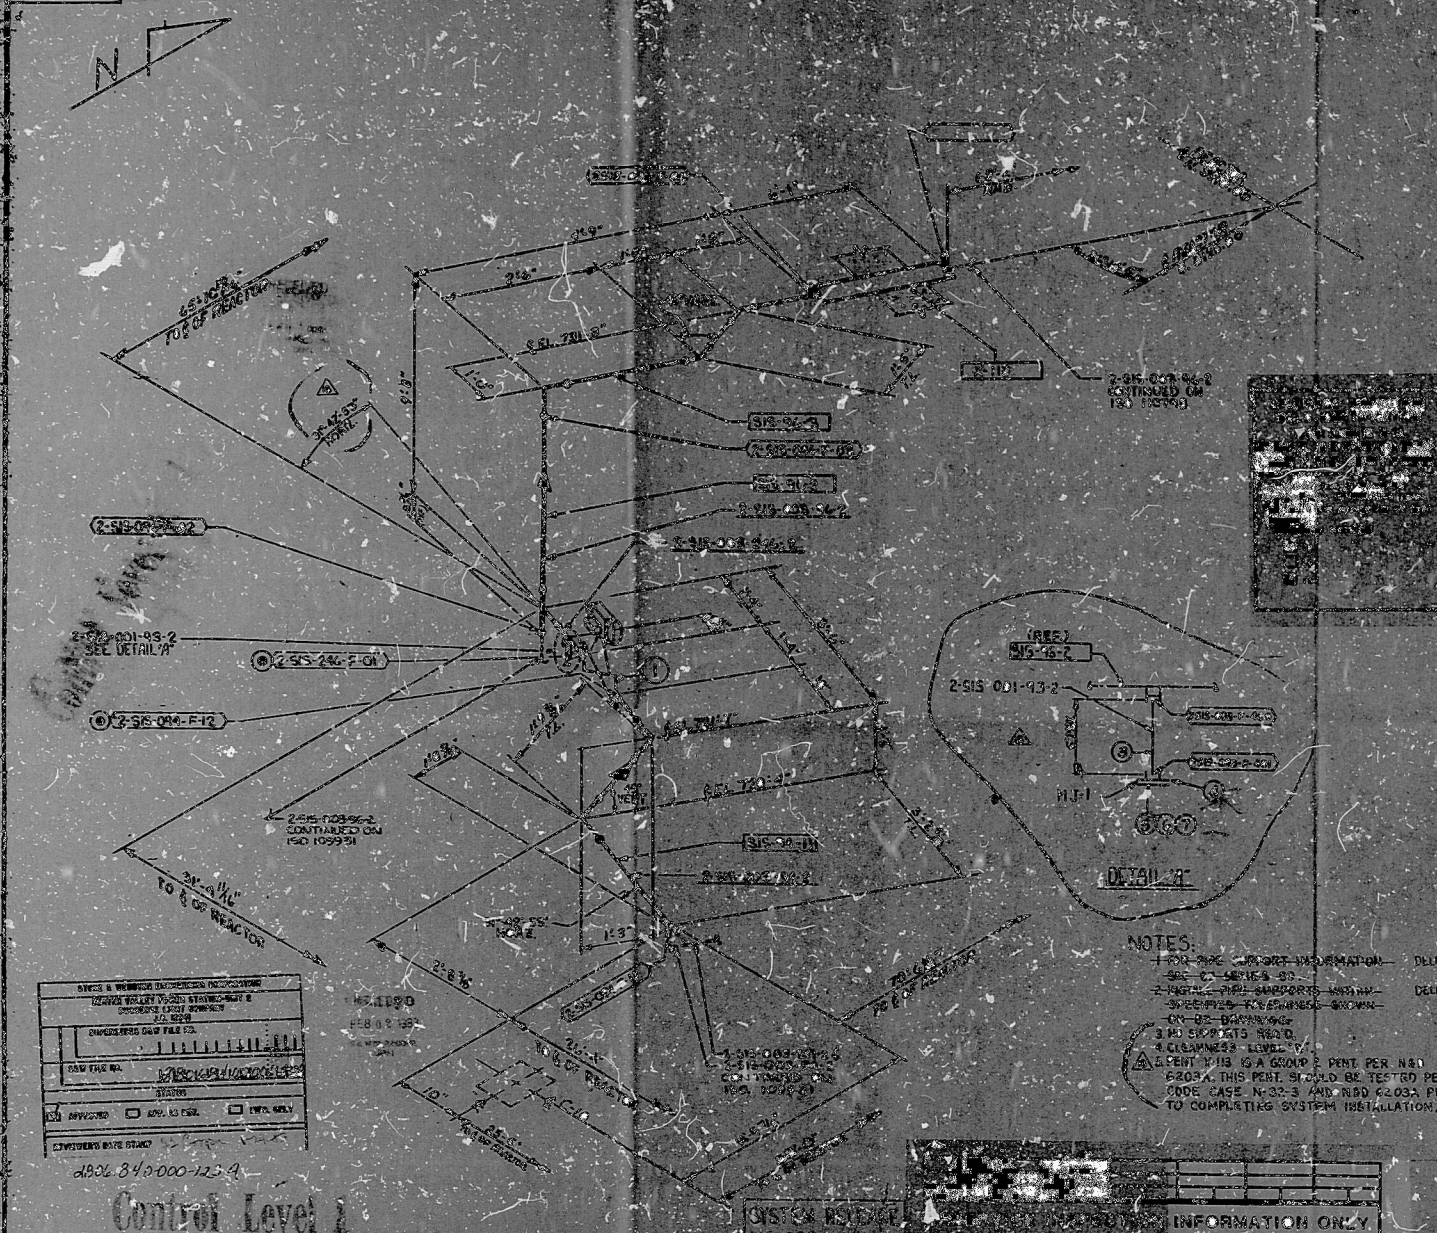

REVISIONS

NO.	DATE	DESCRIPTION
1	10/1/78	ISSUED FOR CONSTRUCTION
2	10/1/78	ISSUED FOR CONSTRUCTION
3	10/1/78	ISSUED FOR CONSTRUCTION

DESIGNED BY: [Signature]
CHECKED BY: [Signature]
DATE: 10/1/78

REFERENCE

NO.	DATE	DESCRIPTION
1	10/1/78	ISSUED FOR CONSTRUCTION
2	10/1/78	ISSUED FOR CONSTRUCTION
3	10/1/78	ISSUED FOR CONSTRUCTION

NOTES:

1. SEE 2-95-001-100 FOR INFORMATION ON THE SIS-001 TANK.
2. SEE 2-95-001-100 FOR INFORMATION ON THE SIS-002 VALVE.
3. SEE 2-95-001-100 FOR INFORMATION ON THE SIS-003 VALVE.
4. SEE 2-95-001-100 FOR INFORMATION ON THE SIS-004 VALVE.
5. SEE 2-95-001-100 FOR INFORMATION ON THE SIS-005 VALVE.

INFORMATION ONLY

MATERIAL CONTROL									
ITEM NO.	DESCRIPTION	QTY	UNIT	REMARKS	DATE	BY	STATUS	APPROVED	REMARKS
1	PIPE, 1/2" DIA. SCH. 40	100	FT.						
2	FLANGE, 1/2" DIA.	10	EA.						
3	VALVE, 1/2" DIA.	5	EA.						
4	PIPE, 1/2" DIA. SCH. 40	100	FT.						
5	FLANGE, 1/2" DIA.	10	EA.						
6	VALVE, 1/2" DIA.	5	EA.						
7	PIPE, 1/2" DIA. SCH. 40	100	FT.						
8	FLANGE, 1/2" DIA.	10	EA.						
9	VALVE, 1/2" DIA.	5	EA.						
10	PIPE, 1/2" DIA. SCH. 40	100	FT.						

MECHANICAL JOINT CONTROL

ITEM NO.	DESCRIPTION	QTY	UNIT	REMARKS
1	PIPE, 1/2" DIA. SCH. 40	100	FT.	
2	FLANGE, 1/2" DIA.	10	EA.	
3	VALVE, 1/2" DIA.	5	EA.	
4	PIPE, 1/2" DIA. SCH. 40	100	FT.	
5	FLANGE, 1/2" DIA.	10	EA.	
6	VALVE, 1/2" DIA.	5	EA.	
7	PIPE, 1/2" DIA. SCH. 40	100	FT.	
8	FLANGE, 1/2" DIA.	10	EA.	
9	VALVE, 1/2" DIA.	5	EA.	
10	PIPE, 1/2" DIA. SCH. 40	100	FT.	

SYSTEM CONTROL

INSTALLATION COMPLETE

FINAL ACCEPTANCE INSPECTION

PRESSURE TEST ACCEPTANCE

DATE: 10/1/78

BY: [Signature]

SAFETY INJECTION SYSTEM (SIS) MAIN STEAM & CABLE VAULT AREA

EL. 718.6

509932-1B

8407260295

PDR RIDS

