


AA NOTE A: FIRE-RATED WALLS SHALL BE 2 HOUR RATED, UNLESS OTHERWISE SPECIFIED.
 AA NOTE B: FIRE-RATED FLOORS SHALL BE 2 HOUR RATED, UNLESS OTHERWISE SPECIFIED.
 AA NOTE C: FIRE-RATED ROOF SHALL BE 2 HOUR RATED, UNLESS OTHERWISE SPECIFIED.

- LEGEND**
- 3 HOUR FIRE WALL
 - 2 HOUR FIRE WALL
 - 1 HOUR FIRE BREAK WALL
 - EXTERIOR WALL FIRE AREA BOUNDARY
 - AA20 FIRE AREA DESIGNATION
 - AA21 FIRE DOOR LABEL RATING
 - HS HOSE STATION
 - HS UNDERHAZARD KNOB
 - FD FIRE DETECTOR
 - FD FIRE EXTRACTOR
 - FD IONIZATION DETECTOR
 - FD THERMAL DETECTOR
 - FD PHOTOGRAPHIC DETECTOR
 - FD FLAME DETECTOR
 - FD SPRINKLER SYSTEM
 - FD DELUGE SYSTEM
 - FD HALON SYSTEM
 - FD CABLE TRAY
 - FD SPRINKLERS
- FOR COMPLETE LEGEND SEE PAGE 1.

CROSS-SECTION E-E

RATING NOTE: FIRE RATING PROVIDED FOR NON-SAFETY-RELATED CONSIDERATIONS NOT REQUIRED FOR SAFE SHUTDOWN.

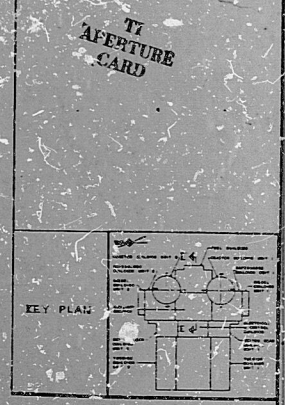

REV	DATE	APPROVED	REMARKS
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			

TXAS UTILITIES GENERATING CO
 FILE NO. 37

5408300339

PDR RIDS

