




FLOOR PLAN ELEV. 796'-0"  
CHLORINATION BUILDING FOR  
CIRCULATING WATER INTAKE STRUCTURE  
SCALE: 1/8" = 1'-0"

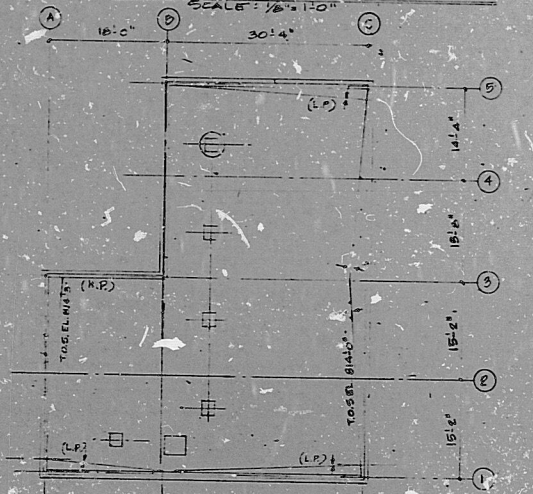

ROOF PLAN OF CHLORINATION BUILDING  
FOR CIRCULATING WATER INTAKE STRUCTURE  
SCALE: 1/8" = 1'-0"

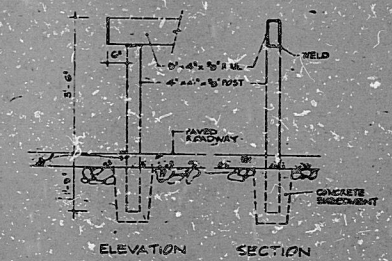

ELEVATION SECTION  
DETAIL  
VEHICLE GUARD RAIL  
SCALE: 1/4" = 1'-0"

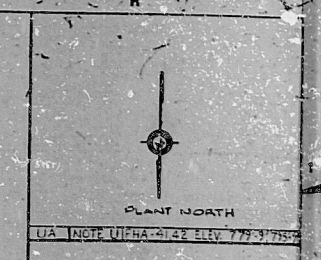

- LEGEND**
- 3 HOUR FIRE WALL
  - 3 HOUR FIRE FLOOR
  - 2 HOUR FIRE WALL
  - 1 HOUR FIRE BREAK WALL
  - EXTERIOR WALL FIRE SHIELD BOUNDARY
  - FIRE AREA DESIGNATION
  - FIRE DOOR LABEL RATING
  - HOSE STATION
  - IONIZATION FIRE DETECTOR
  - PSE EXTINGUISHER
  - IONIZATION DETECTOR
  - THERMAL DETECTOR
  - THERMAL STRIP DETECTOR
  - FLAME DETECTOR
  - SPRINKLER SYSTEM
  - DELUGE SYSTEM
  - HALON SYSTEM
  - CABLE TRAY
  - SPRINKLERS
- NOTES FOR COMPLETE LEGEND SEE CHIC FMA-11

**GENERAL NOTES:**

1. ALL LEGEND SYMBOLS, DIMENSIONS, SPECIFICATIONS TO BE OBSERVED. SEE CHIC FMA-11 FOR DETAILS.
2. ALL EQUIPMENT LOCATION DIMENSIONS SHOWN ON THIS DRAWING SHALL NOT BE USED FOR INSTALLATION.

NO.	DATE	REVISION
1	11/15/55	ISSUED FOR PERMIT
2	11/15/55	REVISED TO SHOW CHANGES
3	11/15/55	REVISED TO SHOW CHANGES
4	11/15/55	REVISED TO SHOW CHANGES
5	11/15/55	REVISED TO SHOW CHANGES
6	11/15/55	REVISED TO SHOW CHANGES
7	11/15/55	REVISED TO SHOW CHANGES
8	11/15/55	REVISED TO SHOW CHANGES
9	11/15/55	REVISED TO SHOW CHANGES
10	11/15/55	REVISED TO SHOW CHANGES

CHICAGO FIRE DEPARTMENT  
FIRE HAZARD ANALYSIS  
PROGRAM APPLICABLE TO ALL CHICAGO FIRE DEPARTMENT FACILITIES  
FIRE HAZARD ANALYSIS  
CIRCULATING WATER INTAKE  
STRUCTURE PLAN ELEV. 795'-9"

TEXAS UTILITIES  
GENERATING CO.  
FIRE HAZARD ANALYSIS  
CIRCULATING WATER INTAKE  
STRUCTURE PLAN ELEV. 795'-9"

SCALE: 1/8" = 1'-0"

8408300415

PDR RIDS

