
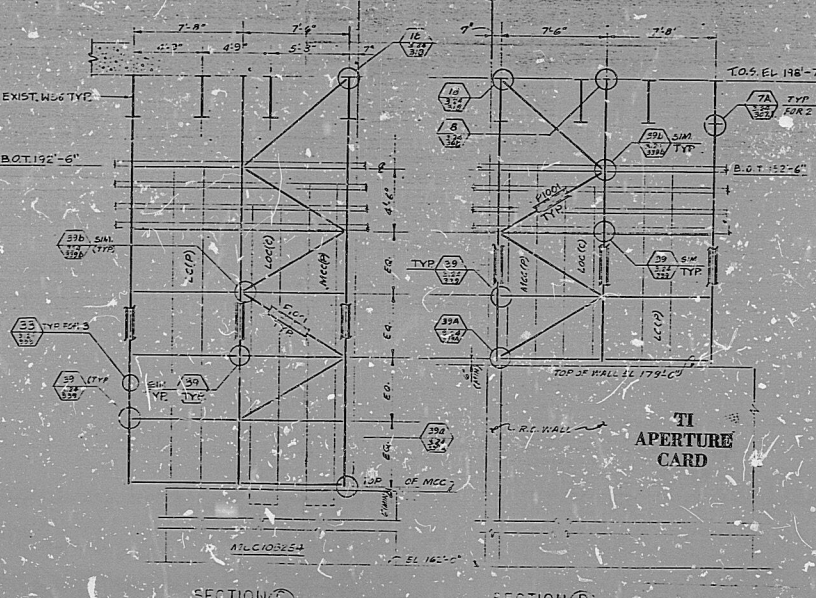


KEY PLAN

28	29	30	31	32	33	34
35	36	37	38	39	40	41
42	43	44	45	46	47	48
49	50	51	52	53	54	55
56	57	58	59	60	61	62
63	64	65	66	67	68	69
70	71	72	73	74	75	76
77	78	79	80	81	82	83
84	85	86	87	88	89	90
91	92	93	94	95	96	97
98	99	100	101	102	103	104

- NOTES:
- ALL CABLE TRAYS ARE 24" UNLESS SHOWN OTHERWISE.
 - CLASS I & RACEWAY-TRAY & CONDUIT, ETC. ARE IDENTIFIED FOR "Q" LISTED INSTALLATION BY LETTERS A, B, C, D, W, X, Y OR Z IN THE TRAY CHARACTER OF THE RACEWAY NUMBER.
 - ALL FIRE DETECTORS ARE MOUNTED ON THE CEILING.
 - FOR INSTALLATION DETAIL OF NON-STANDARD ELBOWS FOR CABLE TRAYS, SEE DWG. E-1406-0, SH. 2 & 3.

- REFERENCE DRAWINGS
- P-1905-1 - PIPING
 - C-0813-1 - CIVIL STRUCTURAL
 - C-0647-1 -
 - P-9155-1 - HEATING & VENTILATING
 - P-8155-1 - PLUMBING
 - E-1406-0 - RACEWAY NOTES, SYMBOLS & DETAILS
 - C-0813-1 - STRUCTURAL STEEL FLOOR FRAMING PLAN
 - J-1905-1 - INSTRUMENT LOCATION
 - P-0046-1 - EQUIP. LOCATION

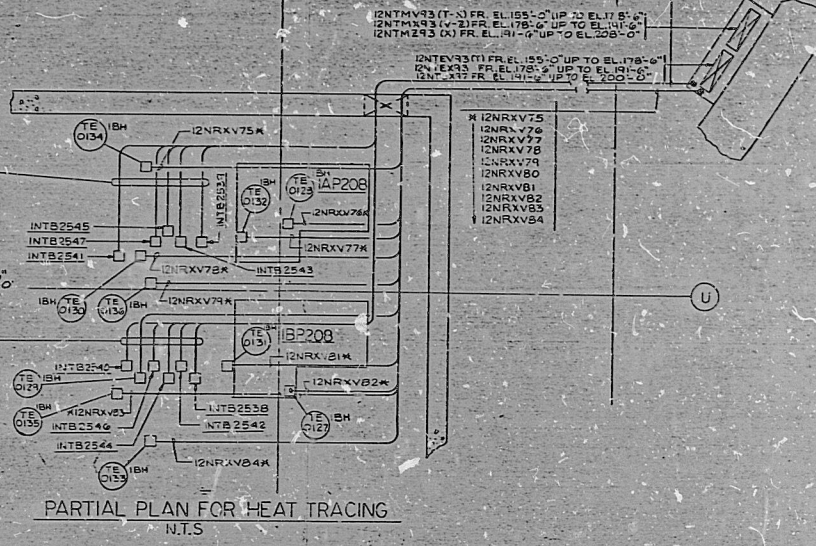

REVISIONS

NO.	DESCRIPTION	DATE	BY	CHKD.
1	ISSUED FOR CONSTRUCTION	11/15/54
2
3
4
5
6
7
8
9
10

BECHTEL
SAN FRANCISCO

PUBLIC SERVICE ELECTRIC AND GAS COMPANY
HOPE CREEK GENERATING STATION

RACEWAY PLAN
REACTOR BLDG. AREA 19
PLAN AT EL. 162'-0"

JOB NO. 1082.5 DRAWING NO. E-15-0-1 REV. 3

This drawing and the data herein are the property of the Public Service Electric and Gas Company and are not to be used, copied, or reproduced in any manner without the written consent of the Company.

32
41
41
58
85"
11"
17"
22"

8409040394

PDR RIDS

