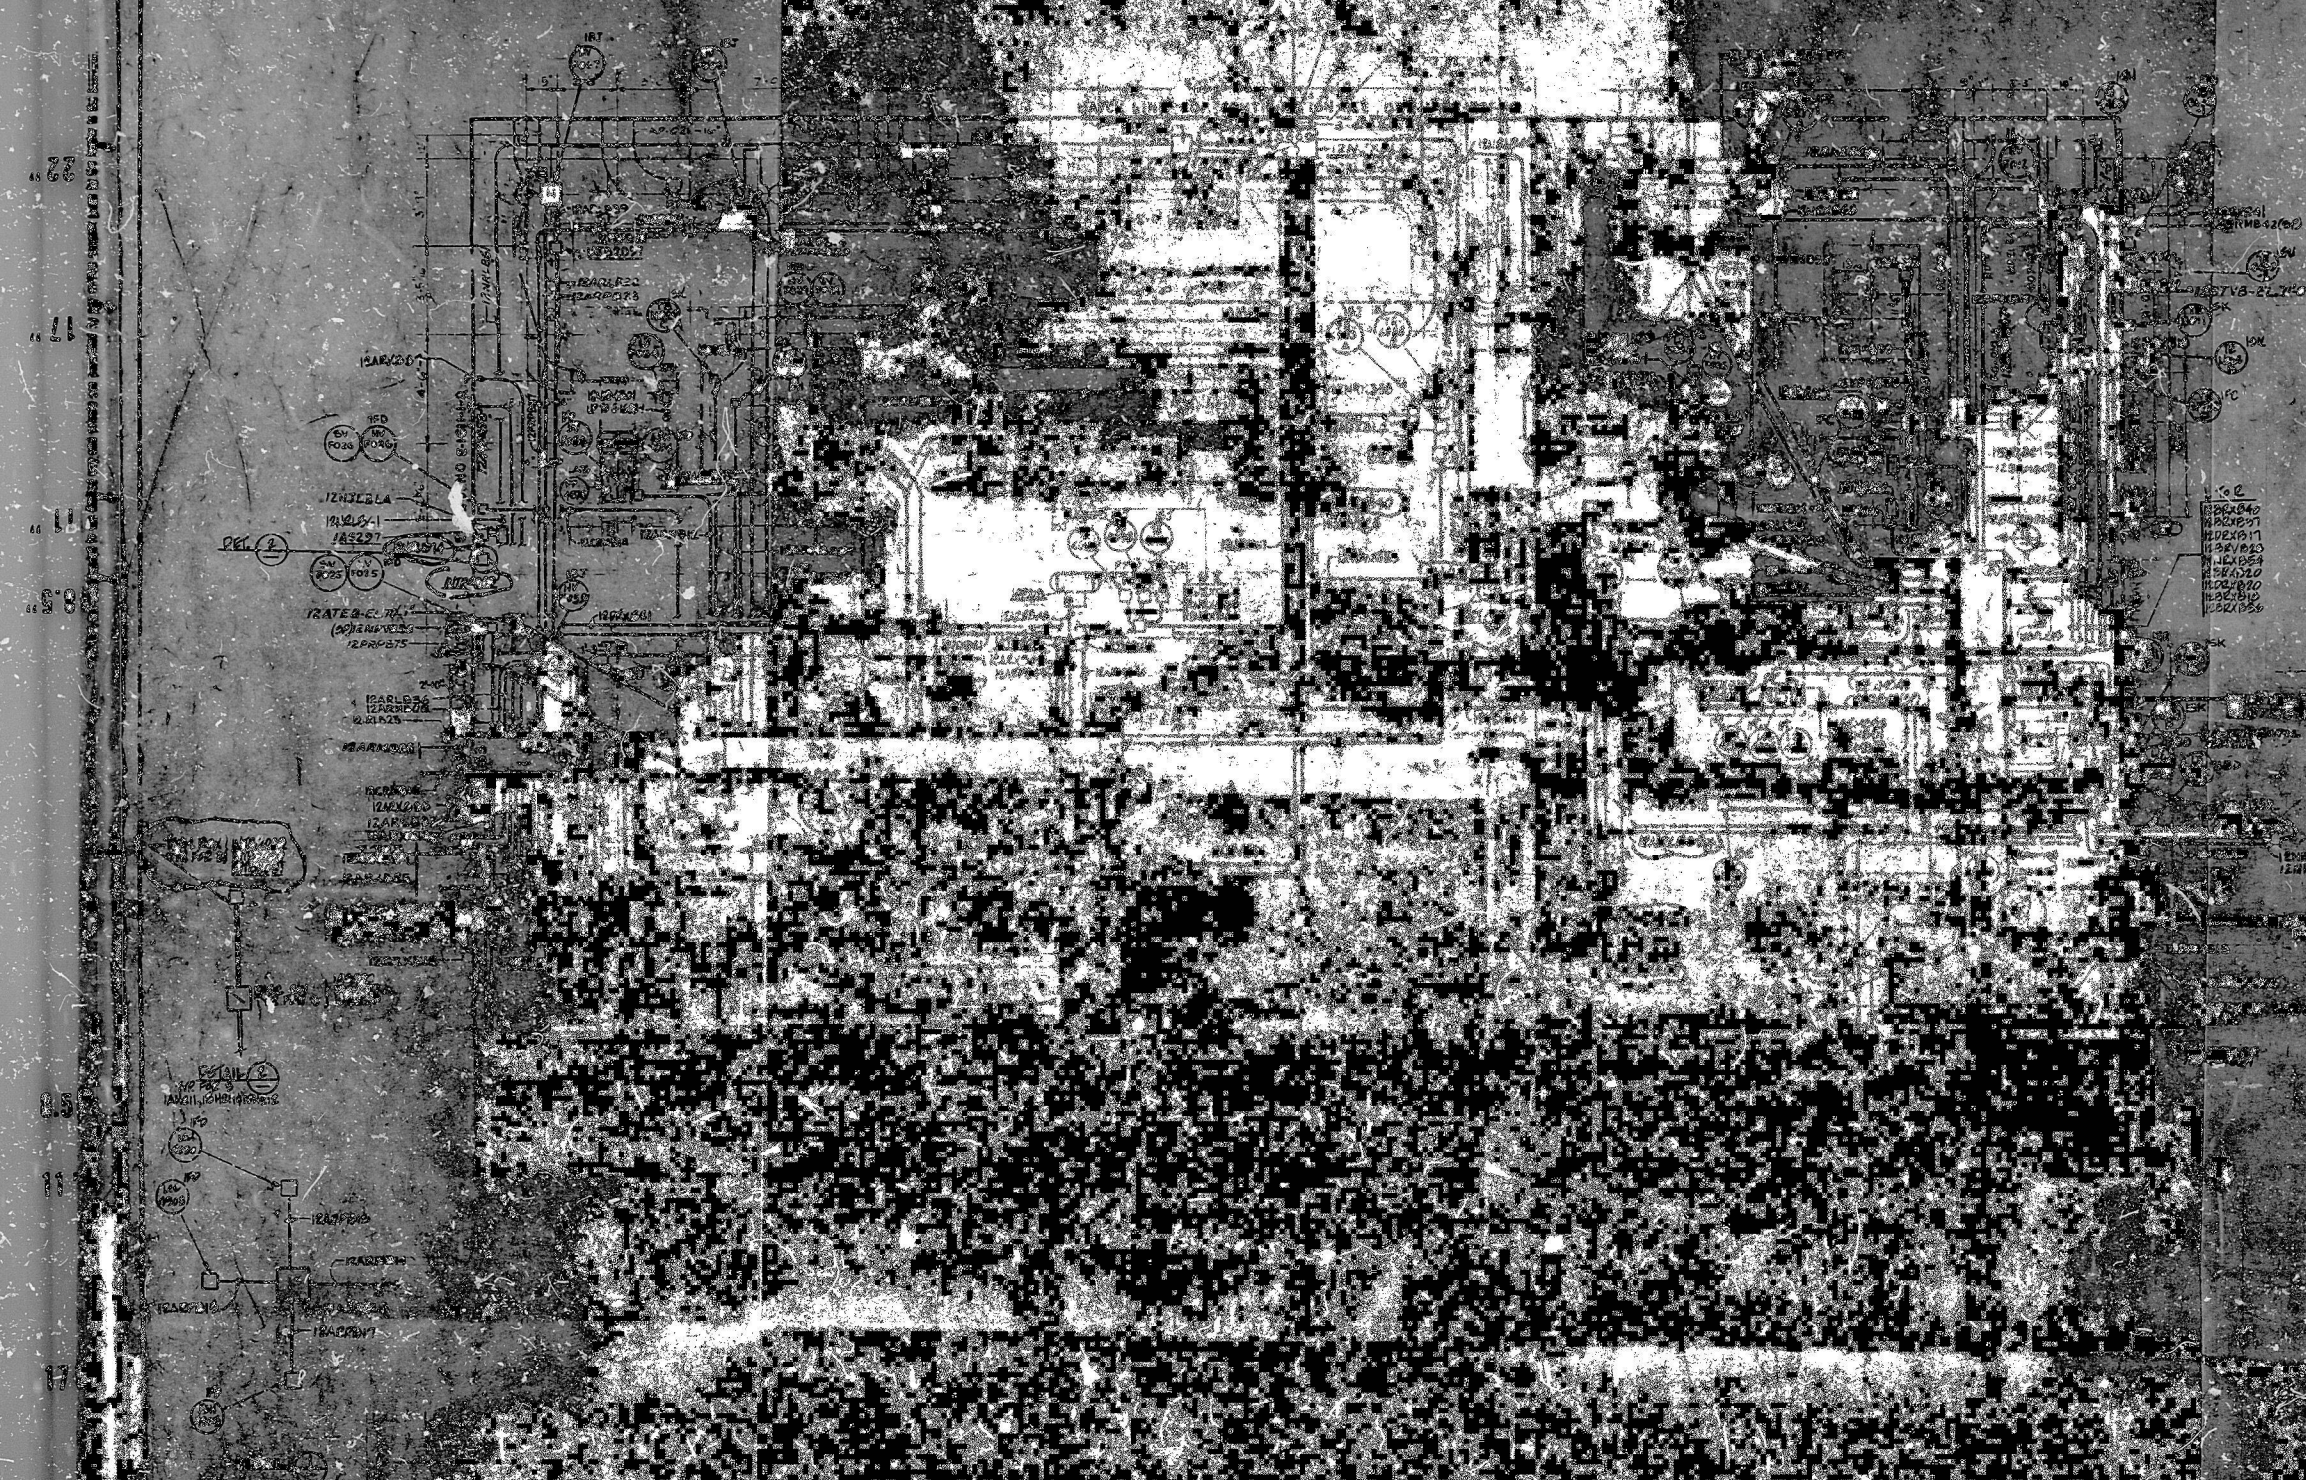


- NOTES:**
1. ALL CABLE TRAYS ARE 24" UNLESS SHOWN OTHERWISE.
 2. FOR LOCATION OF JUNCTION BOXES, SEE ENLARGED CONDUIT DRAWINGS.
 3. CLASS 15 RACEWAY TRAY & CONDUIT ETC. ARE IDENTIFIED FOR "Q" LISTED INSTALLATION BY LETTERS A, B, C, D, W, X, Y OR Z, IN THE THIRD CHARACTER OF THE RACEWAY NUMBER.
 4. ALL FIRE DETECTORS ARE MOUNTED ON THE CEILING.

- REFERENCE DRAWINGS**
- P-2501-1 PIPING
 - C-0511-1 CIVIL-STRUCTURAL
 - P-9231-1 HEATING & VENTILATING
 - P-8231-1 PLUMBING
 - E-1406-0 RACEWAY NOTES, SYMBOLS & DETAILS
 - C-0801-1 STRUCTURAL STEEL FLOOR FRAMING PLAN
 - J-2301-1 INSTRUMENT LOCATION

NO.	DESCRIPTION	DATE	BY	CHKD.
1	REVISION			
2	REVISION			
3	REVISION			
4	REVISION			
5	REVISION			
6	REVISION			
7	REVISION			
8	REVISION			
9	REVISION			
10	REVISION			
11	REVISION			
12	REVISION			
13	REVISION			
14	REVISION			
15	REVISION			
16	REVISION			
17	REVISION			
18	REVISION			
19	REVISION			
20	REVISION			

A FAC

PDR RIDS

8409050016

