


POS	LIMIT SWITCH CONTACT DEVELOPMENT				FUNCTION	
	VALVE POSITION	A	B	FULLY CLOSED		
1					BYPASS	
2					SPARE	
3					GREEN LT	THIS DWG
4					OPEN LIMIT	
5					BYPASS	
6					SPARE	
7					SPARE	
8					SPARE	
9					SPARE	
10					SPARE	
11					SIGNAL FUSE	E-11GH SH-4
12					SPARE	
13					SPARE	
14					SPARE	
15					RED LT	THIS DWG
16					SPARE	

- NOTES:
1. ALL EQUIPMENT LOCATED AT RESPECTIVE MCC EXCEPT AS NOTED
  2. APPLICABLE LOGIC DIAGRAM - LSK-26-4D
  3. CIRCUIT NO. TO PRECEDE WIRE NO.
  4. TORQUE SWITCHES TOS-O & TOS-C STOP MOTOR IF MECHANICAL OVERLOAD OCCURS DURING OPENING OR CLOSING CYCLE.
  5. FOR LOCATION REFERENCE SEE E-2B

**NUCLEAR SAFETY RELATED**

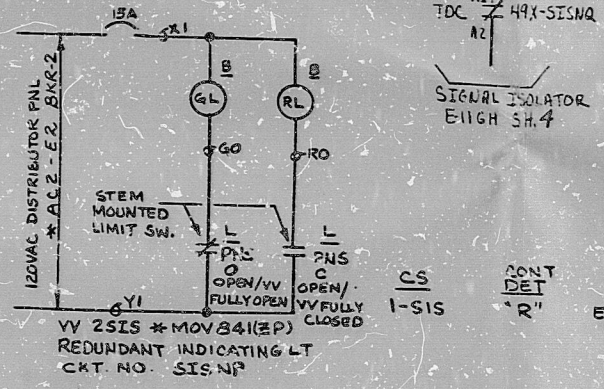

ELEMENTARY DIAGRAM - HOT LEGS  
 SAFETY INJECTION ISOLATION VALVE  
 BEAVER VALLEY POWER STATION-UNIT 2  
 DUQUESNE LIGHT COMPANY  
 STORF & WENSTER ENGINEERING CORPORATION  
 12241-E-6QM

7	6	5	4	3	2	1
---	---	---	---	---	---	---

8409210304 TI APERTURE CARD

PDR RIDS

(304)  
8409210304

