


This drawing and its design is given in full property of the Utility which is participating in the SNUPPS Project. It is loaned on the borrower's express agreement that it will not be reproduced, copied, loaned, exhibited, or used in any way in the United States or elsewhere without the express written consent of the Utility.

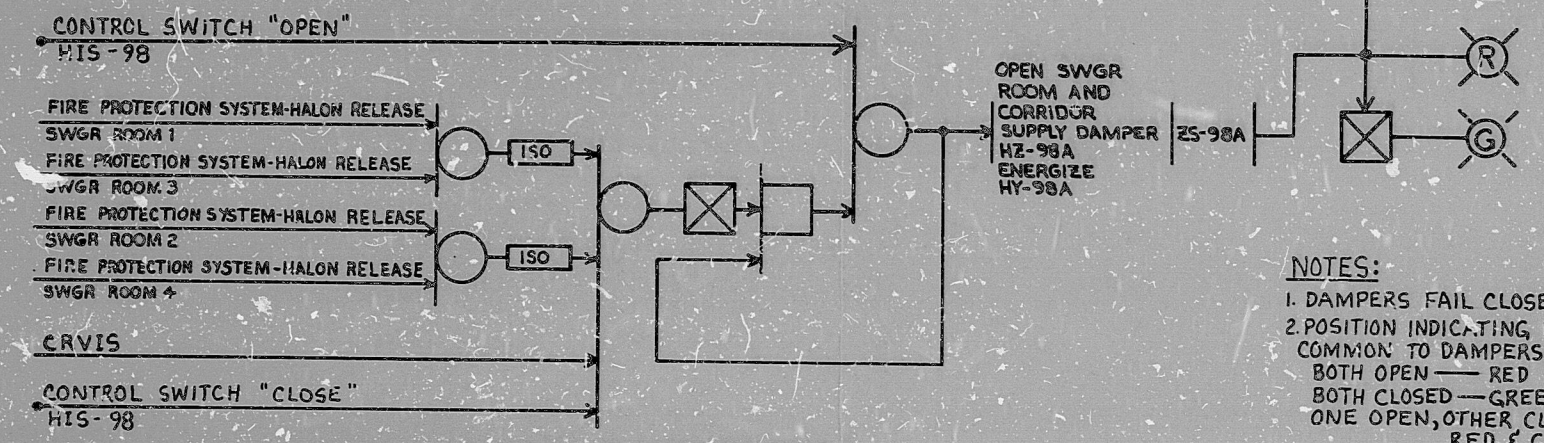

NOTES:
1. DAMPERS FAIL CLOSED.
2. POSITION INDICATING LIGHTS ARE COMMON TO DAMPERS A & B.
BOTH OPEN — RED
BOTH CLOSED — GREEN
ONE OPEN, OTHER CLOSED — RED & GREEN

OPEN
G R
CLOSE
CONTROL SWITCH
HIS-98
CUTLER-HAMMER E-30
MOMENTARY CONTACT

DAMPER	SERVICE	CONTROL SWITCH	LOCATION	SEPARATION GROUP	SOLENOID VALVE	LIMIT SWITCH	COMPUTER POINT
HZ-98A	SWGR. ROOM & CORRIDOR SUP.	HIS-98	068	4	HY-98A	ZS-98A	Z-98A
HZ-98B	" " " RET.				HY-98B	ZS-98B	Z-98B

TI
APERTURE
CARD

REFERENCES
M-02GK03

REVISIONS				BECHTEL GAITHERSBURG, MARYLAND SNUPPS JOB NO. 10466				CONTROL LOGIC DIAGRAM CONTROL BUILDING HVAC DAMPERS		UTILITY DWG. NO.	REV.
NO.	DATE	REVISIONS	BY	CHK	DES	ENG	APP	APP		BECHTEL DWG. NO.	REV.
1	5-1-90	ISSUED FOR CONSTRUCTION	TJL							J-02GK25 (Q)	0
DESIGNED				DRAWN TJL				DATE 10-6-79			
								REVIEW LEVEL 2			

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to micrographics.
DATE 5-1-90 OPERATOR *Barbara M. Hogue* SUPERVISOR *John M. Hogue*



PDR RIDS

8410030142

