


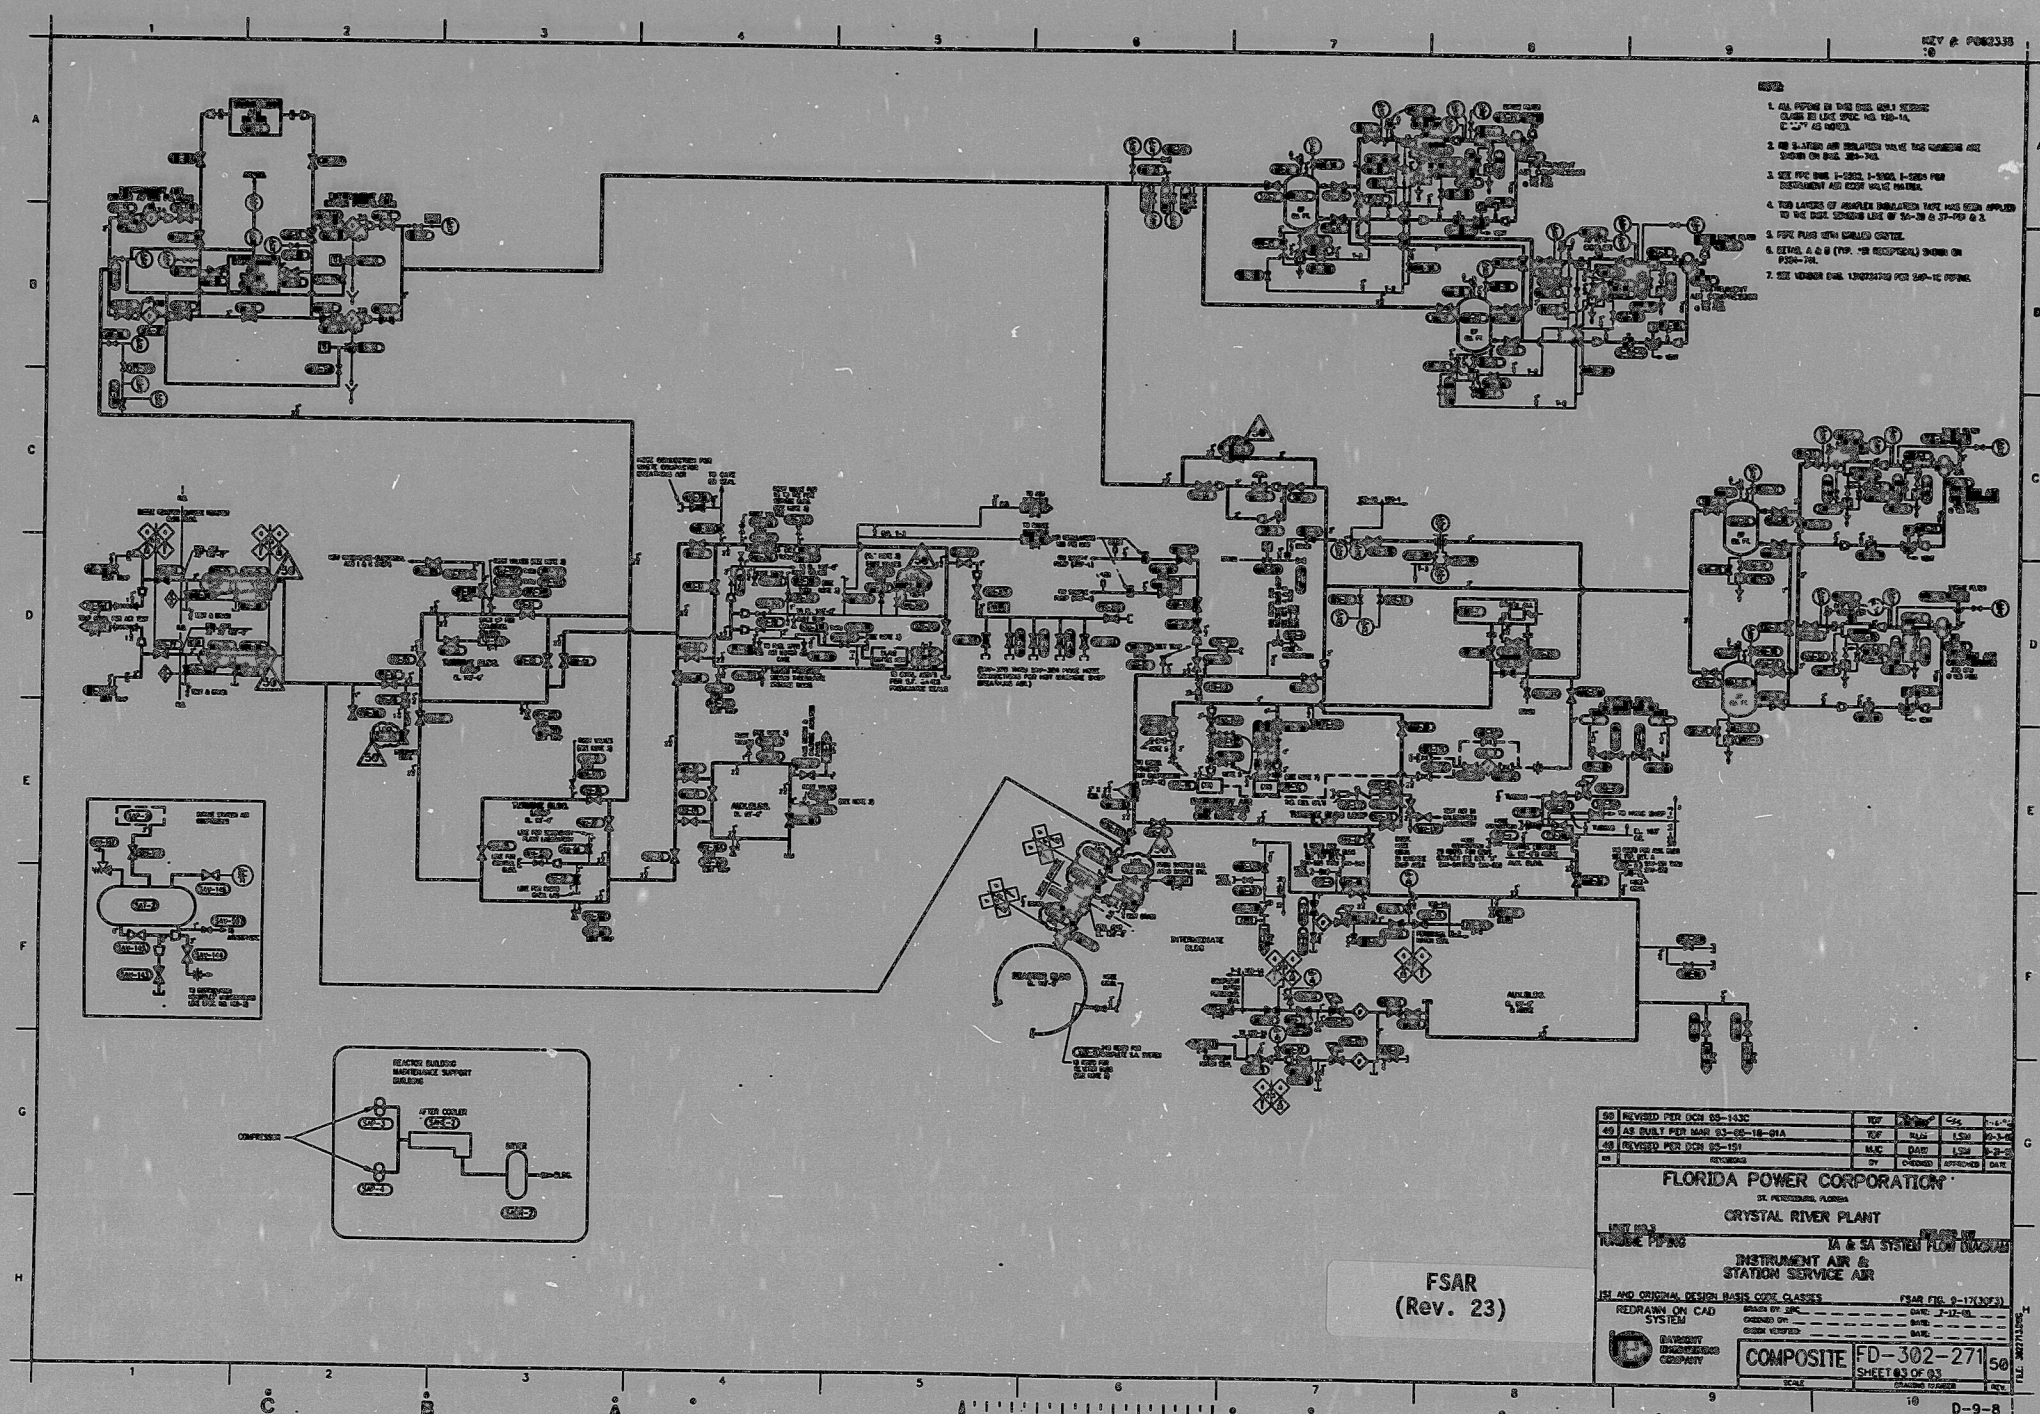

- NOTES
1. ALL WORK ON THIS DRAWING SHOULD BE DONE IN ACCORDANCE WITH THE REVISIONS LISTED ON THIS DRAWING.
 2. SEE FIG. 9-12 FOR THE REVISIONS LISTED ON THIS DRAWING.
 3. SEE FIG. 9-12 FOR THE REVISIONS LISTED ON THIS DRAWING.
 4. THE LAYOUT OF THIS DRAWING IS IN ACCORDANCE WITH THE REVISIONS LISTED ON THIS DRAWING.
 5. SEE FIG. 9-12 FOR THE REVISIONS LISTED ON THIS DRAWING.
 6. SEE FIG. 9-12 FOR THE REVISIONS LISTED ON THIS DRAWING.
 7. SEE FIG. 9-12 FOR THE REVISIONS LISTED ON THIS DRAWING.

FSAR
(Rev. 23)

REVISIONS		REV.	DATE	BY	CHKD.
1	REVISED PER UCM 88-1432	1	10-1-88	WJ	WJ
2	REVISED PER UCM 88-1432	2	10-1-88	WJ	WJ
3	REVISED PER UCM 88-1432	3	10-1-88	WJ	WJ
4	REVISED PER UCM 88-1432	4	10-1-88	WJ	WJ
5	REVISED PER UCM 88-1432	5	10-1-88	WJ	WJ
6	REVISED PER UCM 88-1432	6	10-1-88	WJ	WJ
7	REVISED PER UCM 88-1432	7	10-1-88	WJ	WJ
8	REVISED PER UCM 88-1432	8	10-1-88	WJ	WJ
9	REVISED PER UCM 88-1432	9	10-1-88	WJ	WJ
10	REVISED PER UCM 88-1432	10	10-1-88	WJ	WJ

FLORIDA POWER CORPORATION
ST. PETERSBURG, FLORIDA
CRYSTAL RIVER PLANT
INSTRUMENT AIR & STATION SERVICE AIR
COMPOSITE
FD-302-271
SHEET 1 OF 1

ANSTEC
APERTURE
CARD

9611290324

PDR RIDS

9611290324

