


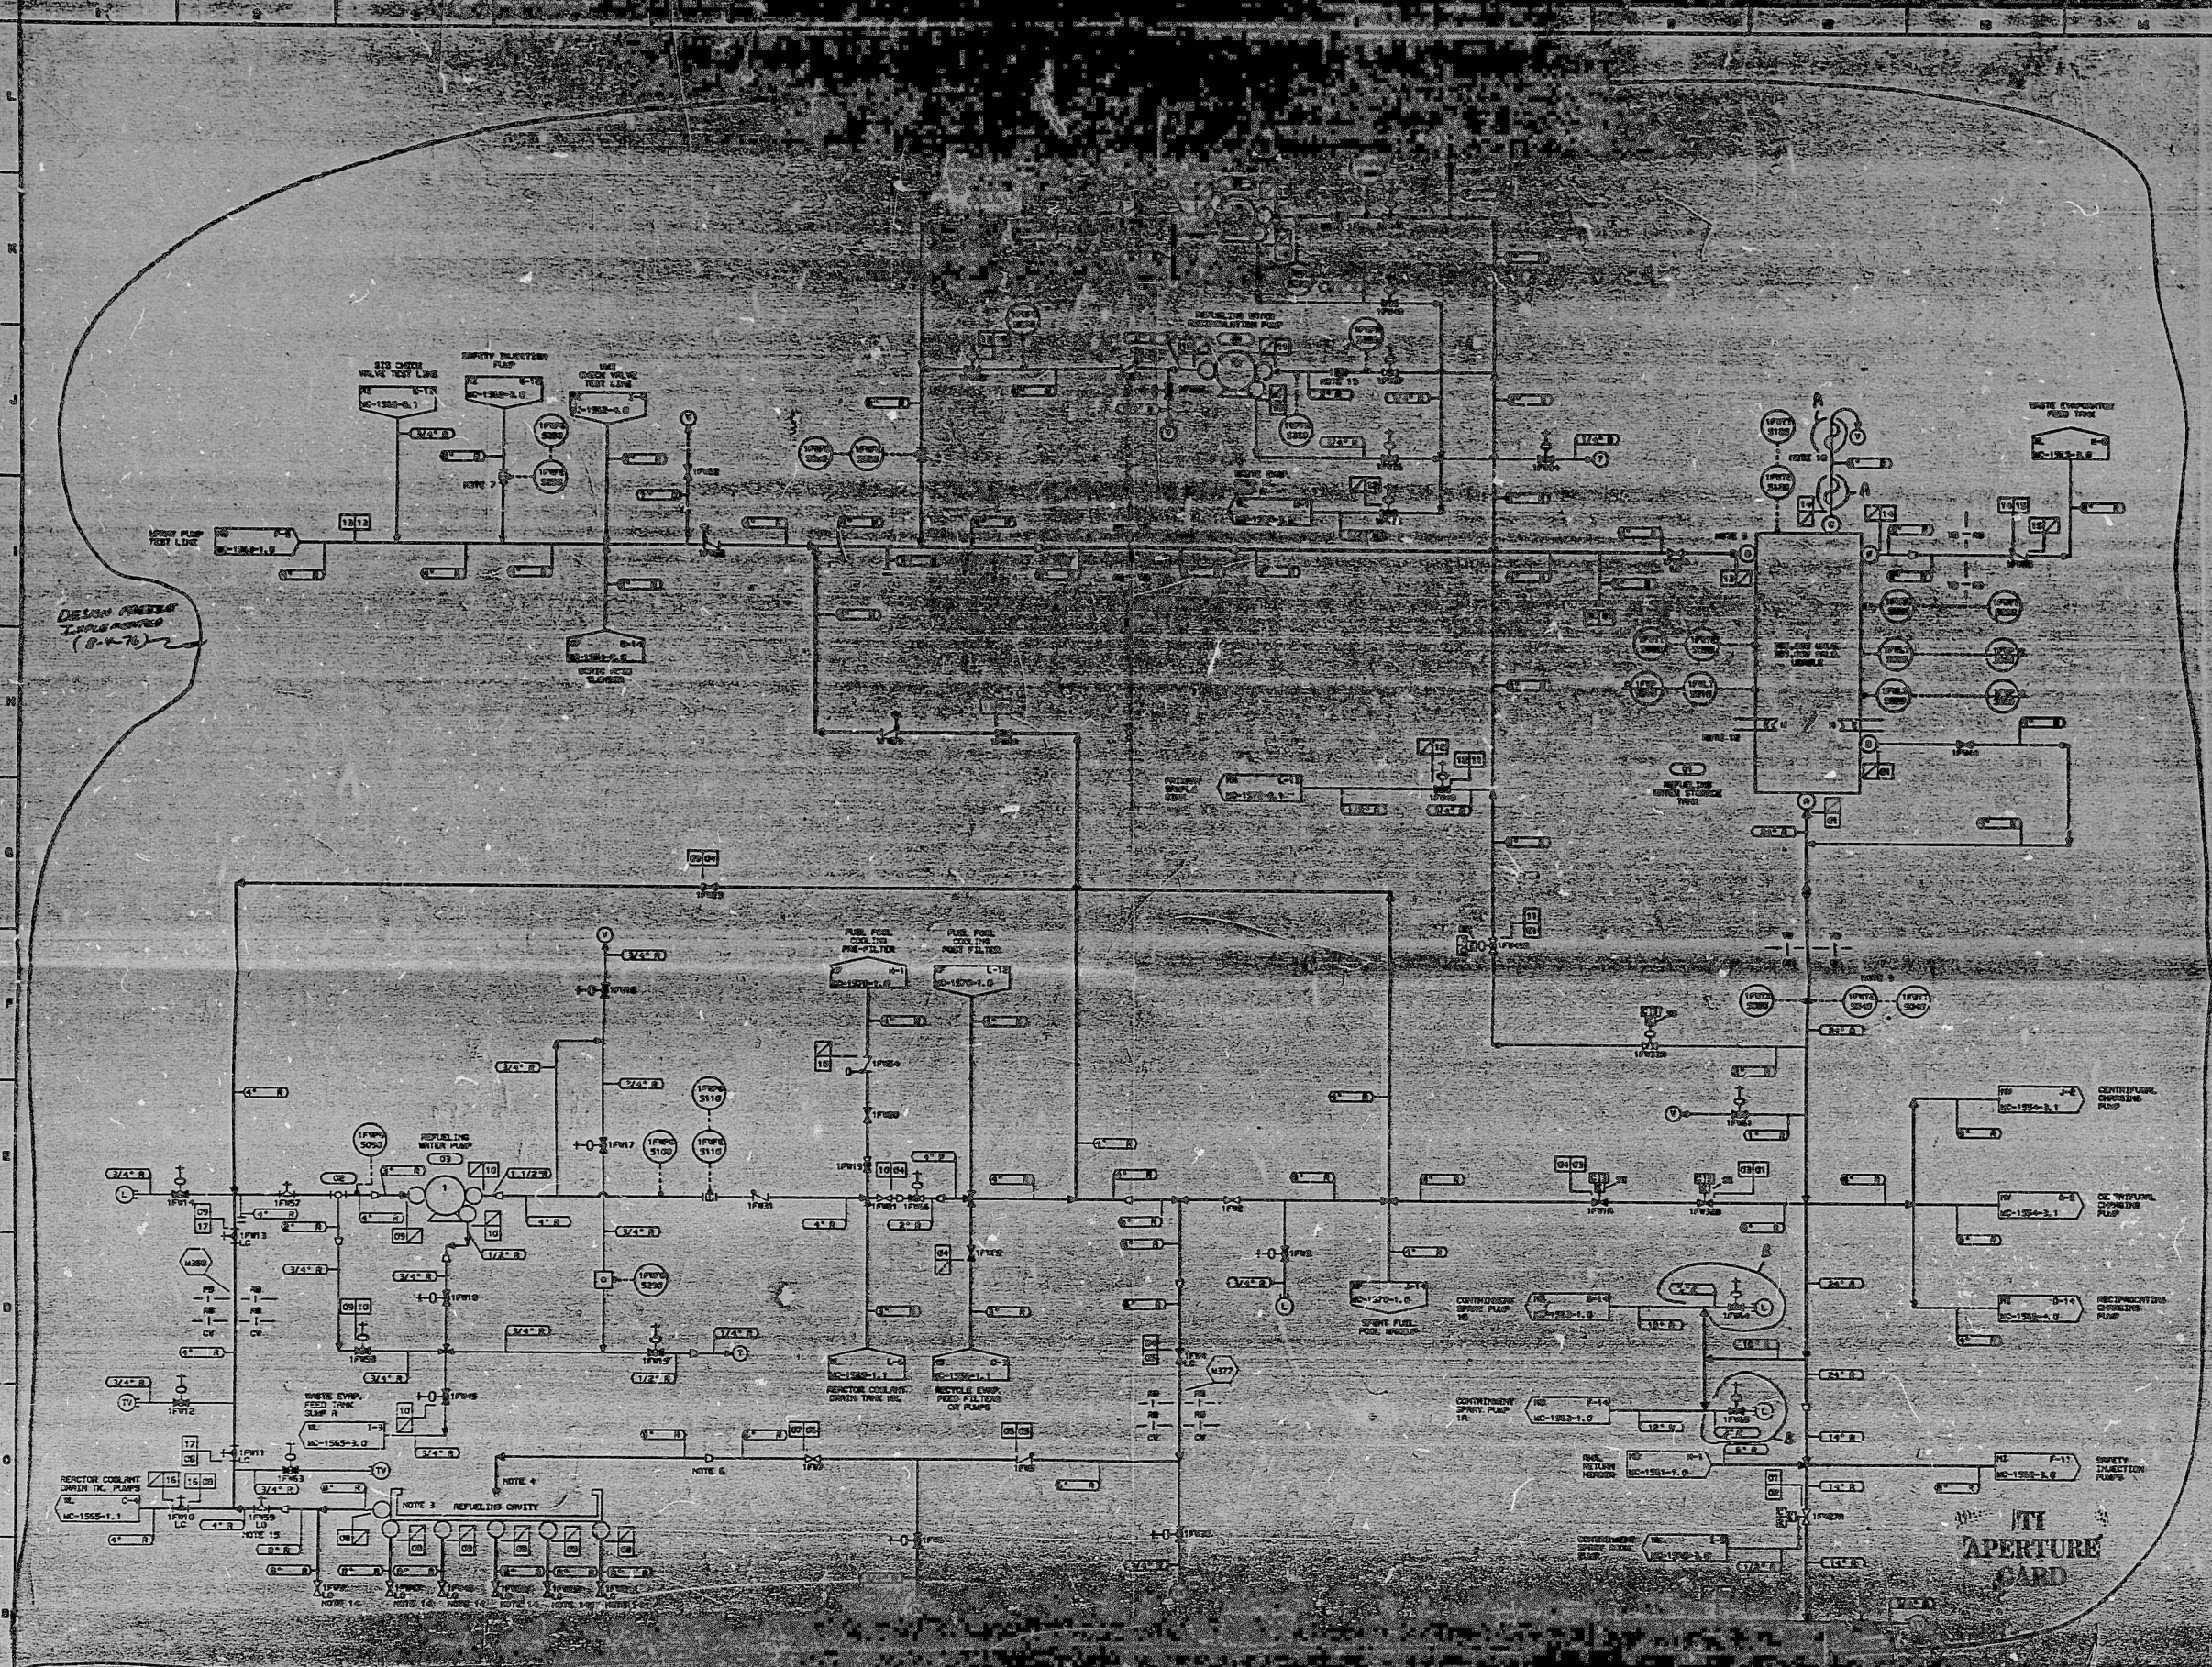

NOTES:

1. MC-1555-1.1 TO MC-1555-1.10: REACTOR COOLANT SYSTEM (RCS) PUMP.
2. MC-1555-1.11 TO MC-1555-1.20: REACTOR COOLANT SYSTEM (RCS) PUMP.
3. MC-1555-1.21 TO MC-1555-1.30: REACTOR COOLANT SYSTEM (RCS) PUMP.
4. MC-1555-1.31 TO MC-1555-1.40: REACTOR COOLANT SYSTEM (RCS) PUMP.
5. MC-1555-1.41 TO MC-1555-1.50: REACTOR COOLANT SYSTEM (RCS) PUMP.
6. MC-1555-1.51 TO MC-1555-1.60: REACTOR COOLANT SYSTEM (RCS) PUMP.
7. MC-1555-1.61 TO MC-1555-1.70: REACTOR COOLANT SYSTEM (RCS) PUMP.
8. MC-1555-1.71 TO MC-1555-1.80: REACTOR COOLANT SYSTEM (RCS) PUMP.
9. MC-1555-1.81 TO MC-1555-1.90: REACTOR COOLANT SYSTEM (RCS) PUMP.
10. MC-1555-1.91 TO MC-1555-1.100: REACTOR COOLANT SYSTEM (RCS) PUMP.

APERTURE CARD

SYSTEM CHANGE ORDER NUMBER	
1	2
3	4
5	6
7	8
9	10
11	12
13	14
15	16
17	18
19	20
21	22
23	24
25	26
27	28
29	30
31	32
33	34
35	36
37	38
39	40
41	42
43	44
45	46
47	48
49	50
51	52
53	54
55	56
57	58
59	60
61	62
63	64
65	66
67	68
69	70
71	72
73	74
75	76
77	78
79	80
81	82
83	84
85	86
87	88
89	90
91	92
93	94
95	96
97	98
99	100

870206090

PDR

8701060302

