


This drawing and the design it covers are the property of BECHTEL. They are merely loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the private use permitted by any written consent given by the lender to the borrower.

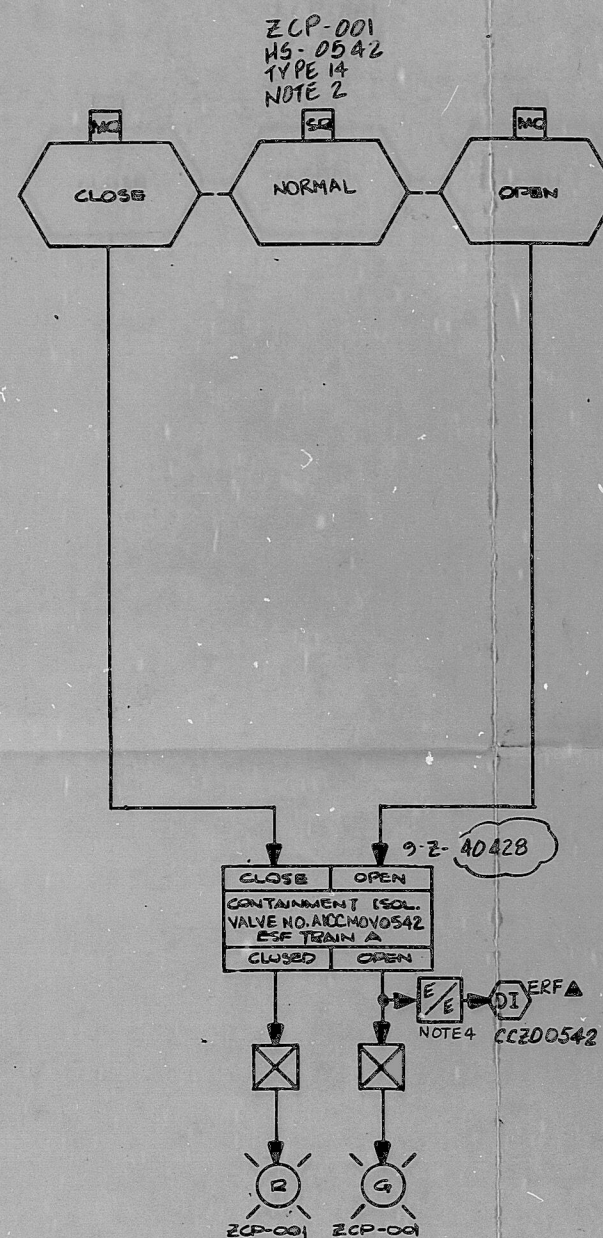

REFERENCE DWGS.

P41D: 9-F-05021

LOGIC SYMBOLS: 9-Z-40418 THRU 9-Z-40421

NOTES:

1. THIS LOGIC IS APPLICABLE TO THE FOLLOWING:

SERVICE	TRAIN	VALVE NO.	CONTROL RM SN LOCATION	HANDSWITCH TAG NO.	COMPUTER POINT BYP/INOP	CONT. PWR. CCJD0542	ELECT. REF. DWG. NO.
RC PMP3, INSIDE CONTMT. CCW OUTLET ISOL. VLV	A	A100MOV0542	ZCP-001	HS-0542	CCJD0542	CCJD0542	9-E-CC13-01
RC PMP3, INSIDE CONTMT. CCW OUTLET ISOL. VLV	B	B100MOV0542	ZCP-001	HS-0403	CCJD0403	CCJD0403	9-E-CC13-01

2. FOR SWITCH TYPES SEE DWG. 9-Z-40421.

3. TRAIN B SEE 9-Z-41852.

4. TRAIN A & B ISOLATION DEVICES LOCATED ON PANELS ZLP-659 & 660 RESPECTIVELY.

TI
APERTURE
CARD

HOUSTON OFFICE ISSUED
INFORMATION ONLY
STP 14926

GENERAL NOTE:

THIS DWG. REPRESENTS FUNCTIONAL REQUIREMENTS ONLY.

CHIEF ENGR.	AP. CAINE	NO	REVISION	DFT	CHK	GL	EGS	PEM	DATE	NO	REVISION	DFT	CHK	GL	EGS	PEM	DATE
		4	INCORP. DCN N-1	PTW	JD	JD	JD	JD	10-14-86								
		3	ISSUED FOR ANNUN/CORP. FREEZE	GRB	JD	JD	JD	JD	8-31-84								
		2	CHANGED LOCATION OF END E	GRB	JD	JD	JD	JD	7-15-84								
		1	ADDED EFFECTS/CHANGED BY/END	GRB	JD	JD	JD	JD	12-3-83								
		0	ISSUED FOR CONSTRUCTION	GRB	JD	JD	JD	JD	7-23-83								

THIS DWG. SUPERSEDES B&R DWG:
SR-20-1-Z-3181 CH. 12 REV. H



HOUSTON LIGHTING & POWER CO.
SOUTH TEXAS PROJECT

NUCLEAR SAFETY RELATED

Q

CCW RCP CONTAINMENT INSIDE
ISOLATION VALVES
LOGIC DIAGRAM
SYSTEM: CC

SCALE	JOB NO.	REVISION NO.	DWG.
NONE	1000	5R-20-9-Z 42052	4

8701160346

PDR AIDS

8701160306

