


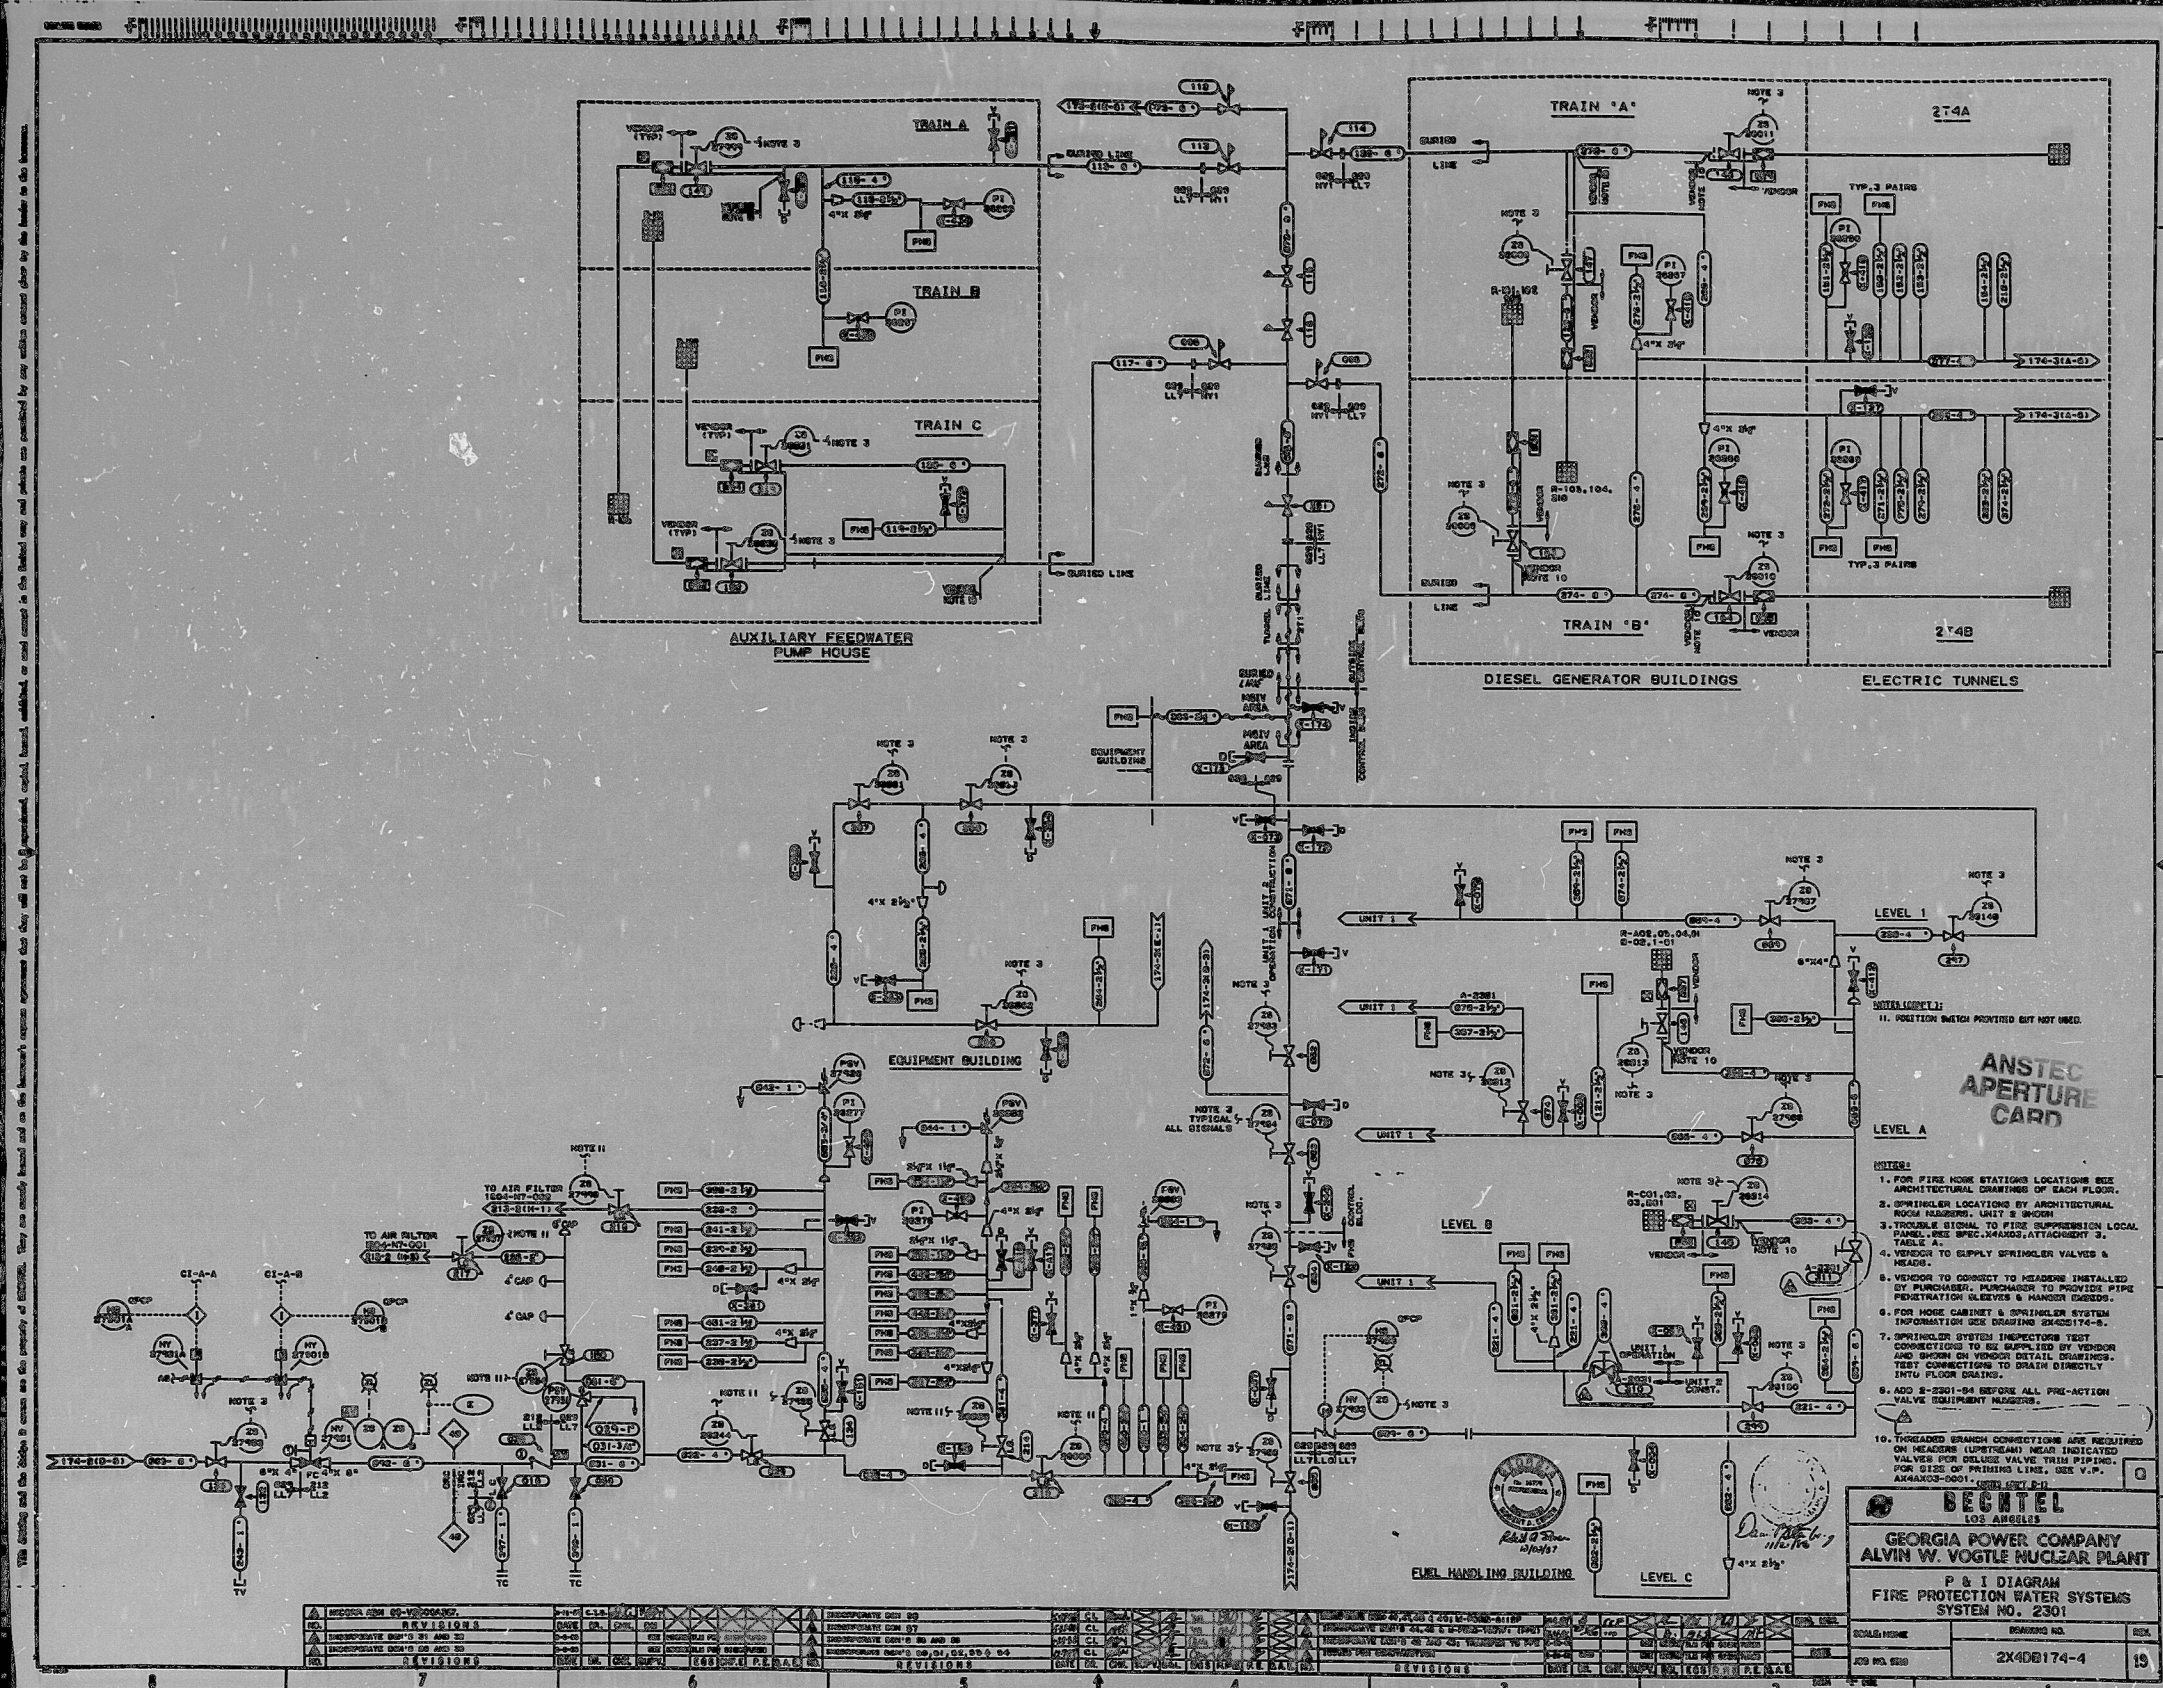

- ANSTEC APERTURE CARD**
- NOTES:**
1. FOR FIRE HOLE LOCATIONS SEE ARCHITECTURAL DRAWINGS OF EACH FLOOR.
 2. SPRINKLER LOCATIONS BY ARCHITECTURAL ROOM NUMBERS, UNIT 8 SHOW.
 3. TYPICAL SIGNAL TO FIRE SUPPRESSION LOCAL PANEL, SEE SPEC. PARAS. ATTACHMENT 3, TABLE A.
 4. VENDOR TO SUPPLY SPRINKLER VALVES & HEADS.
 5. VENDOR TO CONNECT TO HEADERS INSTALLED BY PURCHASER. PURCHASER TO PROVIDE PIPE PENETRATION ALLEYS & HANGERS (GASZOS).
 6. FOR HOSE CABINET & SPRINKLER SYSTEM INFORMATION SEE DRAWING GASEZOS-8.
 7. SPRINKLER SYSTEM INSPECTORS TEST CONNECTIONS TO BE SUPPLIED BY VENDOR AND SHOWN ON VENDOR DETAIL DRAWINGS. TEST CONNECTIONS TO DRAIN DIRECTLY INTO FLOOR DRAINS.
 8. ADD 8-2501-84 BEFORE ALL PRE-ACTION VALVE EQUIPMENT HEADERS.
 9. THROUGH BRANCH CONNECTIONS ARE REQUIRED ON HEADERS (UPSTREAM) NEAR INDICATED VALVES FOR COLLISION VALVE TRIM PIPING. FOR SIZE OF PRIMING LINE, SEE V.P. ANSTEC-001-001 (SEE DETAIL).

BECHTEL
LOS ANGELES

GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT

P & I DIAGRAM
FIRE PROTECTION WATER SYSTEMS
SYSTEM NO. 2301

SCALE: NONE
200 NO. 2301
2X406174-4
19

NO.	DESCRIPTION	DATE	BY	CHKD.	APP'D.
1	ISSUED FOR CONSTRUCTION	11/15/68	J. L. BROWN		
2	REVISION	12/10/68	J. L. BROWN		
3	REVISION	1/10/69	J. L. BROWN		
4	REVISION	2/10/69	J. L. BROWN		
5	REVISION	3/10/69	J. L. BROWN		
6	REVISION	4/10/69	J. L. BROWN		
7	REVISION	5/10/69	J. L. BROWN		
8	REVISION	6/10/69	J. L. BROWN		
9	REVISION	7/10/69	J. L. BROWN		
10	REVISION	8/10/69	J. L. BROWN		

9705230156

PDR RIDS

9505230156

