


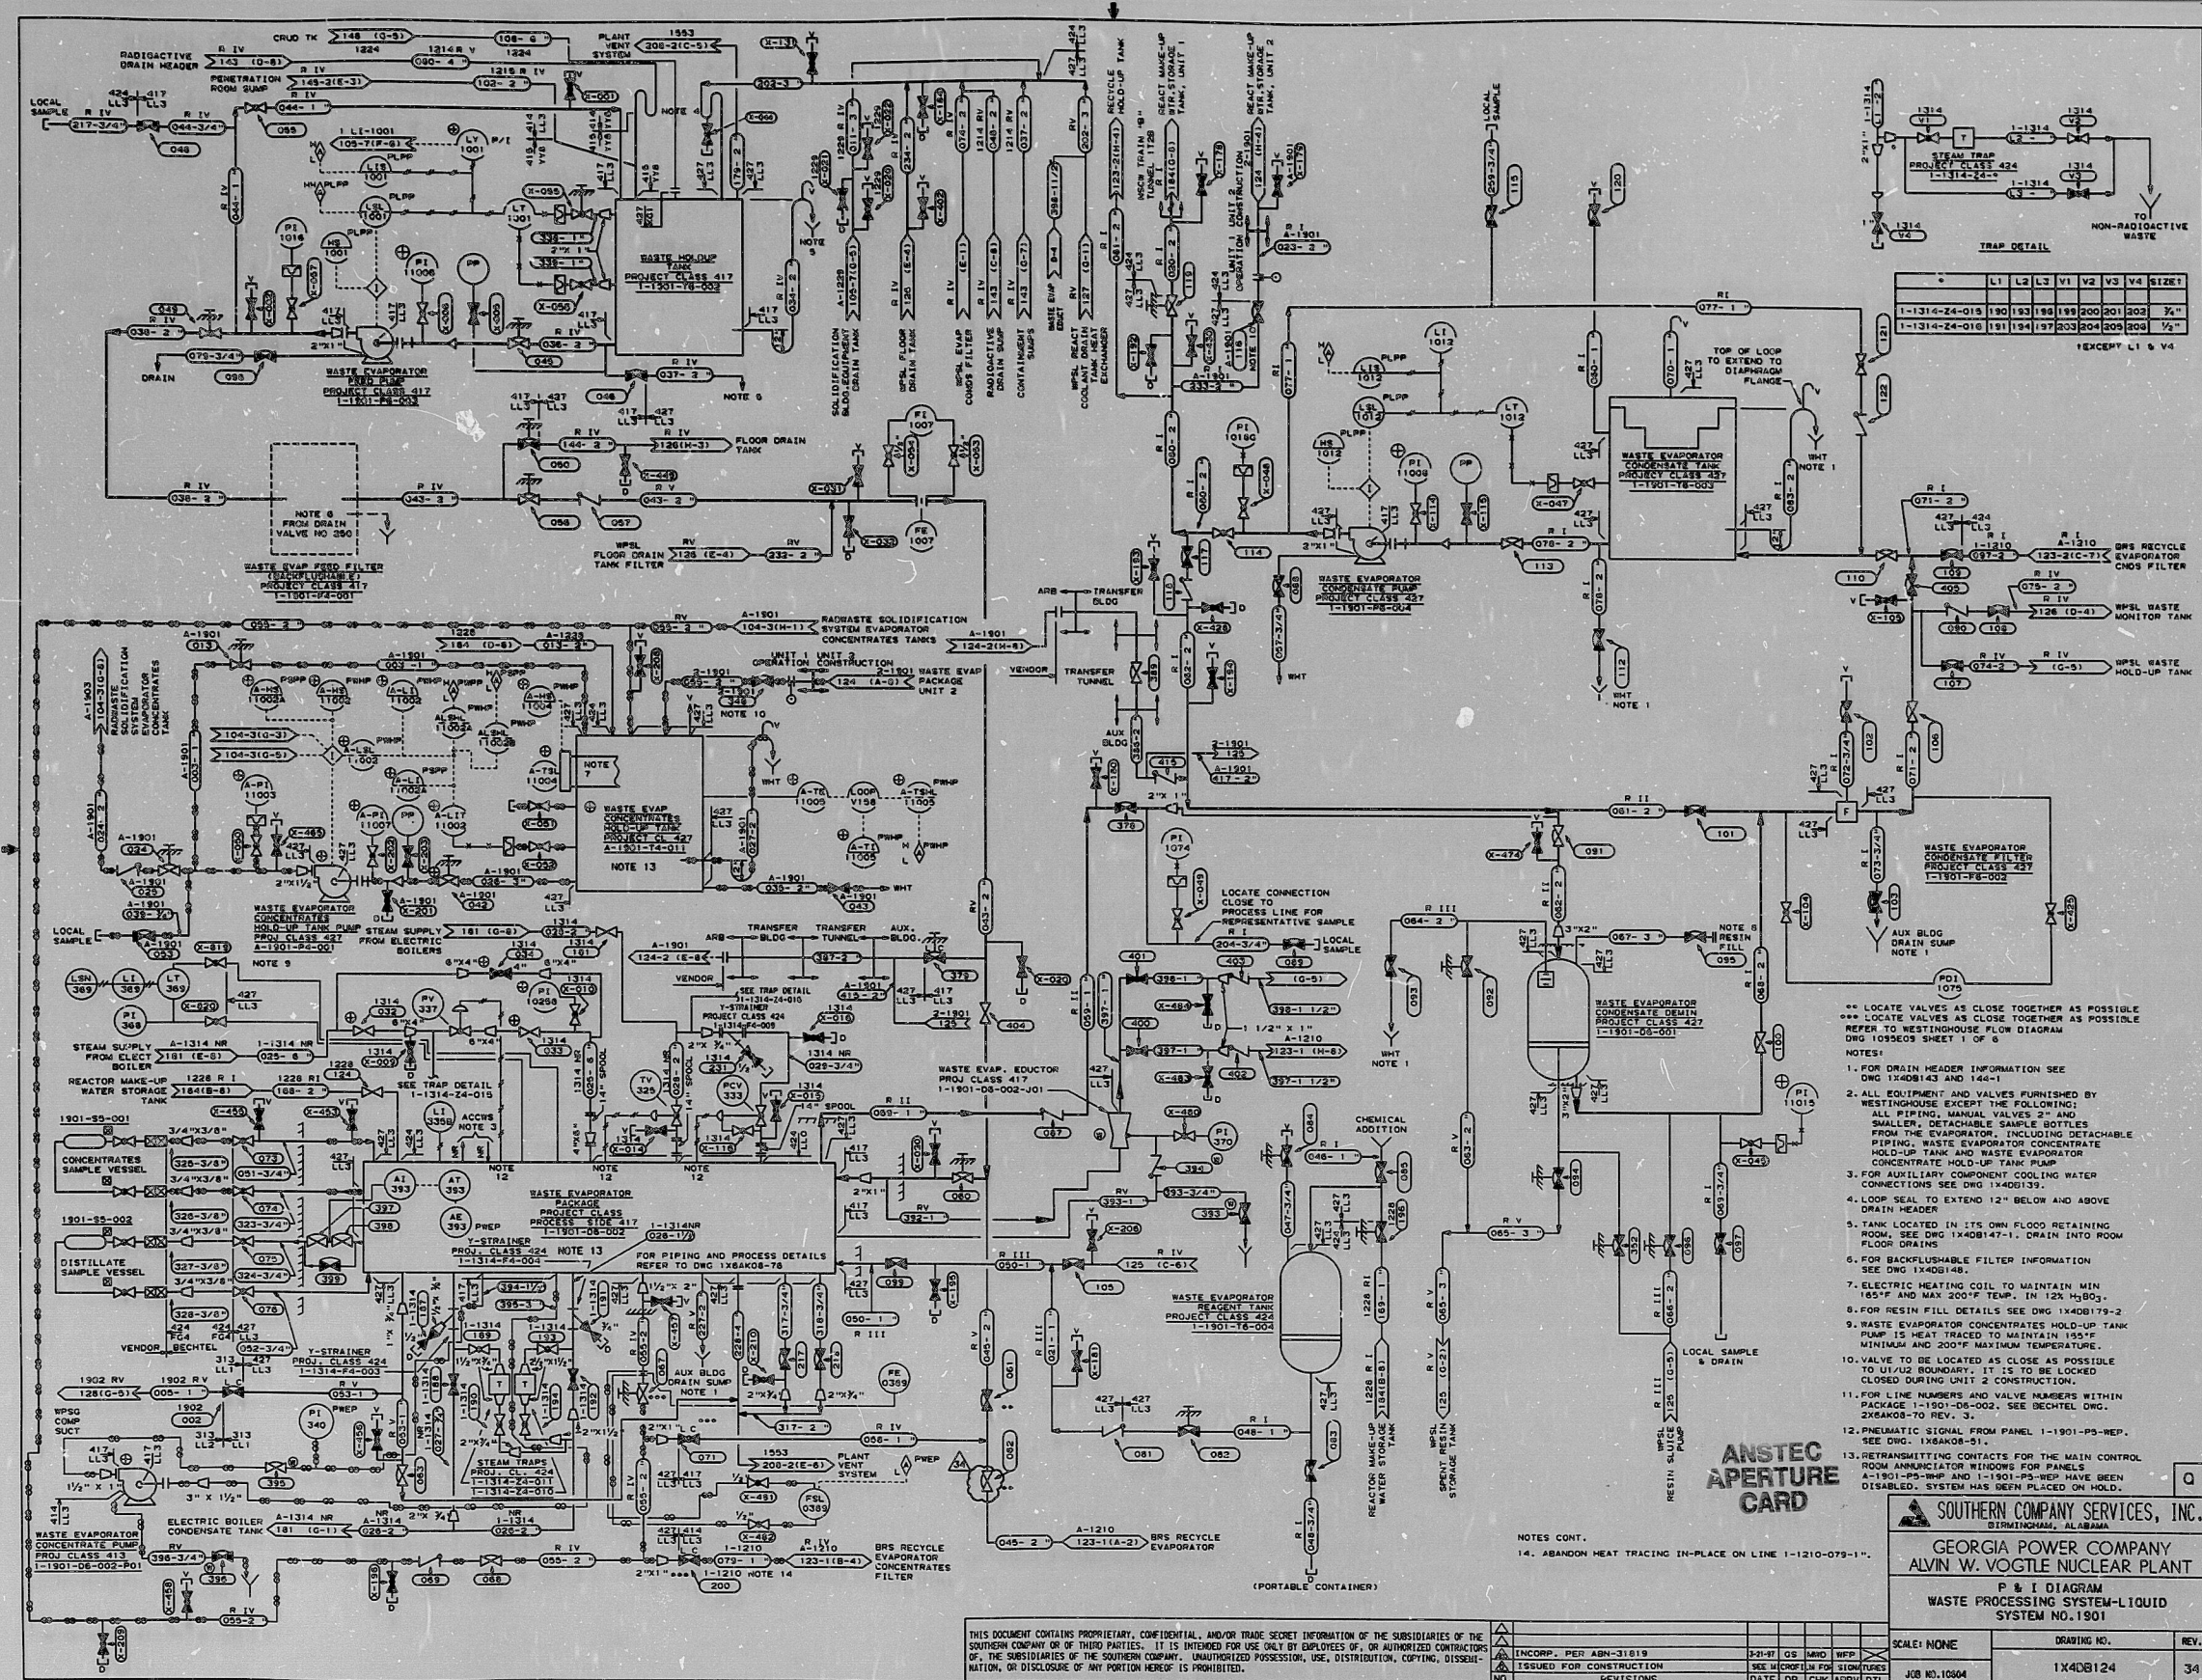

- NOTES:
1. FOR DRAIN HEADER INFORMATION SEE DWG 1408143 AND 144-1.
 2. ALL EQUIPMENT AND VALVES FURNISHED BY WESTINGHOUSE EXCEPT THE FOLLOWING:
ALL PIPING, MANUAL VALVES 2" AND SMALLER, DETACHABLE SAMPLE BOTTLES FROM THE EVAPORATOR, INCLUDING DETACHABLE PIPING, WASTE EVAPORATOR CONCENTRATE HOLD-UP TANK AND WASTE EVAPORATOR CONCENTRATE HOLD-UP TANK PUMP.
 3. FOR AUXILIARY COMPONENT COOLING WATER CONNECTIONS SEE DWG 1408133.
 4. LOOP SEAL TO EXTEND 12" BELOW AND ABOVE DRAIN HEADER.
 5. TANK LOCATED IN ITS OWN FLOOD RETAINING ROOM. SEE DWG 1408147-1, DRAIN INTO ROOM FLOOR DRAINS.
 6. FOR BACKFLUSHABLE FILTER INFORMATION SEE DWG 1408148.
 7. ELECTRIC HEATING COIL TO MAINTAIN MIN 185°F AND MAX 200°F TEMP. IN 12X H₂O₃.
 8. FOR RESIN FILL DETAILS SEE DWG 1408179-2.
 9. WASTE EVAPORATOR CONCENTRATE HOLD-UP TANK PUMP IS HEAT TRACED TO MAINTAIN 155°F MINIMUM AND 200°F MAXIMUM TEMPERATURE.
 10. VALVE TO BE LOCATED AS CLOSE AS POSSIBLE TO UTILITY BOUNDARY. IT IS TO BE LOCKED CLOSED DURING UNIT 2 CONSTRUCTION.
 11. FOR LINE NUMBERS AND VALVE NUMBERS WITHIN PACKAGE 1-1901-08-002, SEE DETAIL DWG. 2X50K-2 TO REV. 3.
 12. PNEUMATIC SIGNAL FROM PANEL 1-1901-PS-REP. SEE DWG. 1408151.
 13. RETRANSMITTING CONTACTS FOR THE MAIN CONTROL ROOM ANNUNCIATOR WINDOWS FOR PANELS A-1901-PS-REP AND 1-1901-PS-REP HAVE BEEN DISABLED. SYSTEM HAS BEEN PLACED ON HOLD.

ANSTEC
APERTURE
CARD

NOTES CONT.
14. ABANDON HEAT TRACING IN-PLACE ON LINE 1-1210-079-11."

THIS DOCUMENT CONTAINS PROPRIETARY, CONFIDENTIAL, AND/OR TRADE SECRET INFORMATION OF THE SUBSIDIARIES OF THE SOUTHERN COMPANY OR OF THIRD PARTIES. IT IS INTENDED FOR USE ONLY BY EMPLOYEES OF, OR AUTHORIZED CONTRACTORS OF, THE SUBSIDIARIES OF THE SOUTHERN COMPANY. UNAUTHORIZED POSSESSION, USE, DISTRIBUTION, COPYING, DISSEMINATION, OR DISCLOSURE OF ANY PORTION HEREOF IS PROHIBITED.

SOUTHERN COMPANY SERVICES, INC. BIRMINGHAM, ALABAMA			
GEORGIA POWER COMPANY ALVIN W. VOGTLE NUCLEAR PLANT			
P & I DIAGRAM WASTE PROCESSING SYSTEM-LIQUID SYSTEM NO. 1901			
SCALE: NONE	DRAWING NO.	REV.	
JOB NO. 10004	1408124	34	
CAO NAME 14-08124			

NO.	REVISIONS	DATE	OR	CHK	APPV	DTL
1	ISSUED FOR CONSTRUCTION					
2						
3						
4						
5						
6						
7						
8						

9706030159

PDR RIDS

9706030159

