


THIS DRAWING AND THE DESIGN IT COVERS ARE THE PROPERTY OF SOUTHERN COMPANY SERVICES, INC. THEY ARE MERELY LOANED AND ON THE BORROWER'S EXPRESS AGREEMENT THAT THEY WILL NOT BE REPRODUCED, COPIED, LOANED, EXHIBITED, OR USED EXCEPT IN THE LIMITED WAY AND PRIVATE USE PERMITTED BY ANY WRITTEN CONSENT GIVEN BY THE LENDER TO THE BORROWER.

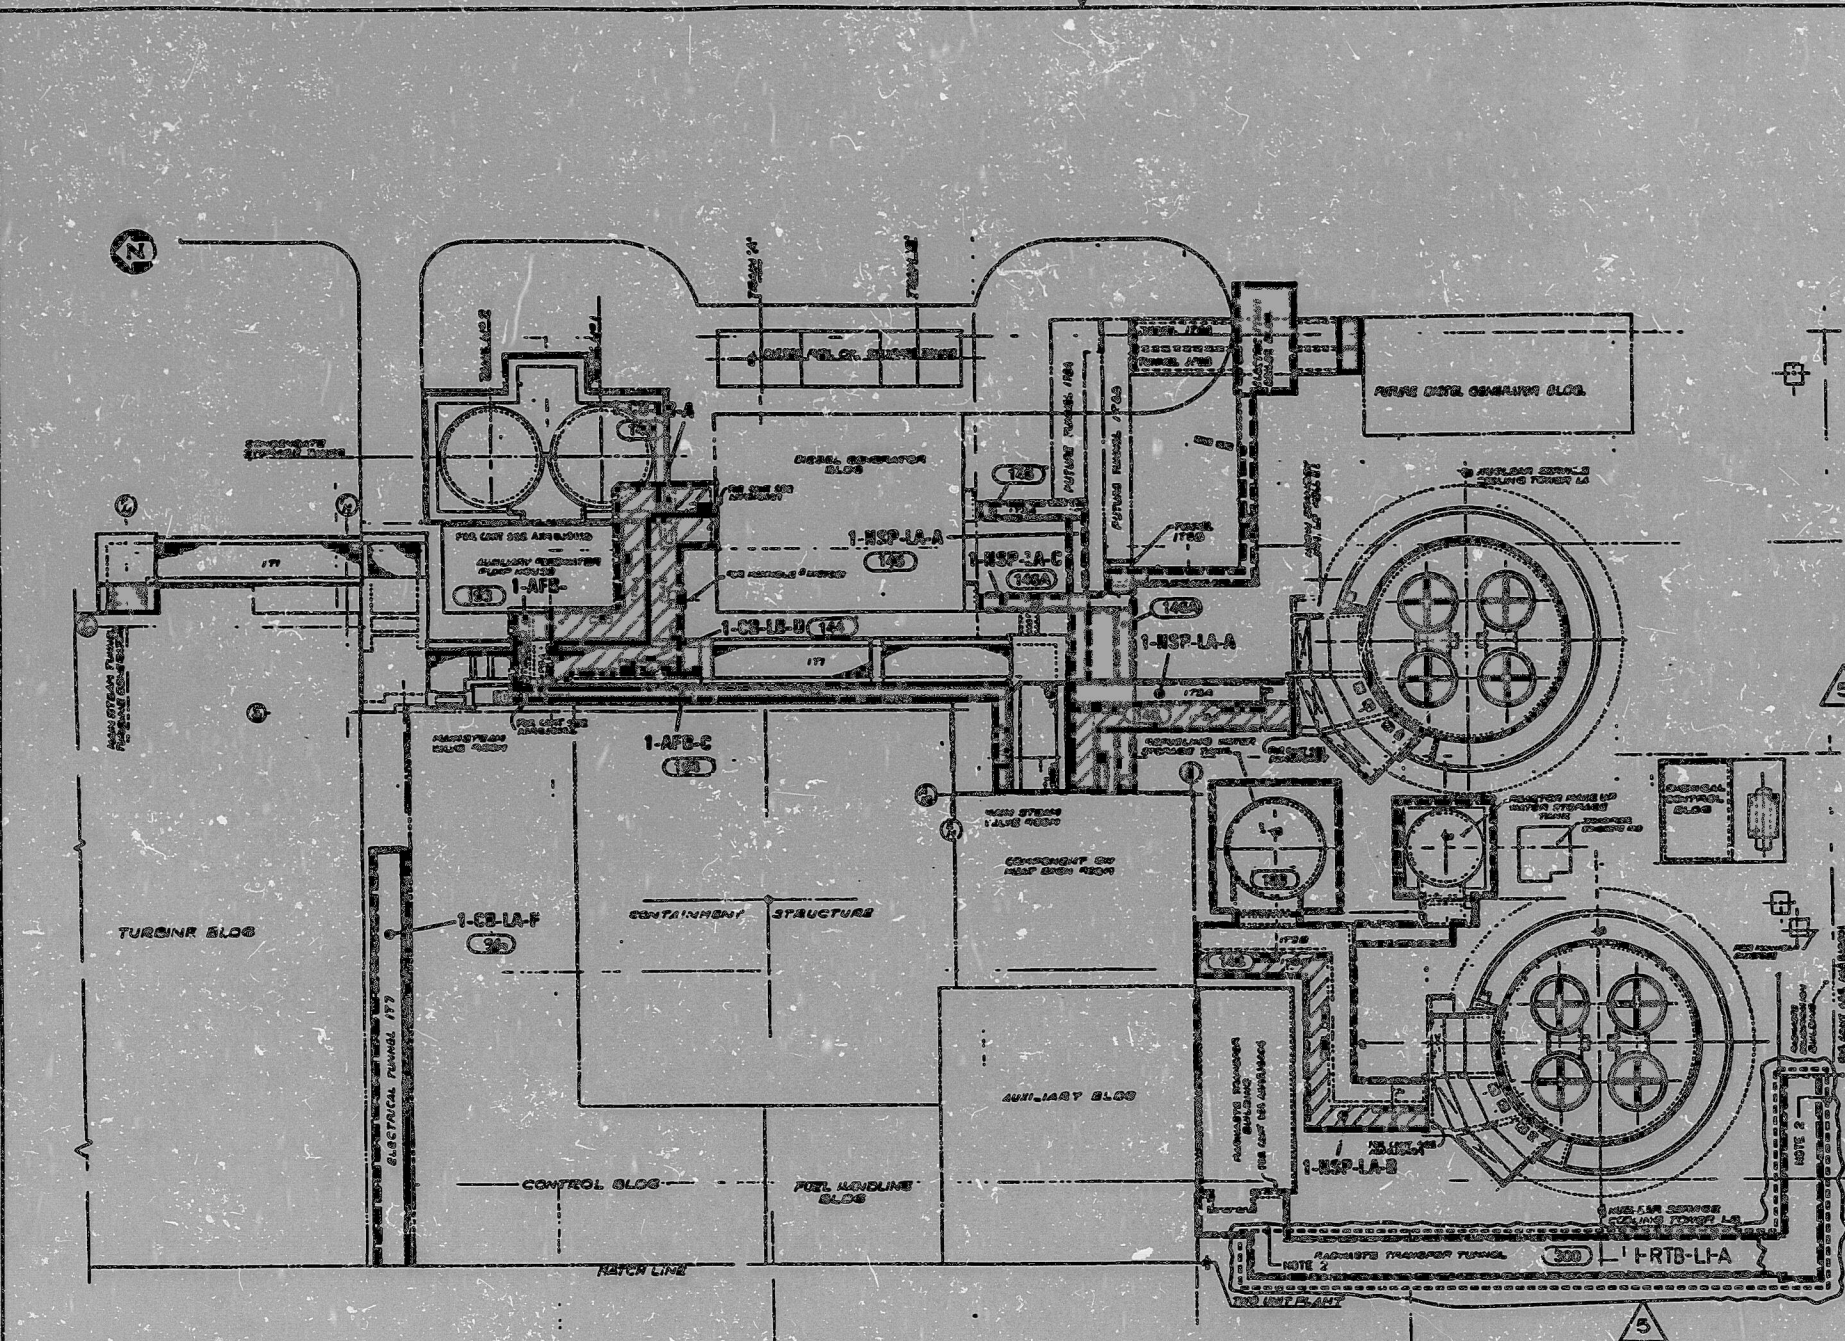

NOTES:
1. THE BACKGROUND USED ON THIS DRAWING IS PROVIDED FOR ORIENTATION PURPOSES ONLY.
2. "RETIRED IN PLACE".

* FIRE HOSE CABINET WITH HOSE RACK FOR 100 FT. 1.5 IN. ARMS "ROCKWELL" FIRE HOSE WITH GALLEY ROSSER LUG STYLE COUPLING AND A 17 LB. PONY (10A) ABC PORTABLE FIRE EXTINGUISHER.

- LEGEND
- 3 HR RATED FIRE AREA BOUNDARY
 - UNRATED FIRE AREA BOUNDARY
 - 3 HR RATED BOUNDARY
 - 2 HR RATED BOUNDARY
 - PRE-ACTION SPRINKLER SYSTEM
 - HALON SYSTEM
 - FIRE HOSE CABINET
 - FIRE HOSE RACK
 - PORTABLE EXTINGUISHER (DRY-CHEMICAL)
 - EXIT SIGN LOCATION
 - FIRE ALARM PULL BOX
 - KNOCK OUT PANEL
 - FIRE ZONE BOUNDARY
 - FIRE ZONE DESIGNATOR

ELECTRICAL CABLE LOCATION CROSS REFERENCE			
FIRE ZONE	UNIT 1 E4 CODE	UNIT 2 E4 CODE	
101	VE	-	
102	VE	-	
103	VE	-	
104	VE	-	
105	VE	-	
106	VE	-	
107	VE	-	
108	VE	-	
109	VE	-	
110	VE	-	

△	REVISED PER REA 95-VAA043	DATE	DR	CHK	APPV	DTL	DATE	DR	CHK	SUPV	EGL	EGS	CHFE	PE	QAE	ENG. MGR.
△	REVISIONS	DATE	DR	CHK	APPV	DTL	DATE	DR	CHK	SUPV	EGL	EGS	CHFE	PE	QAE	ENG. MGR.
△	ISSUED FOR CONSTRUCTION	DATE	DR	CHK	APPV	DTL	DATE	DR	CHK	SUPV	EGL	EGS	CHFE	PE	QAE	ENG. MGR.
NO.	REVISIONS	DATE	DR	CHK	APPV	DTL	DATE	DR	CHK	SUPV	EGL	EGS	CHFE	PE	QAE	ENG. MGR.

ANSTEC APERTURE CARD

SOUTHERN COMPANY SERVICES, INC. BIRMINGHAM, ALABAMA		
GEORGIA POWER COMPANY ALVIN W. VOGTLE NUCLEAR PLANT		
FIRE AREAS NSCW AND MISC CATEGORY 1 STRUCTURES KEY PLAN-UNIT 1		
SCALE: NONE	DRAWING NO.	REV.
JOB NO. 10804	AX4DJ8040	5

SIZE C 17X22

15, 1995 181144

PDR RIDS

9601040052

