


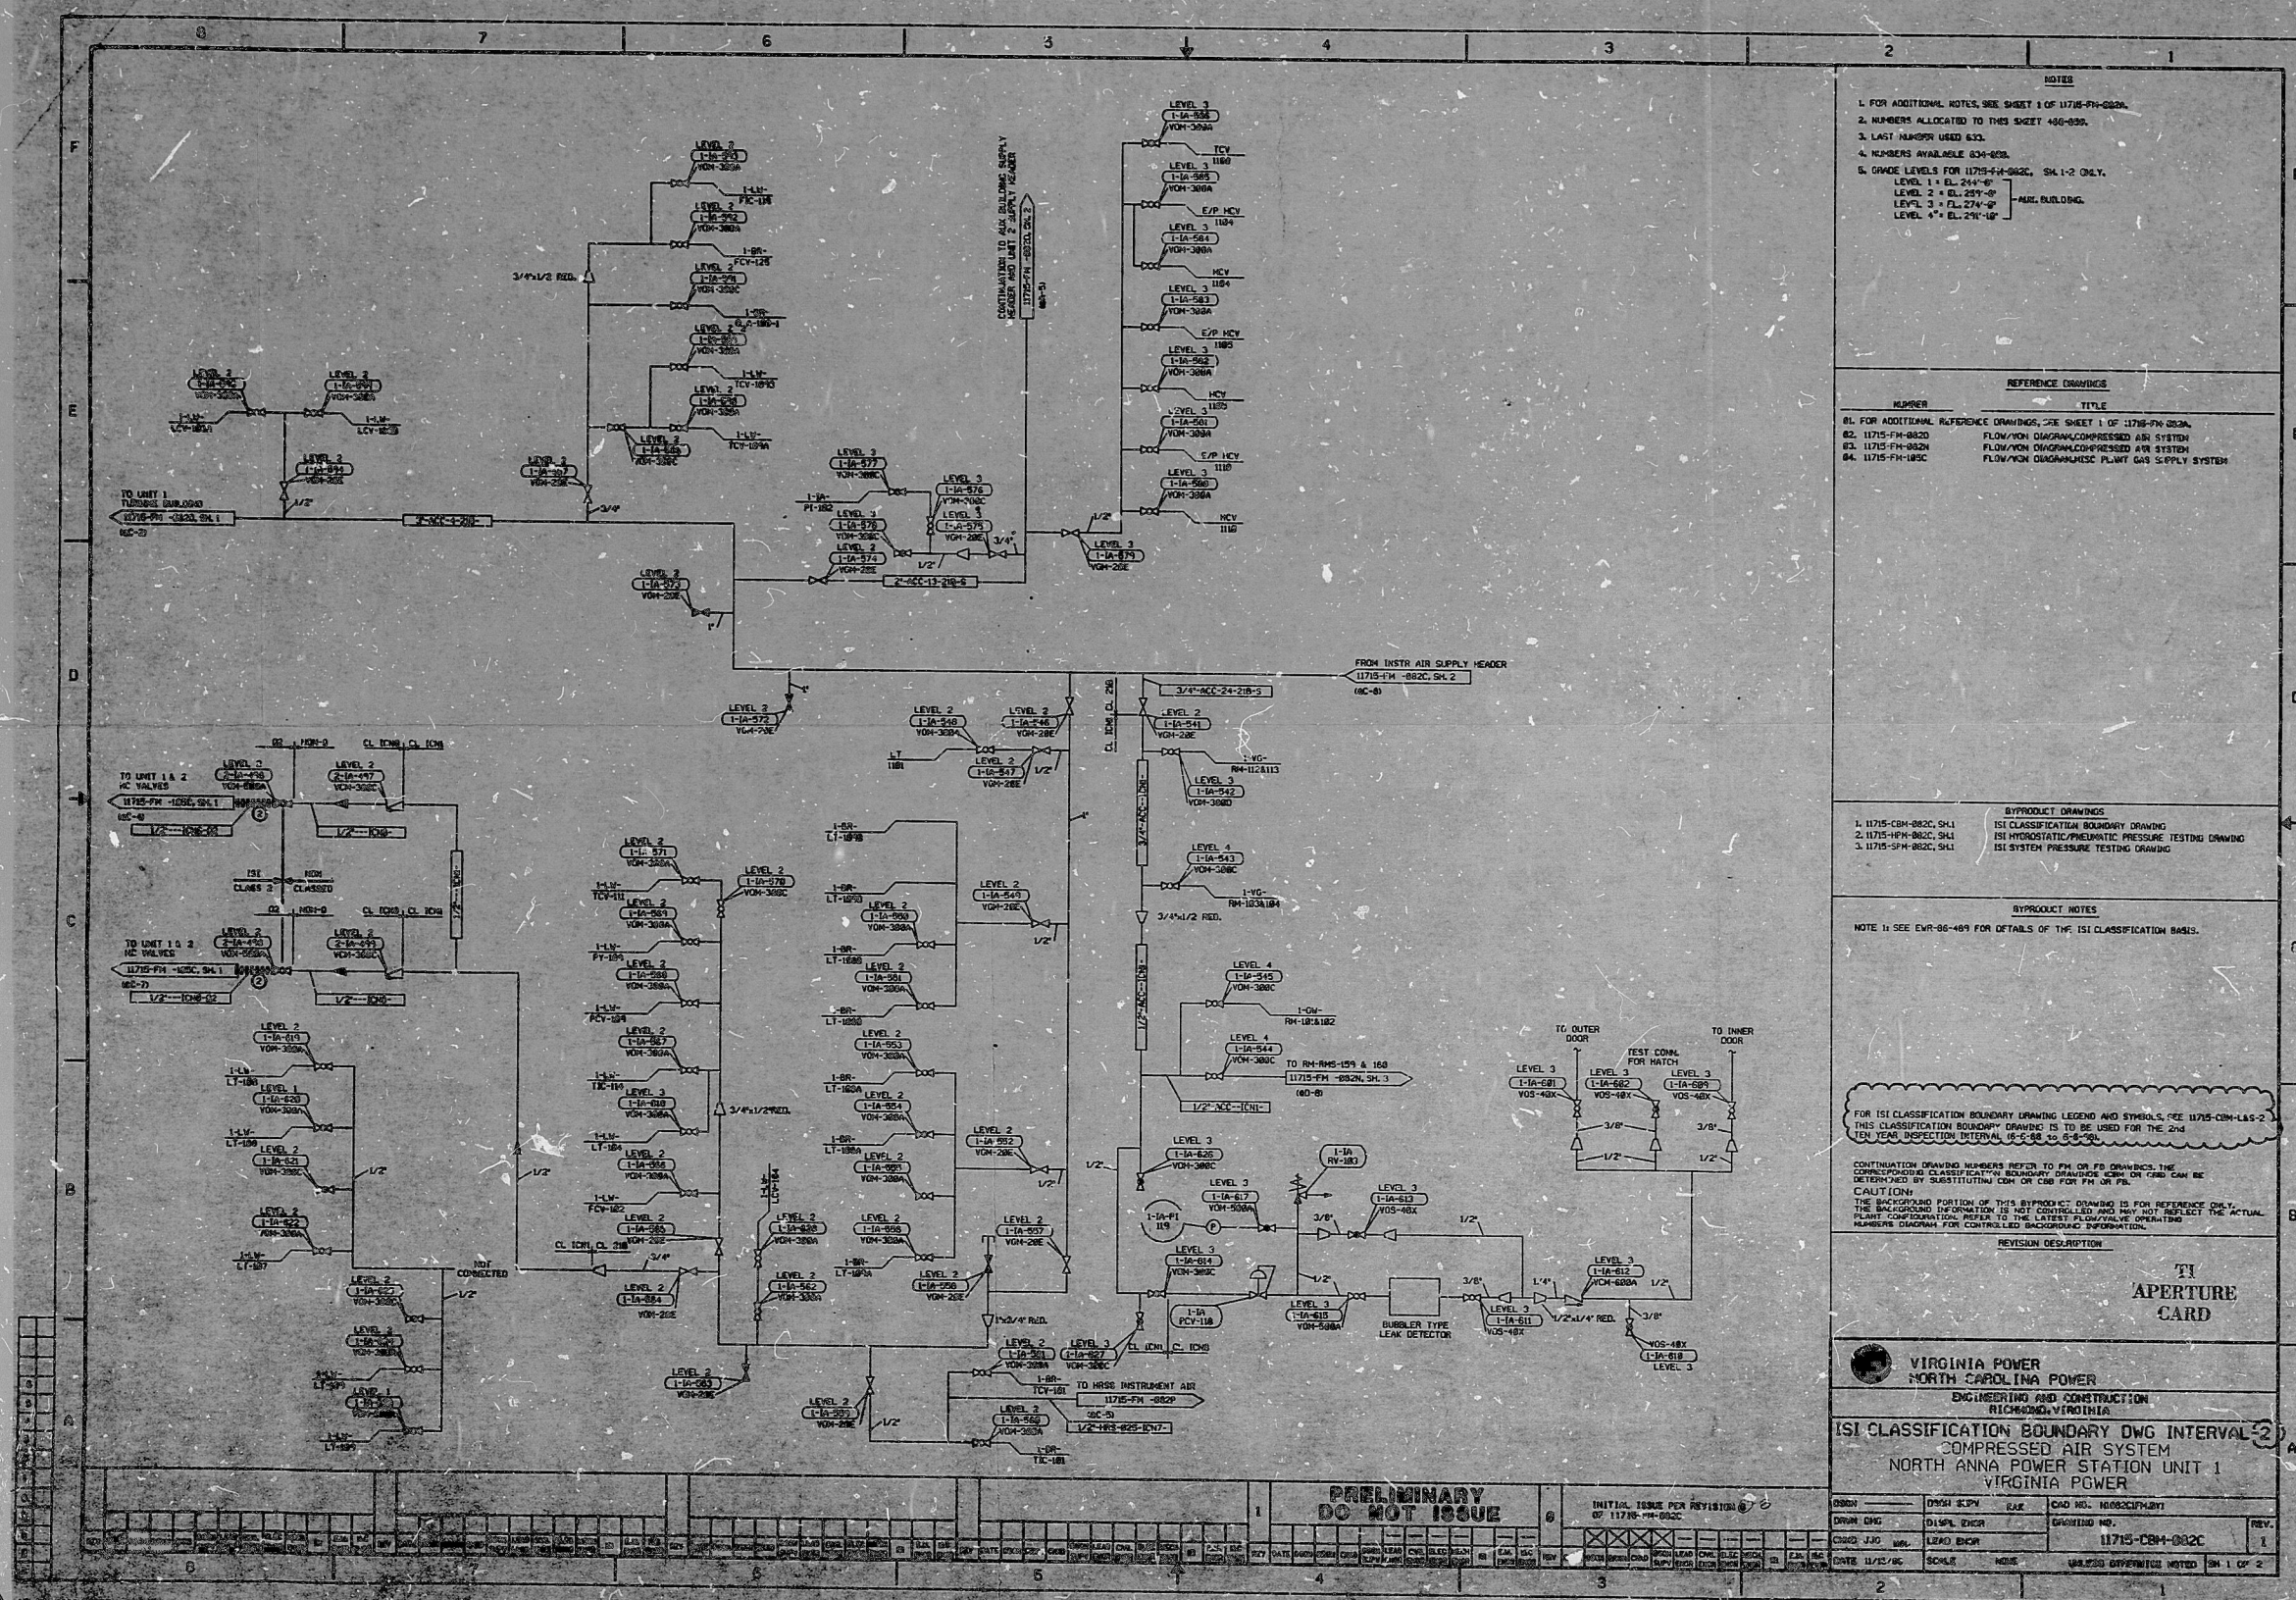

- NOTES
1. FOR ADDITIONAL NOTES, SEE SHEET 1 OF 1175-FM-822A.
 2. NUMBERS ALLOCATED TO THIS SHEET 400-800.
 3. LAST NUMBER USED 831.
 4. NUMBERS AVAILABLE 834-850.
 5. GRADE LEVELS FOR 1175-FM-822C, SH 1-2 ONLY.
LEVEL 1 = EL. 244'-0"
LEVEL 2 = EL. 237'-0"
LEVEL 3 = EL. 234'-0"
LEVEL 4 = EL. 231'-0"

NUMBER	TITLE
01. 1175-FM-822A	IS1 CLASSIFICATION BOUNDARY DRAWING
02. 1175-FM-822B	IS1 HYDROSTATIC/PNEUMATIC PRESSURE TESTING DRAWING
03. 1175-FM-822C	IS1 SYSTEM PRESSURE TESTING DRAWING
04. 1175-FM-822D	IS1 SYSTEM PRESSURE TESTING DRAWING

- BYPRODUCT DRAWINGS
1. 1175-FM-822C, SH 1
 2. 1175-FM-822C, SH 2
 3. 1175-FM-822C, SH 3

NOTE: SEE ENR-86-409 FOR DETAILS OF THE IS1 CLASSIFICATION BASIS.

FOR IS1 CLASSIFICATION BOUNDARY DRAWING LEGEND AND SYMBOLS, SEE 1175-FM-822-2. THIS CLASSIFICATION BOUNDARY DRAWING IS TO BE USED FOR THE 2nd YEAR INSPECTION INTERVAL (5-5-86 TO 5-5-87).

CAUTION: CONTINUATION DRAWING NUMBERED FROM 1 TO 10. THIS DRAWING IS FOR REFERENCE ONLY. THE BACKGROUND INFORMATION IS NOT CONTROLLED AND MAY NOT REFLECT THE ACTUAL PLANT CONFIGURATION. REFER TO THE CONTROLLED AND REVISED DRAWINGS FOR THE LATEST INFORMATION. NUMBERS DIAGRAM FOR CONTROLLED BACKGROUND INFORMATION.

REVISION DESCRIPTION

1	ISSUE
---	-------

1175-FM-822C
COMPRESSIONED AIR SYSTEM
NORTH ANNA POWER STATION UNIT 1
VIRGINIA POWER

PRELIMINARY
DO NOT ISSUE

DATE	11/2/86	SCALE	1"=10'	REVISION	1
DATE	11/2/86	SCALE	1"=10'	REVISION	1

8806160221

PDR RIDS

