


NO.	REVISION	DATE	BY	CHKD.

2CAF1 HIGH ENERGY
2 CAHS 2CAF1

CN-2CA-60 5

NO.	QTY	DESCRIPTION	UNIT	SCALE	NOTES
A	37'	PIPE	SA-108	6"	80
B	1'	PIPE	SA-108	4"	160
C	6'	PIPE	SA-224	6"	80
D	1'	CONC. F.	SA-405	6"x4"	80
E	1'	THERMOWELL	SA-405	7"	80
F	1'	PENETRATION	SA-405	7"	80
G	1'	H/CWPL SW FOR	SA-405	7"	80
H	1'	PLUS	SA-405	7"	80
J	2'	90° BELL (C.W.)	SA-405	6"	80
K	1'	PIPE	SA-108	6"	80

QA CONDITION 1
NUCLEAR SAFETY RELATED

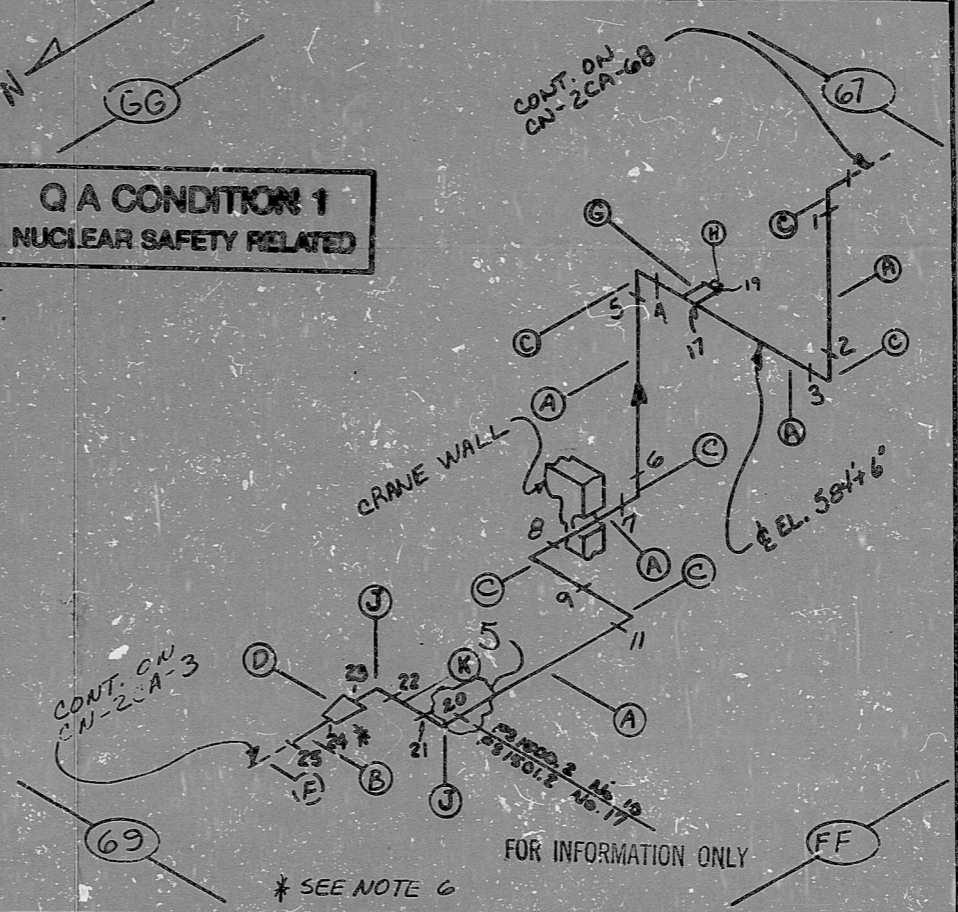

ANSTEC APERTURE CARD

NOTES:
 ① ALL WELD NUMBERS SHALL BE PRECEDED BY 2CA-0 -
 ② LAST WELD NO. 25
 ③ REF. LAYOUT DWG. CN-2441-CA015
 ④ REF. PLOW DWG. CN-2592-L1 (E) 11/11
 ⑤ CHECK FOR INSERVICE INSPECTION IWT PSA: 602F
 ⑥ TRANSITION I.A.W. MD.G-ES-11

NO.	REVISION	DATE	BY	CHKD.

QA CONDITION I
 DUKES POWER COMPANY
 CAROLINA NUCLEAR STATION
 TITLE AUXILIARY FEEDWATER SYSTEM
 TO STM GEN 2D
 SYS. CA LINE NO. 1017 DUKES CLASS B
 Piping Specs. 1500.2-1 ME012
 LOCATION REACTOR BUILDING (RBS)
 DWG. NO. CN-2CA-60 REV. NO. 5

C B A A B

PDR RIDS

9603130169

