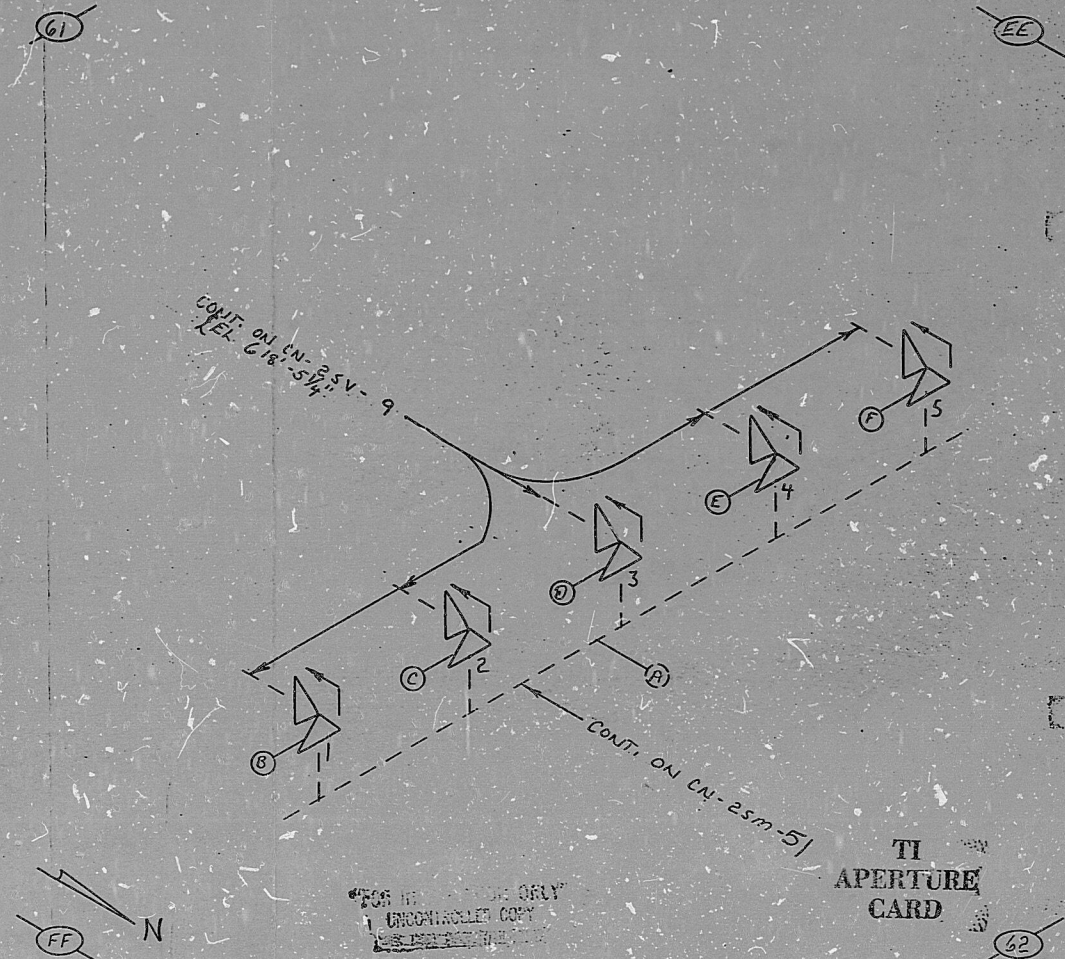


HIGH ENERGY

[illegible]

NOTES:

1. ALL WELD NUMBERS SHALL BE PRECEDED BY 25V 8-
2. LAST WELD NO. 5
3. REF. LAYOUT DWG. IN-2491-SV003
4. REF. FLOW. DWG. CN-2543-1.0 (H I 2.9.10)
5. CHECK FOR INSURVACE INSPECTION: 1200 PSIA, 600°F

1	4"	1,500	1	1	1
2	6"	1,500	1	1	1
3	4"	1,500	1	1	1
4	4"	1,500	1	1	1
5	4"	1,500	1	1	1
WELD NO.	SIZE	SCH	RT	PWHT	MPH

3	RE-ITEMS B-F			
2	Add CONT.			
1	SMALL HARD ITEMS D, E			
4	REL FOR CONT.			
NO.	REVISION			

NUCLEAR SAFETY RELATED		YES	NO
DUKE POWER COMPANY CATAWBA NUCLEAR PLANT			
TITLE			
MAIN STEAM VENT TO ATMOSPHERE SYSTEM			
FROM STEAM GENERATOR 2C			
SYS. <u>SV</u> LINE NO. <u>04</u> DUKE CLASS <u>B</u>			
PIPING SPEC. <u>P 900.12</u>			
LOCATION <u>REACTOR ROOM HOUSE (R.D.H.)</u>			
DWG. NO. <u>011-25V-8</u>		REV. NO. <u>3</u>	

PDR RIDS

8808230215

