


E-6089-0 Q

This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, nor used except in the limited way and private use permitted by any written consent given by the lender to the borrower.

AUTO-GRAPHICS FILE #40463

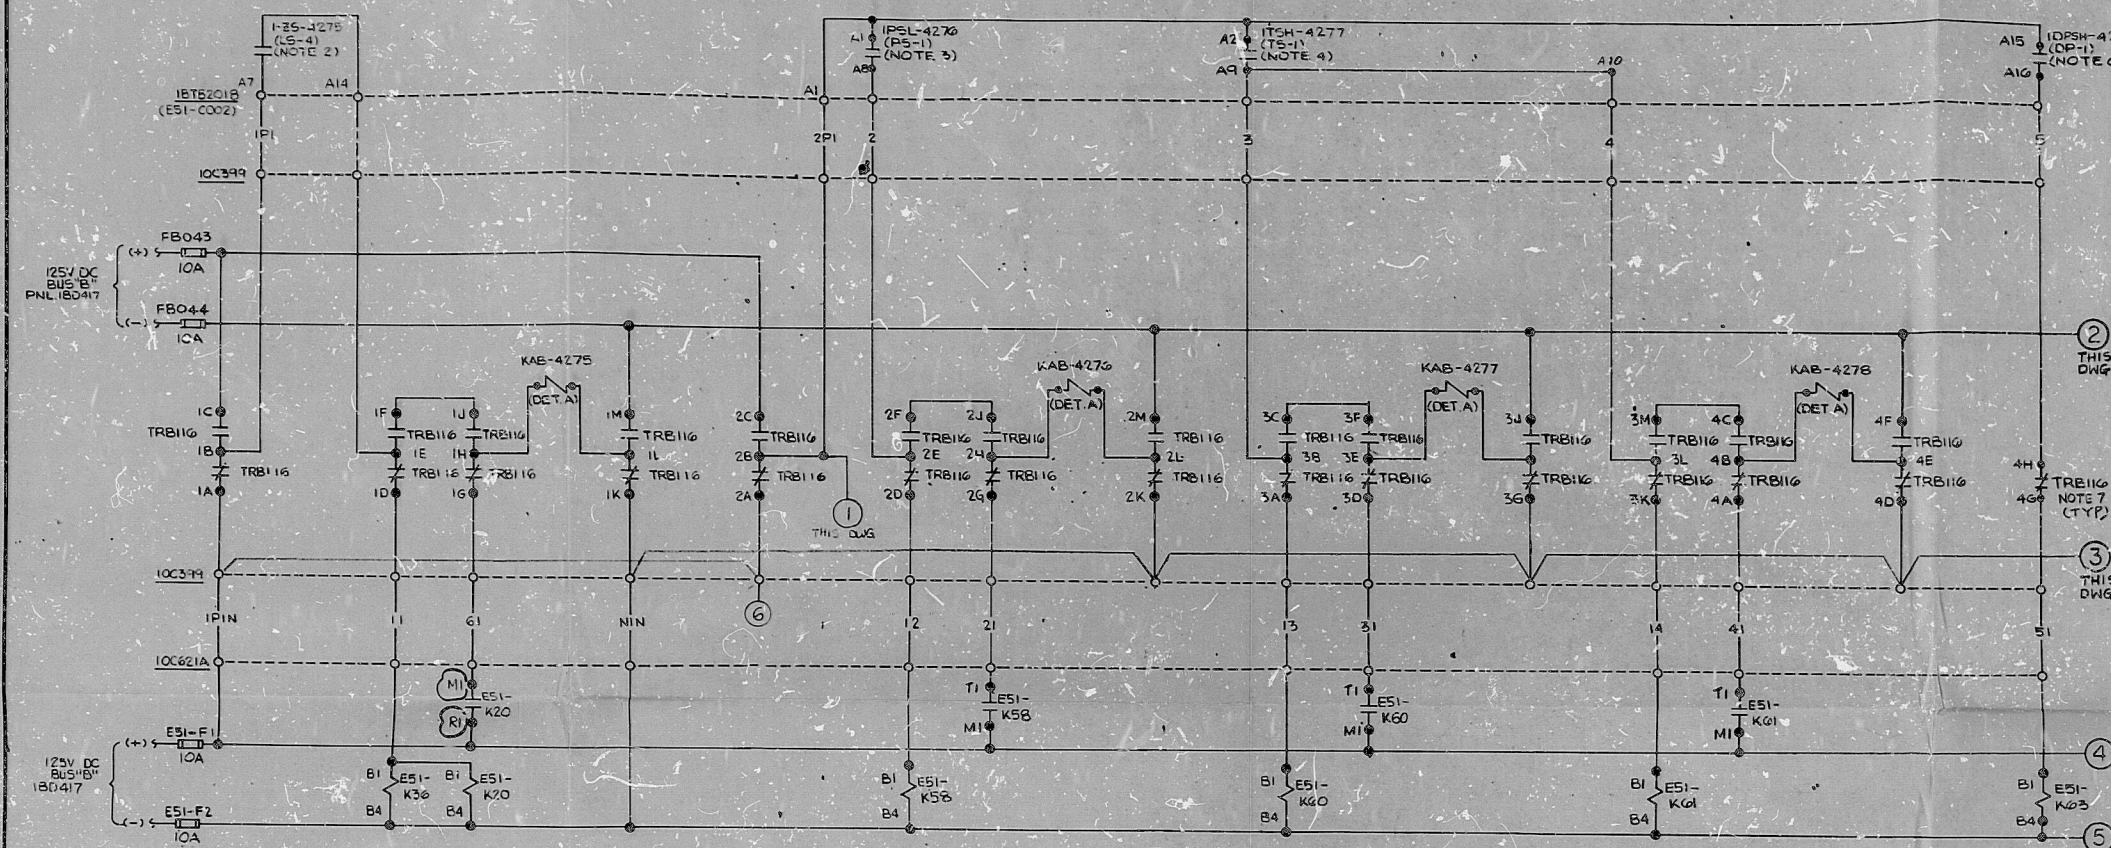

NOTES:



- 1-2S-4275 CLOSING WHEN RCIC PUMP TRIP AND THROTTLE VALVE NOT FULLY CLOSED.
- 1-PSL-4276 CLOSING ON RCIC OIL PRESSURE LOW.
- 1-TSH-4277 CLOSING ON RCIC TURBINE OIL BEARING OIL TEMPERATURE HIGH.
- 1-PSH-4279 CLOSING ON RCIC OIL FILTER DIFFERENTIAL PRESSURE HIGH. (IN RSP PANEL FOR ISOLATION ONLY).
- RELAY TRB11G CONTACTS ARE SHOWN WITH THE NORMAL COIL ENERGIZED (SEE REF. 3).
- 1-BUS-NO35E1A CLOSING ON CONDENSATE STORAGE TANK LOW-LOW LEVEL.

REFERENCE DRAWINGS:

1. 3E ELEMENTARY DIA. MPL-ES1-1040-59 (781E421AC) SH. 6, 7.
2. CABLE BLOCK DIAGRAM DWO. E-2089-0.
3. ELECT SCHEME DWS. E-6603-0, E-6604-0.
4. LOGIC DIAGRAM J-50-0 & J-08-0, SH. 6.
5. FLUID COMPONENT INC. DWS. 10855-J-453(Q)-2.
6. COMSIP INC. DWS. 10855-J201(Q)-7, SH. 29 (PWL 10C399).

TI
APERTURE
CARD

RCIC TURBINE MONITORING CIRCUITS IN RSP
SCHEME NO. 100330 SUB-D (INST. TAG NO. IFC-...)
CLASS 1E, CHANNEL B

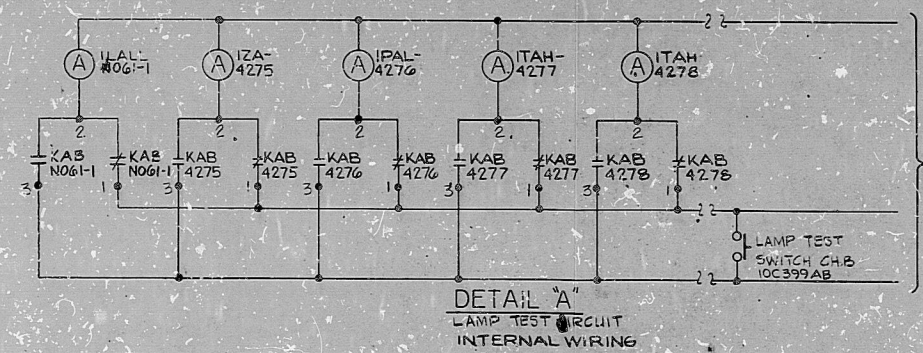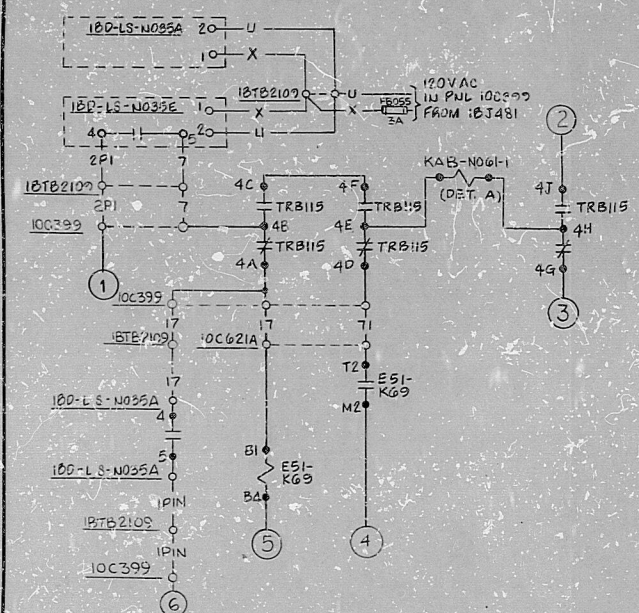

NO.	DATE	REVISIONS	BY	CHKD	DESIGN	ENGR	PROD	APPR
1	10/1/55	INCORP. SEC. E-1442	A	J	P	E		
2	10/1/55	INCORPORATED FOR E-50542	M	J	P	E		
3	10/1/55	REV'D FOR GE ECN NO. 103227	J	P	E			
4	10/1/55	REV'D FOR SUPPLY TO RELUS NO. 103227	J	P	E			
5	10/1/55	ADDED POWER SUPPLY TO RELUS NO. 103227	J	P	E			
6	10/1/55	REV'D AUX RELAY CONTACTS	J	P	E			
7	10/1/55	REVISED TO ADD LALL-NO61-1	J	P	E			
8	10/1/55	REV. PUSH TO TEST L.T.S. CH. 8 AS SHOWN DELETED UNIT - 2	J	P	E			
9	10/1/55	ADDED NOTE 7 & LIGHT TEST CONTACTS (CHANGED "5" TO "6")	J	P	E			
10	10/1/55	ISSUED FOR CONSTRUCTION	J	P	E			

SCALE: NONE

DESIGNED: R. LIENAU

DRAWN: [Signature]

BECHTEL
SAN FRANCISCO

PUBLIC SERVICE ELECTRIC AND GAS COMPANY
HOPE CREEK GENERATING STATION

ELECTRICAL SCHEMATIC DIAGRAM
RCIC SYSTEM
TURBINE MONITORING CKTS. IN RSP

JOB No.	DRAWING No.	REV.
10855	E-6089-0	7

22 x 34 1/2" SIZE

PDR RIDS

8602260459

