



CIRCULATING WATER PUMP HOUSE (BYRON)
NOTE: SAFETY CATEGORY E, QUALITY GROUP D

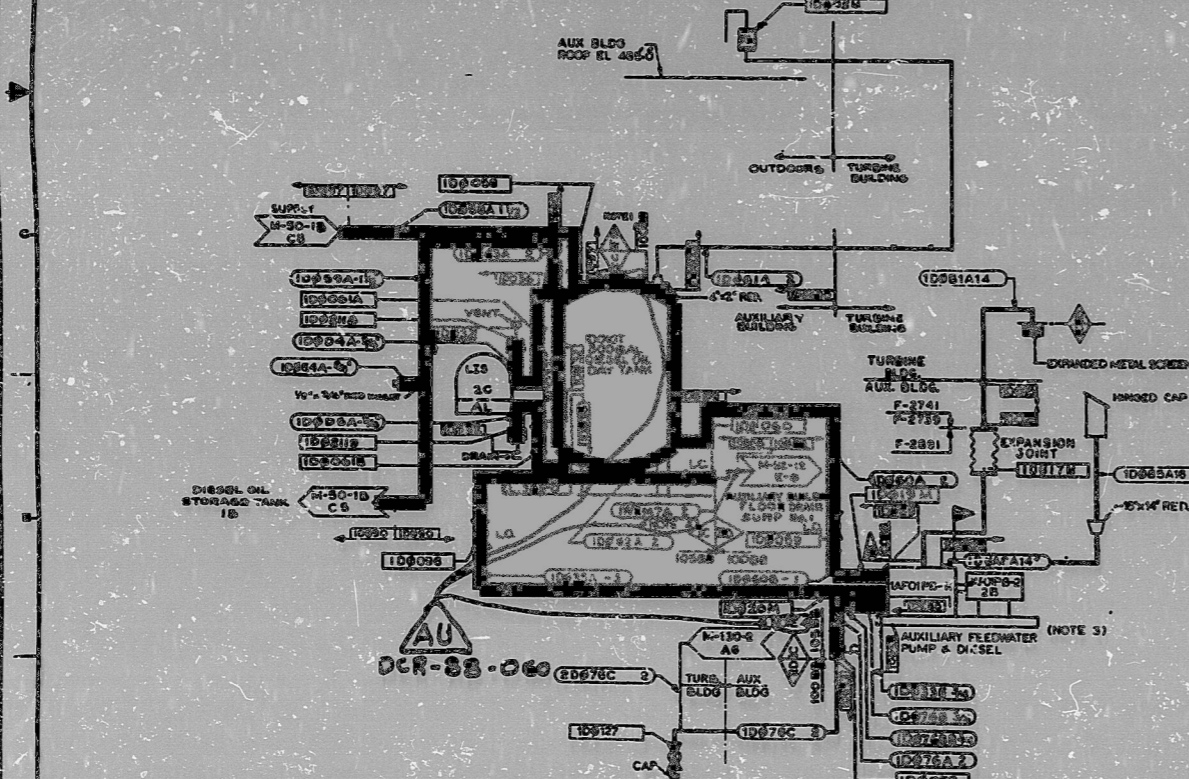

AU
DCR-88-060

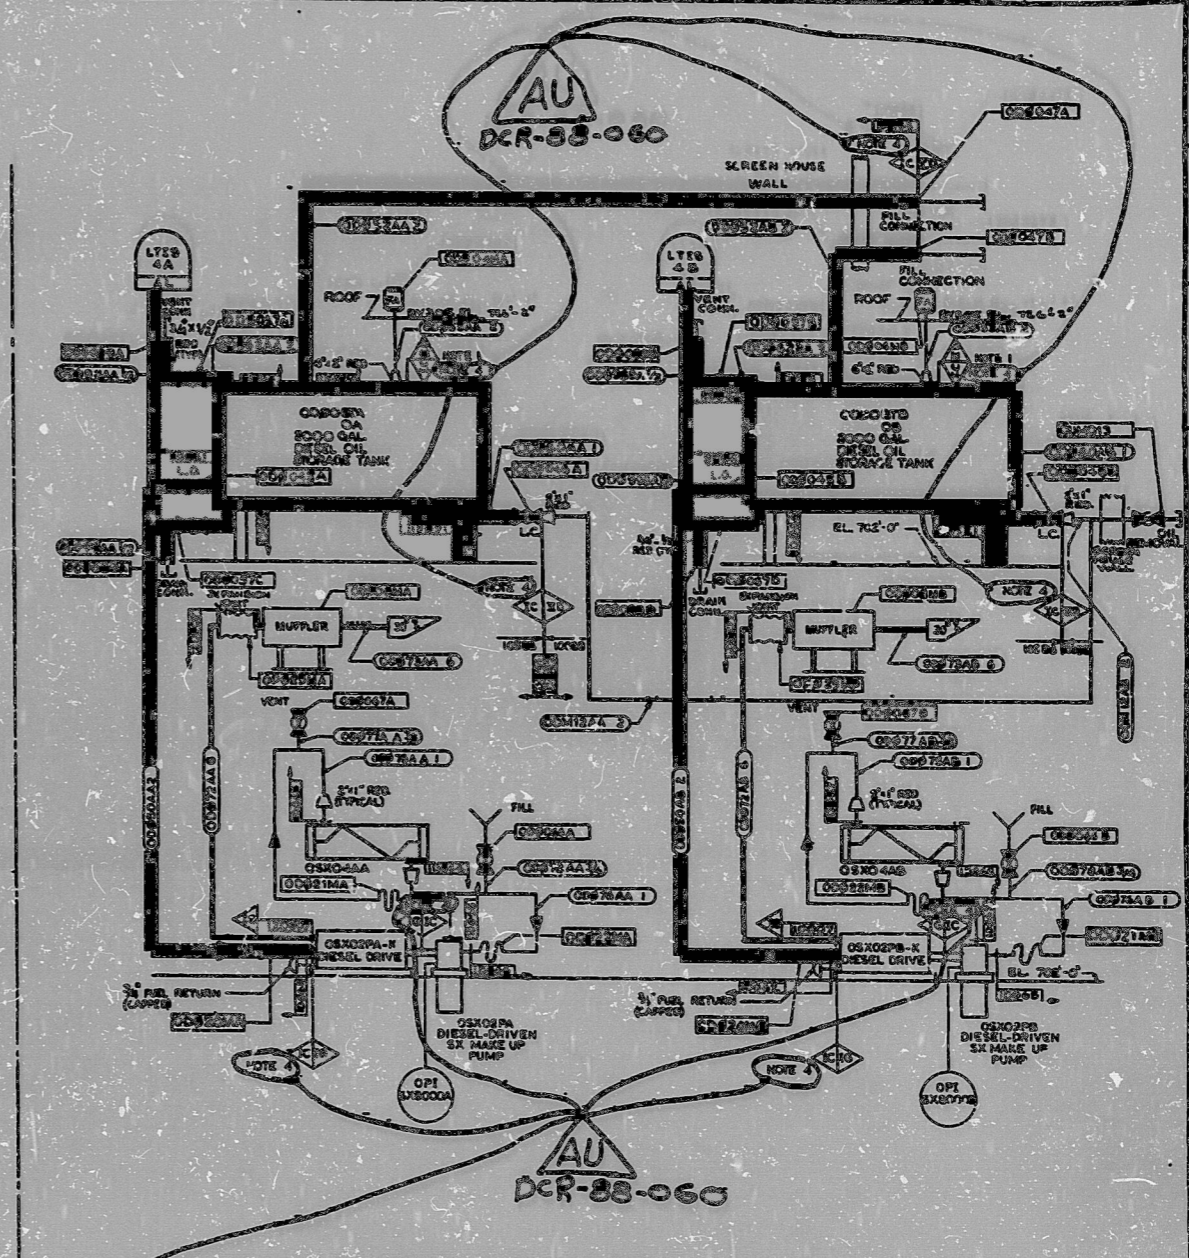

BYRON SCREEN HOUSE (BYRON)
NOTE: SAFETY CATEGORY E, QUALITY GROUP C UNLESS OTHERWISE NOTED

- NOTES:
1. CLASSIFICATION CHANGE TO BE MADE AT NOZZLE CONNECTION.
 2. ALL FILL CONNECTIONS TO TERMINATE OUTSIDE BUILDING AT CONVENIENT TRUCK LOAD POINT.
 3. PUMP (AFOPE) CLASSIFICATION IS 1C DIESEL DRIVE (AFOPE-A) CLASSIFICATION IS 1C.
 4. PIPING CLASSIFICATION ON THIS DRAWING REFERRED TO IS 1C UNLESS OTHERWISE NOTED.

ANSTEC APERTURE CARD

NUCLEAR SAFETY RELATED ITEMS ARE SHOWN ON THIS DRAWING (FOR SAFETY CLASSIFICATION SEE PUMP, EQUIPMENT, VALVE, OR INSTRUMENT LIST.)

REV	DATE	BY	CHKD	DESCRIPTION
1	12-21-87	J. J. [unclear]	[unclear]	ISSUED FOR CONSTRUCTION
2	01-28-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
3	02-25-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
4	03-23-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
5	04-20-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
6	05-18-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
7	06-15-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
8	07-13-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
9	08-10-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
10	09-07-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
11	10-05-88	J. J. [unclear]	[unclear]	REVISION TO PIPING
12	11-02-88	J. J. [unclear]	[unclear]	REVISION TO PIPING

ITEM NO.	DESCRIPTION	CLASSIFICATION	QUALITY GROUP
1	DIESEL OIL STORAGE TANK	1C	D
2	DIESEL DRIVEN FIRE PUMP	1C	D
3	DIESEL DRIVEN MAKE-UP PUMP	1C	D
4	PIPELINE	1C	D
5	VALVE	1C	D
6	EQUIPMENT	1C	D
7	INSTRUMENT	1C	D

DIAGRAM OF DIESEL FUEL OIL BYRON STATION UNITS 1 & 2
COMMERCIAL TRADING COMPANY
CHICAGO, ILLINOIS

MC

PDR RIDS

9603270236

