


AO
VERIFIED
SYS NO

19562

BILL OF MATERIAL									
MAT'L I.D.	QUANTITY	MATERIAL CLASS	TYP	ASME OR ASTM GRADE	DESCRIPTION	CONST.	SIZE	SCH.	LOT NO.
A 12 F1	1	B 55	SA192	TP-304	PIPE	FOR	8"	20	1111111111111111
B 1	1	B 55	SA192	TP-304	90° EL. (BW)	FOR	8"	20	1111111111111111
C 2	1	B 55	SA192	TP-304	TEE (BW)	FOR	8"	20	1111111111111111
D 1	1	B 55	SA192	TP-304	WALE COUPL. (BW)	FOR	1"	3000	1111111111111111
E 1	1	B 55	SA192	TP-304	WALE COUPL. (BW)	FOR	2"	3000	1111111111111111
F 1	1	B 55	SA192	TP-304	WALE COUPL. (BW)	FOR	8"x3"	20x20	1111111111111111
G 1	1	B 55	SA192	TP-304	WALE COUPL. (BW)	FOR	14"x8"	40x20	1111111111111111
H 2	1	B 55	SA192	TP-304	FLANGE (600#) (BW)	FOR	2"	20	1111111111111111
I 7	1	A 55	SA192	TP-304	GASKET (G-6)	FOR	8"	600#	1111111111111111
J 12	1	B 55	SA192	TP-304	STUDS (A-5)	FOR	1/8"x8"	3000	1111111111111111
K 24	1	B 55	SA192	TP-304	HEX NUTS (A-5)	FOR	1/8"	3000	1111111111111111
L 1	1	B 55	SA192	TP-304	IND. GASKET (WAT.)	FOR	8"	3000	1111111111111111
M 2	1	B 55	SA192	TP-304	FLANGE (600#) (BW)	FOR	8"	20	1111111111111111
N 2	1	A 55	SA192	TP-304	GASKET (G-6)	FOR	8"	600#	1111111111111111
P 2	1	A 55	SA192	TP-304	GASKET (G-6)	FOR	8"	600#	1111111111111111
R 14	1	B 55	SA192	TP-304	STUDS (A-5)	FOR	1/8"x8"	3000	1111111111111111
S 24	1	B 55	SA192	TP-304	HEX NUTS (A-5)	FOR	1/8"	3000	1111111111111111

FOR INFORMATION ONLY

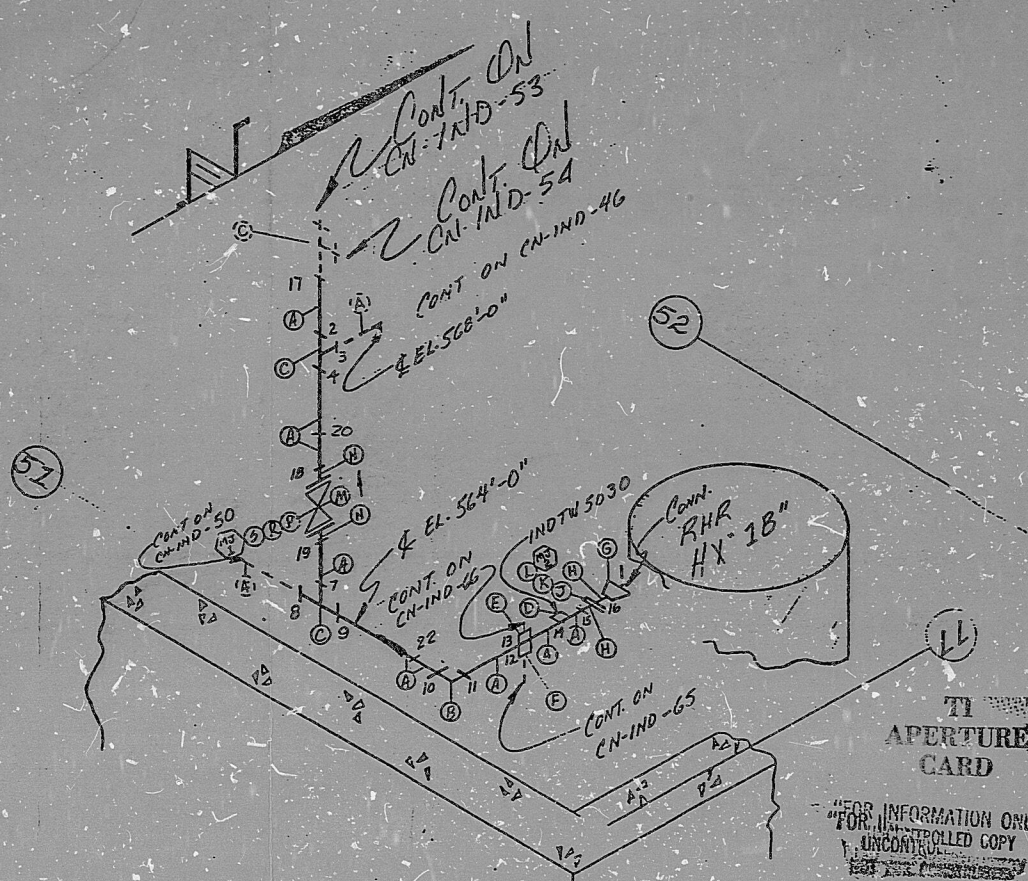

TI
APERTURE
CARD

FOR INFORMATION ONLY
UNCONTROLLED COPY

- NOTES:
- 1 ALL WELD NUMBERS SHALL BE PRECEDED BY IND 64-
 - 2 LAST WELD NO. 22
 - 3 REF. LAYOUT DWG. CN-1492-ND028/IN# 1352
 - 4 REF. FLOW DWG. 1561-1.1 (G-4)
 - 5 ALL MECH. JOINTS SHALL BE PRECEDED BY IND 64-

NO.	REVISION	DATE	NO.	REVISION	DATE
13	Rev. ID "H"	10-8-82	6	Rev. ID "H"	10-8-82
12	Rev. ID "H"	10-8-82	5	Rev. ID "H"	10-8-82
11	Rev. ID "H"	10-8-82	4	Rev. ID "H"	10-8-82
10	ADDED CONTINUATION	10-8-82	3	ADDED CONTINUATION	10-8-82
9	ADDED CONTINUATION	10-8-82	2	ADDED CONTINUATION	10-8-82
8	ADDED CONTINUATION	10-8-82	1	ADDED CONTINUATION	10-8-82
7	ADDED CONTINUATION	10-8-82	0	ADDED CONTINUATION	10-8-82

NUCLEAR SAFETY RELATED		NO.
DUKE POWER COMPANY		1
CATAMBA NUCLEAR STATION		1
TITLE		RESIDUAL HEAT REMOVAL SYSTEM
SYS. NO.		02
LINE NO.		02
PIPE SPEC.		601.2
LOCATION		AP. 2.06 (A-50)
DWG. NO.		CN-IND-64
REV. NO.		13

PDR RIDS

8809070114

