


OPERATING DATA

| NO. | FLOW (SCFH) | PRESS (PSIG) | TEMP (°F) |
|-----|-------------|--------------|-----------|
| 1 | 2000 | 150 | 270 |
| 2 | 150 | 25 | 50 |
| 3 | 40 | 25 | 50 |
| 4 | 250 | 25 | 50 |
| 5 | 700 | 1 | 150 |
| 6 | 5000 | 0 | 260 |
| 7 | 700 | 0 | 260 |

DESIGN DATA

| NO. | NORMAL PRESS (PSIG) | TRANSIENT PRESS (PSIG) | TEMP (°F) |
|-----|---------------------|------------------------|-----------|
| 1 | 55 | 300 | 90 |
| 2 | 6" | 300 | 90 |

- NOTES:
- HEAVY LINES INDICATE PRIMARY SAMPLE PATH.
 - TUBING TO BE SERIES 308 STAINLESS STEEL.
 - HYDROGEN DETECTOR CONSIDER INSTRUMENT SYSTEMS DIVISION MODEL K-111.
 - LINES DOES NOT PASS THRU HOT BOX.
 - INSTRUMENT TAGS MARKED WITH AN (A) ARE CONSIDER TAG NUMBERS USED FOR COMPARISON WITH VENDOR DRAWINGS.
 - THREE (3) LOGIC SIGNALS ARE WIRED TO ILLUMINATE THREE (3) LIGHTS ON PANEL C-162.
 - A. SV-2412 A & B & SV-2414 A & B OPEN.
 - B. SV-2424 A & B OPEN.
 - SV-2412 A & B & SV-2414 A & B & SV-2424 A & B CLOSED.

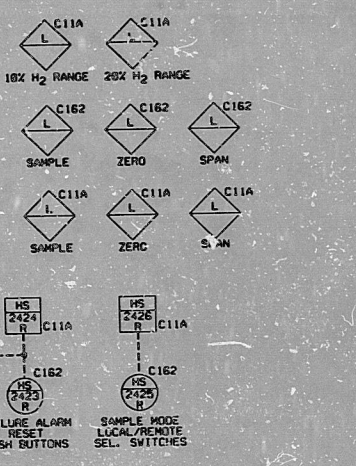

ANSTEC APERTURE CARD

| | | | | |
|--|------|---------------------------------------|-------------|-----|
| 16 | G-14 | MODED LC OF MOD 200A & D AND 531A & B | 100 | PLD |
| 17 | 16 | PER C-104-14-07810 & 100-10-422 | 100 | PLD |
| DATE | NO. | ISSUED | BY | CHK |
| | | | P. G. BROWN | |
| PALISADES PLANT CONSUMERS POWER COMPANY | | | | |
| M224-2.DGN | | | | |
| PIPING & INSTRUMENT DIAGRAM FSD-CONTAINMENT HYDROGEN MONITORING SYSTEM | | | | |
| SYMBOL | NO. | DESCRIPTION | REV. | |
| (Symbol) | 0950 | M-224 SH. 2 | 16 | |

9603290125

PDR RIDS

