



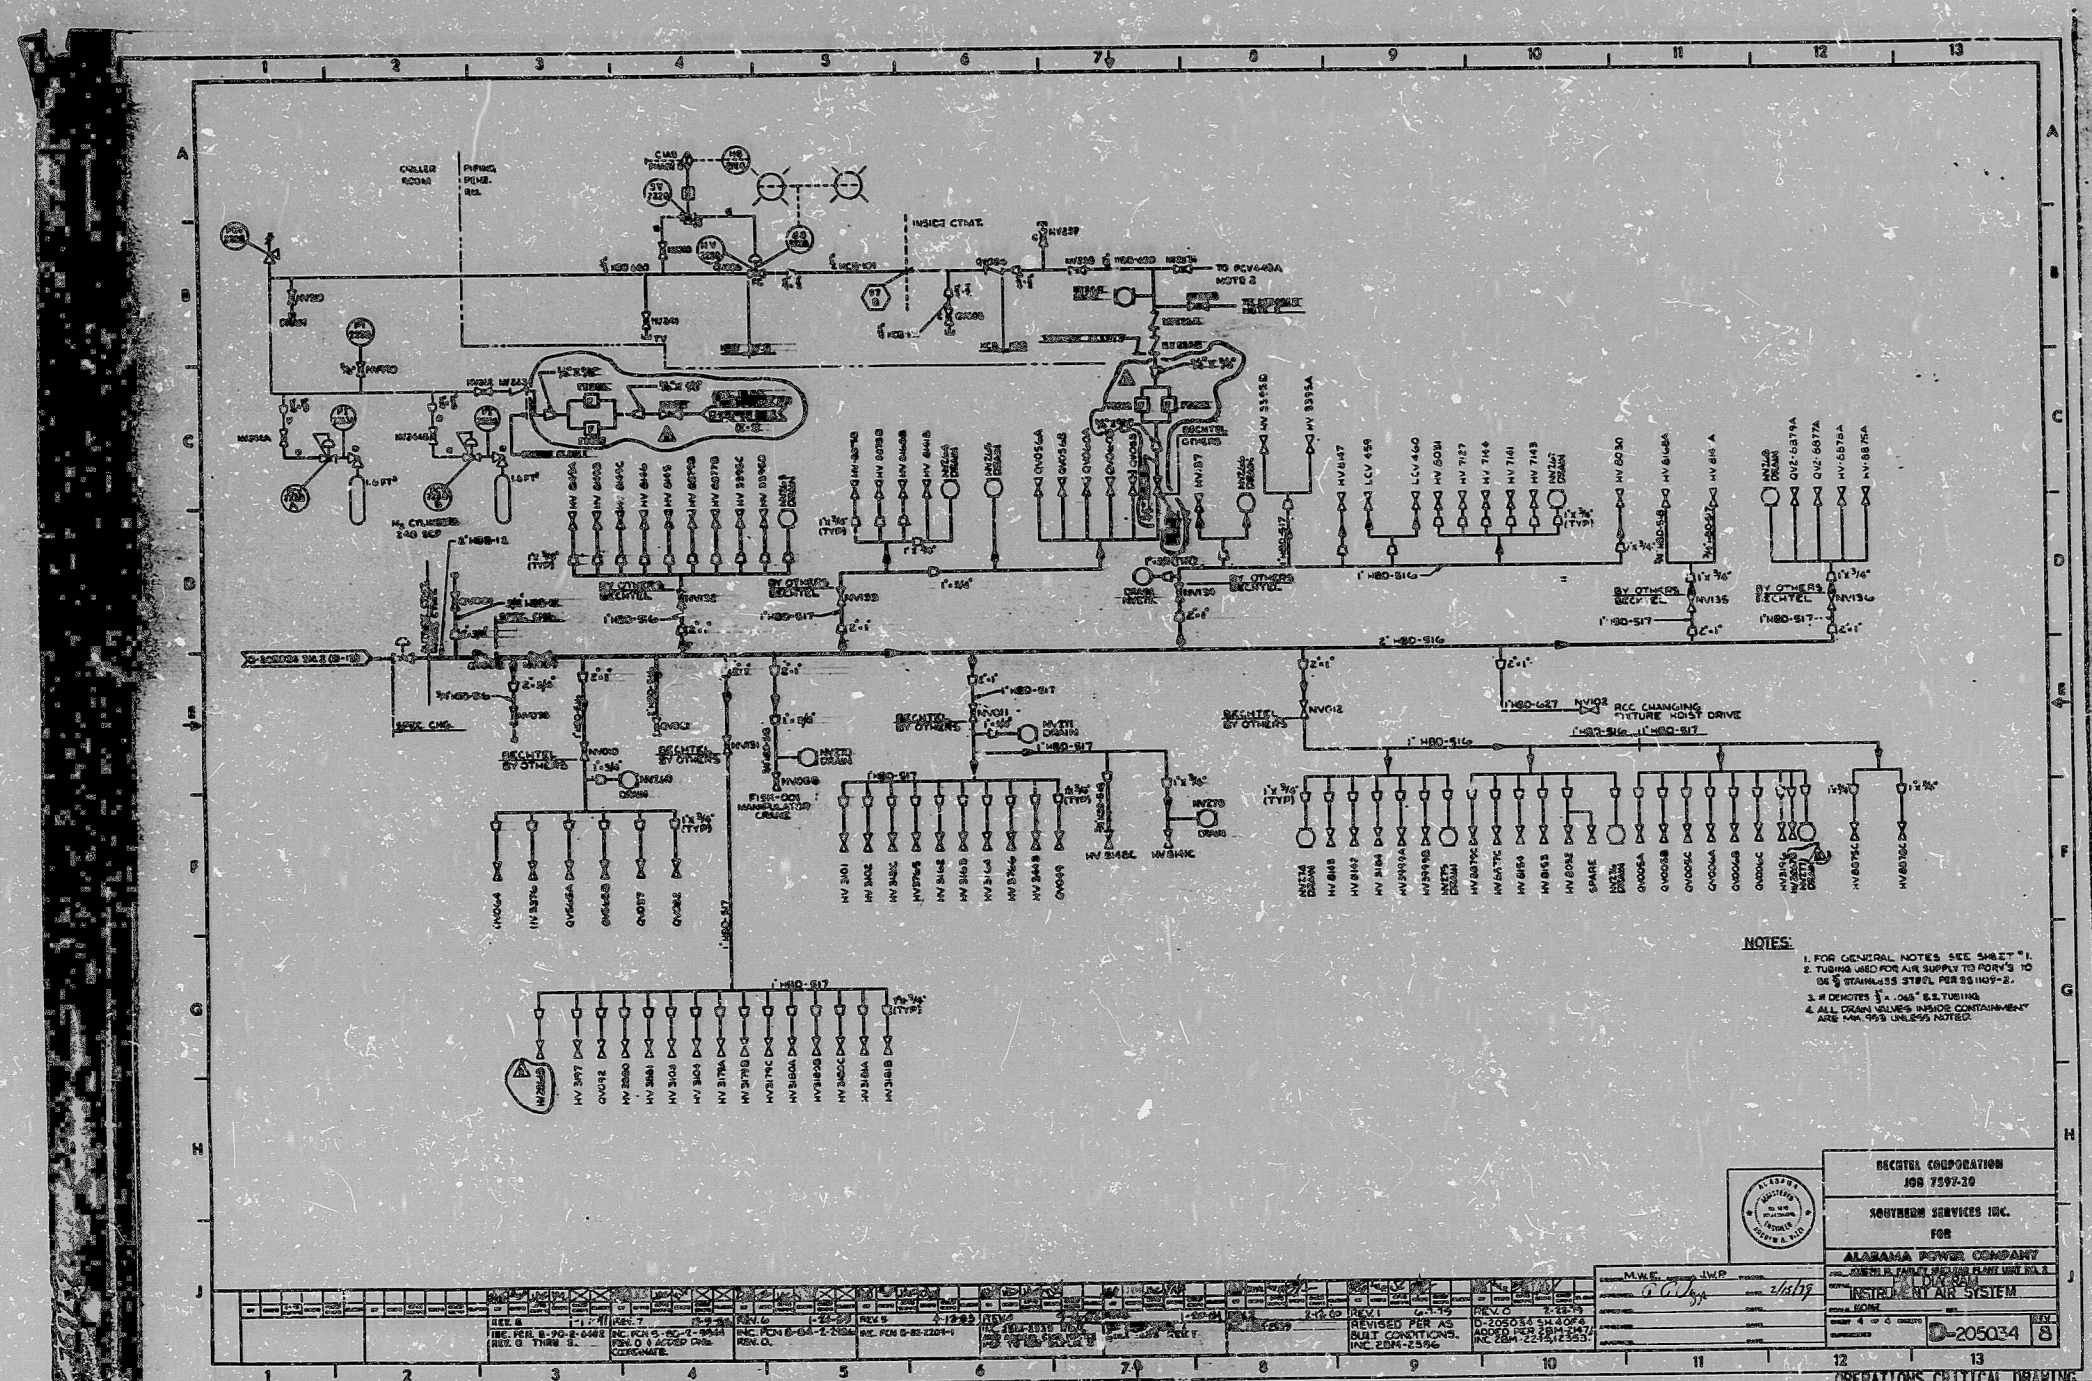

NOTES:
1. FOR GENERAL NOTES SEE SHEET "1".
2. TUBING AND FOR AIR SUPPLY TO TOWER IS OF STAINLESS STEEL PER SPECIFICATION.
3. ALL DIMENSIONS ARE IN INCHES UNLESS NOTED OTHERWISE.

ANSTEC
APERTURE
CARD



RECEIVED CORPORATION
JOB 7597-20
SOUTHERN SERVICES INC.
FOR
ALABAMA POWER COMPANY
OPERATIONS DIVISION
INSTALLED BY AIR SYSTEM
DATE 10/1/55
BY 205034
REV 8

1. I certify that this drawing was prepared by me or under my direct supervision and that I am a duly licensed professional engineer in the State of Alabama.
DATE 10/1/55 BY 205034

PDR RIDS

9605200406

