


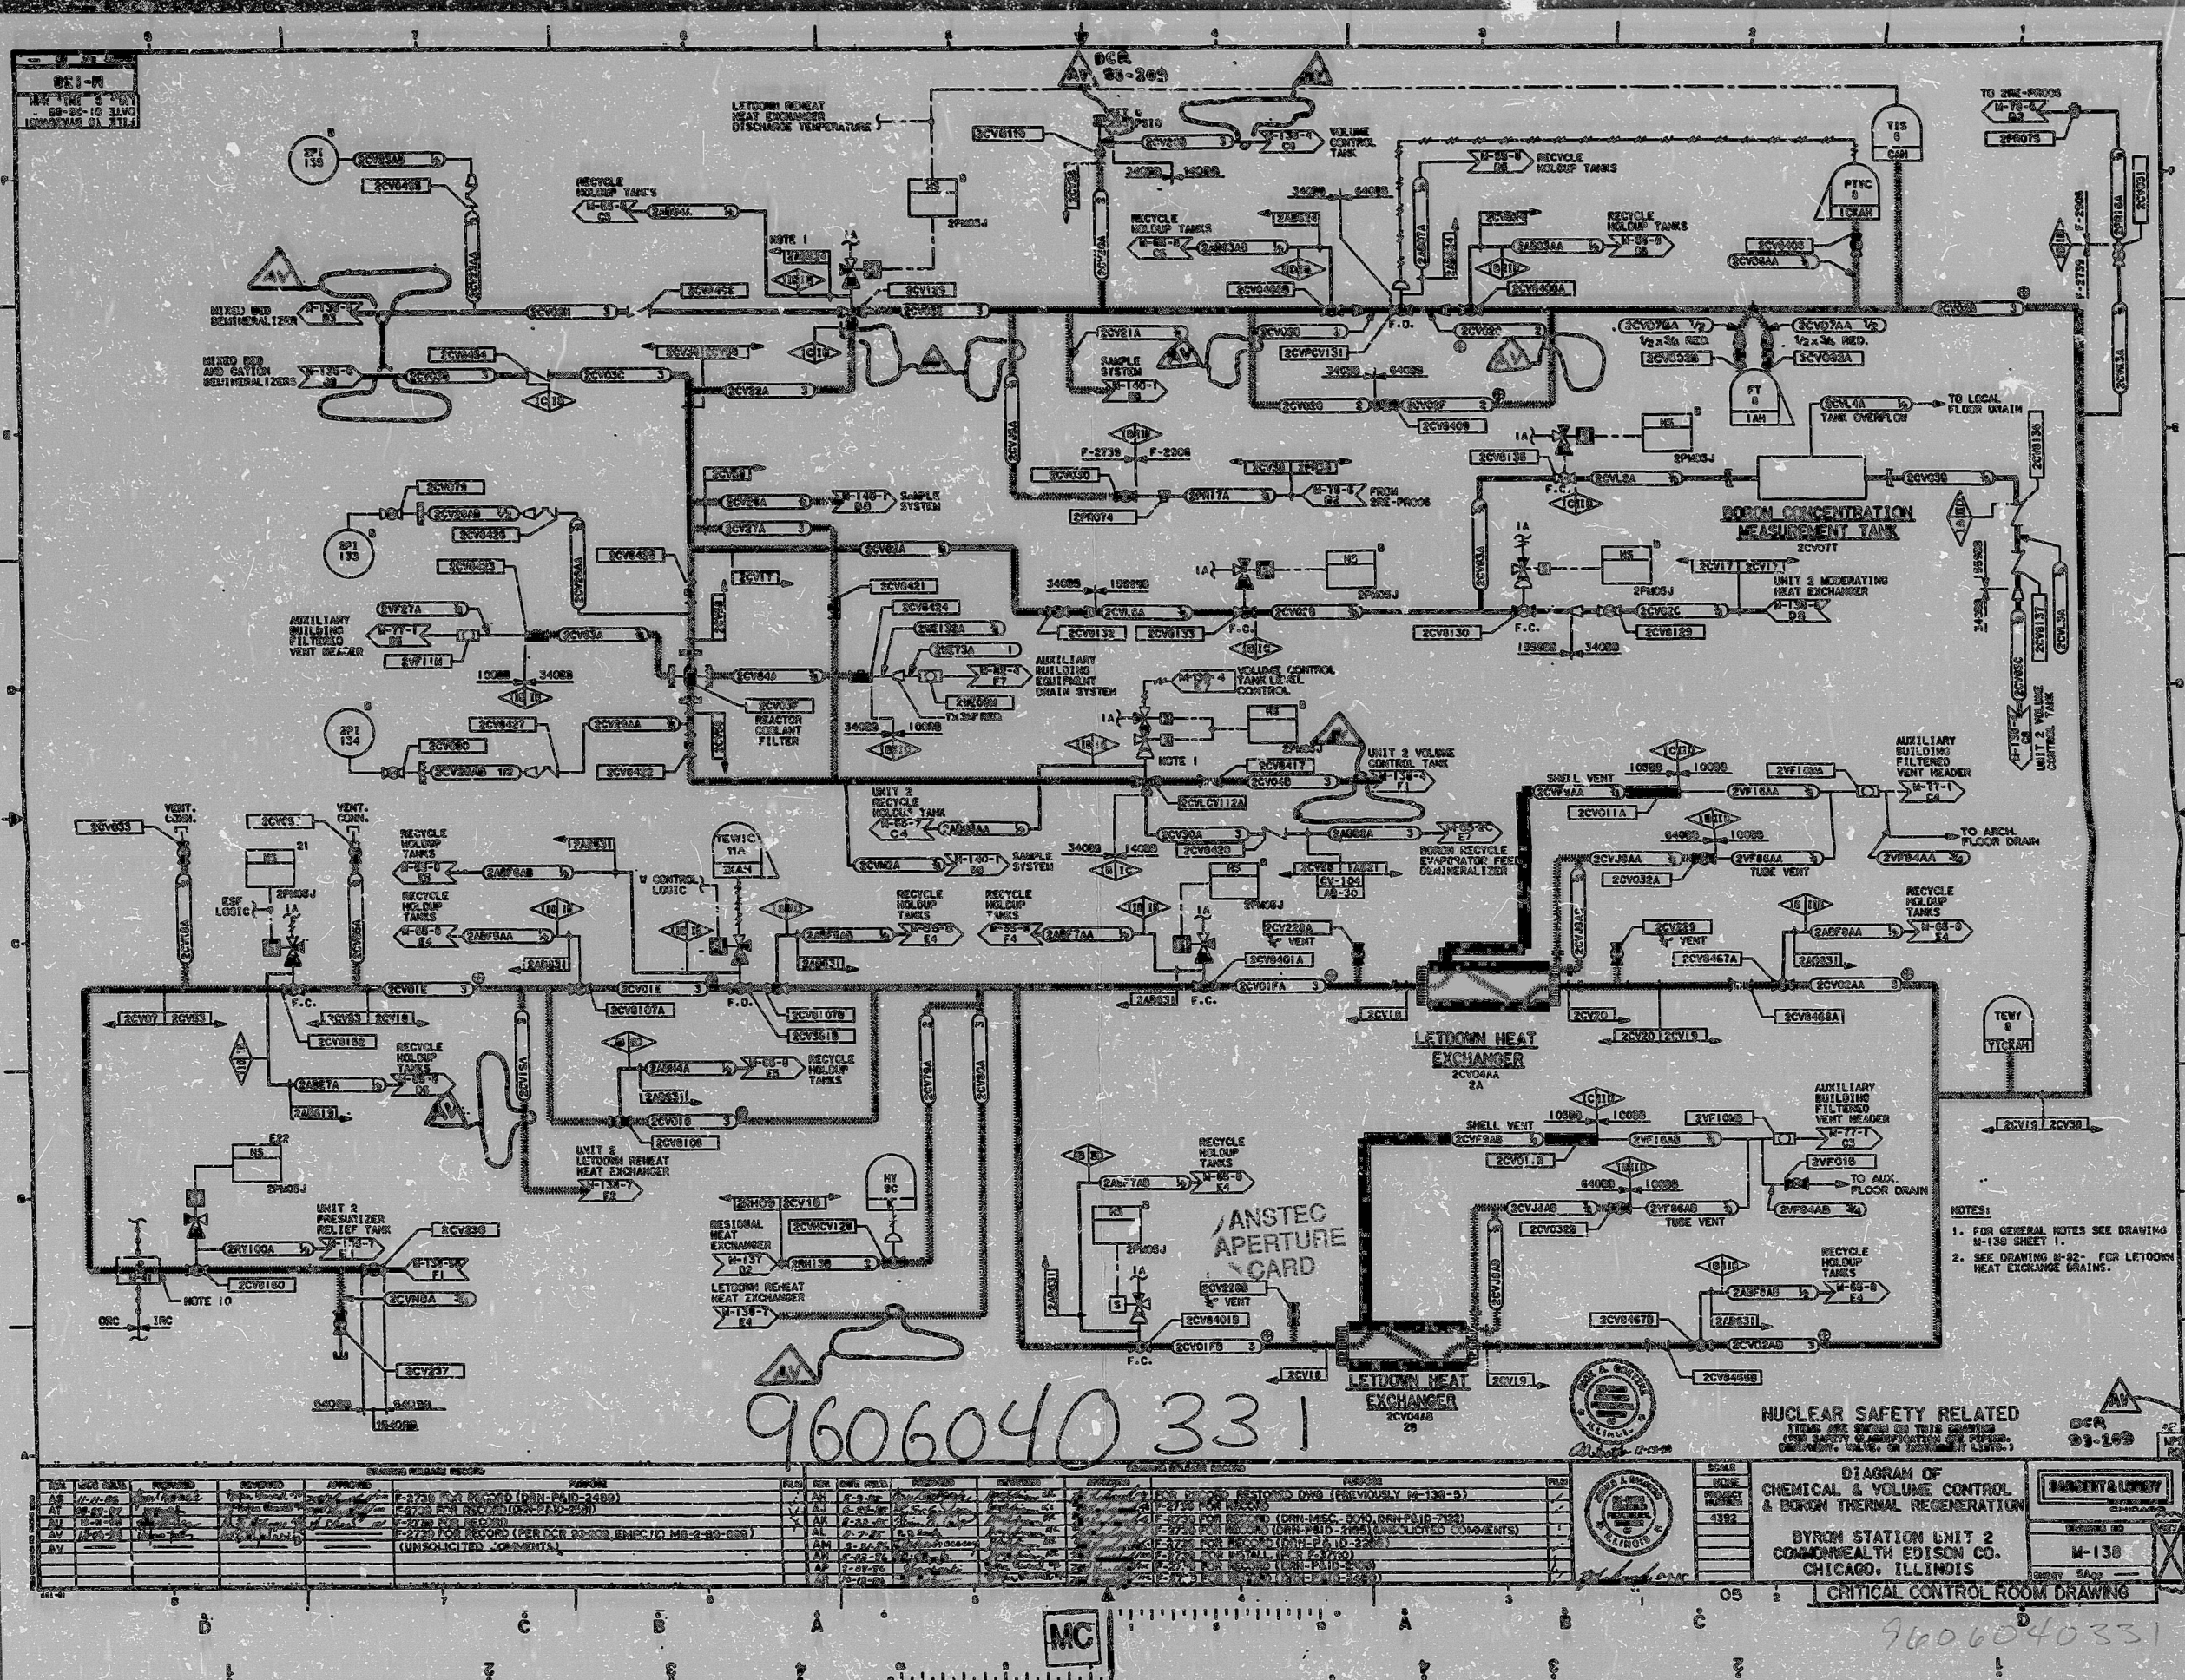

ITEM	DATE	REVISION	APPROVED	REASON
1	10-1-68	1	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
2	10-1-68	2	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
3	10-1-68	3	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
4	10-1-68	4	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
5	10-1-68	5	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
6	10-1-68	6	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
7	10-1-68	7	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
8	10-1-68	8	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
9	10-1-68	9	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)
10	10-1-68	10	W. J. MCGEE	FOR RECORD (DNR-PAD-2480)

NUCLEAR SAFETY RELATED
ITEMS ARE SHOWN ON THIS DRAWING
FOR SAFETY RELATED REASONS ONLY
DO NOT REMOVE OR ALTER THESE ITEMS

DIAGRAM OF
CHEMICAL & VOLUME CONTROL
& BORON THERMAL REGULATION
BYRON STATION UNIT 2
COMMONWEALTH EDISON CO.
CHICAGO, ILLINOIS

9606040 331
M-130
CRITICAL CONTROL ROOM DRAWING

PDR RIDS

9606040331

