
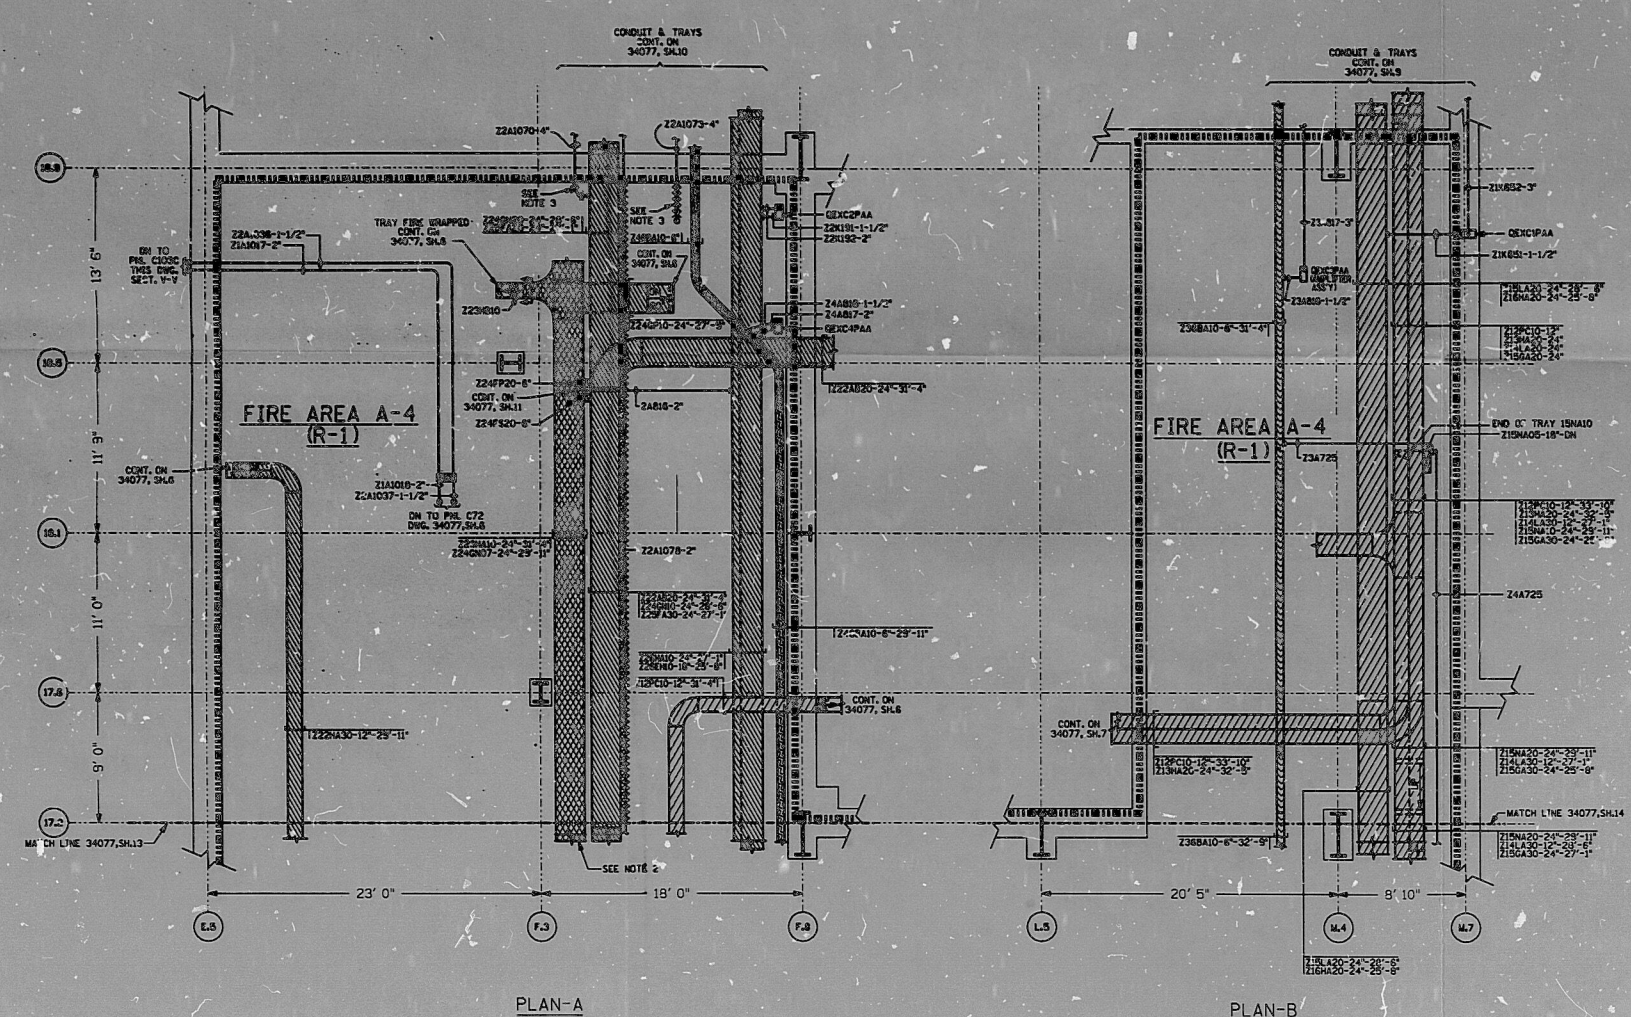


- NOTES**
1. FOR FIRE WRAP CODE AND RATING SEE
NORTH EAST UTILITIES SERVICE CO. FIRE WRAP
DESCRIPTION REPORT.
 2. IN LIEU OF WRAPPING THE ENTIRE TRAYS OF
Z23010 AND Z23010A, ONLY CABLES Z23010/A
AND Z23010/B ARE FIRE WRAPPED.
 3. CONDUITS Z2A1070 AND Z2A1073
ARE FIRE WRAPPED WITHIN FIRE AREA A-4.

REFERENCE DRAWINGS:

25203-34033
25203-34036
25203-23378

- SYMBOLS**
- Z1 TRAY CONTAINING CABLES
PERTAINING TO EQUIPMENT FOR
SAFE SHUTDOWN
 - Z2 TRAY CONTAINING CABLES
PERTAINING TO EQUIPMENT FOR
SAFE SHUTDOWN
 - Z3 TRAY CONTAINING CABLES
PERTAINING TO EQUIPMENT FOR
SAFE SHUTDOWN
 - Z4 TRAY CONTAINING CABLES
PERTAINING TO EQUIPMENT FOR
SAFE SHUTDOWN
 - Z5 TRAY CONTAINING CABLES
PERTAINING TO EQUIPMENT FOR
SAFE SHUTDOWN
 - TRAY FIRE WRAPPED
 - CONDUIT FIRE WRAPPED
 - FIRE AREA APPROX. "B" BARRIERS

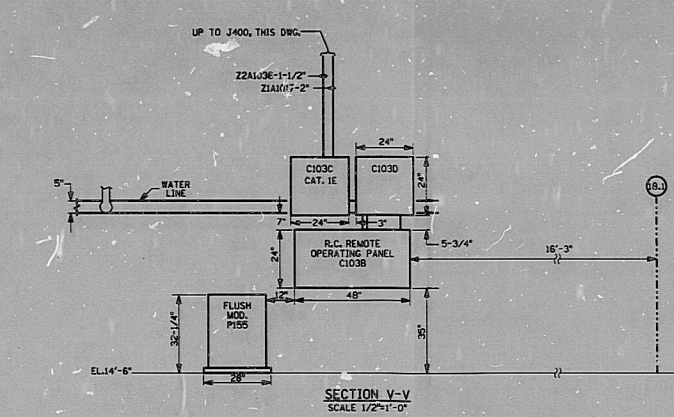

**TI
APERTURE
CARD**

C.A.D.		MP2 APPENDIX "B" SHUTDOWN SYSTEM STUDY	
REVISIONS DURING CONSTRUCTION		P.A.C. 80-243	
REVISIONS DURING CONSTRUCTION		ISSUE FOR APPROVAL	
NORTH EAST UTILITIES SERVICE CO.		FOR	
NORTH EAST NUCLEAR ENERGY CO.		MILLSTONE NUCLEAR POWER STATION UNIT NO.2	
APPENDIX "B"		ELECTRICAL TRAY AND CONDUIT PLAN	
CABLE VAULT, CENTR. AREAS EL. 25'-6"		WATERFORD, CT.	
DATE	DATE	DATE	DATE
5/20/86	5/20/86	5/20/86	5/20/86
SCALE	SCALE	SCALE	SCALE
1/4"=1'-0"	1/4"=1'-0"	1/4"=1'-0"	1/4"=1'-0"
BY	BY	BY	BY
CHL	CHL	CHL	CHL
80-243	80-243	80-243	80-243
25203-34077, SH.15			

8706220293

PDR RIDS

8706220293

