


DWG. NO. OFD-137A-1.1

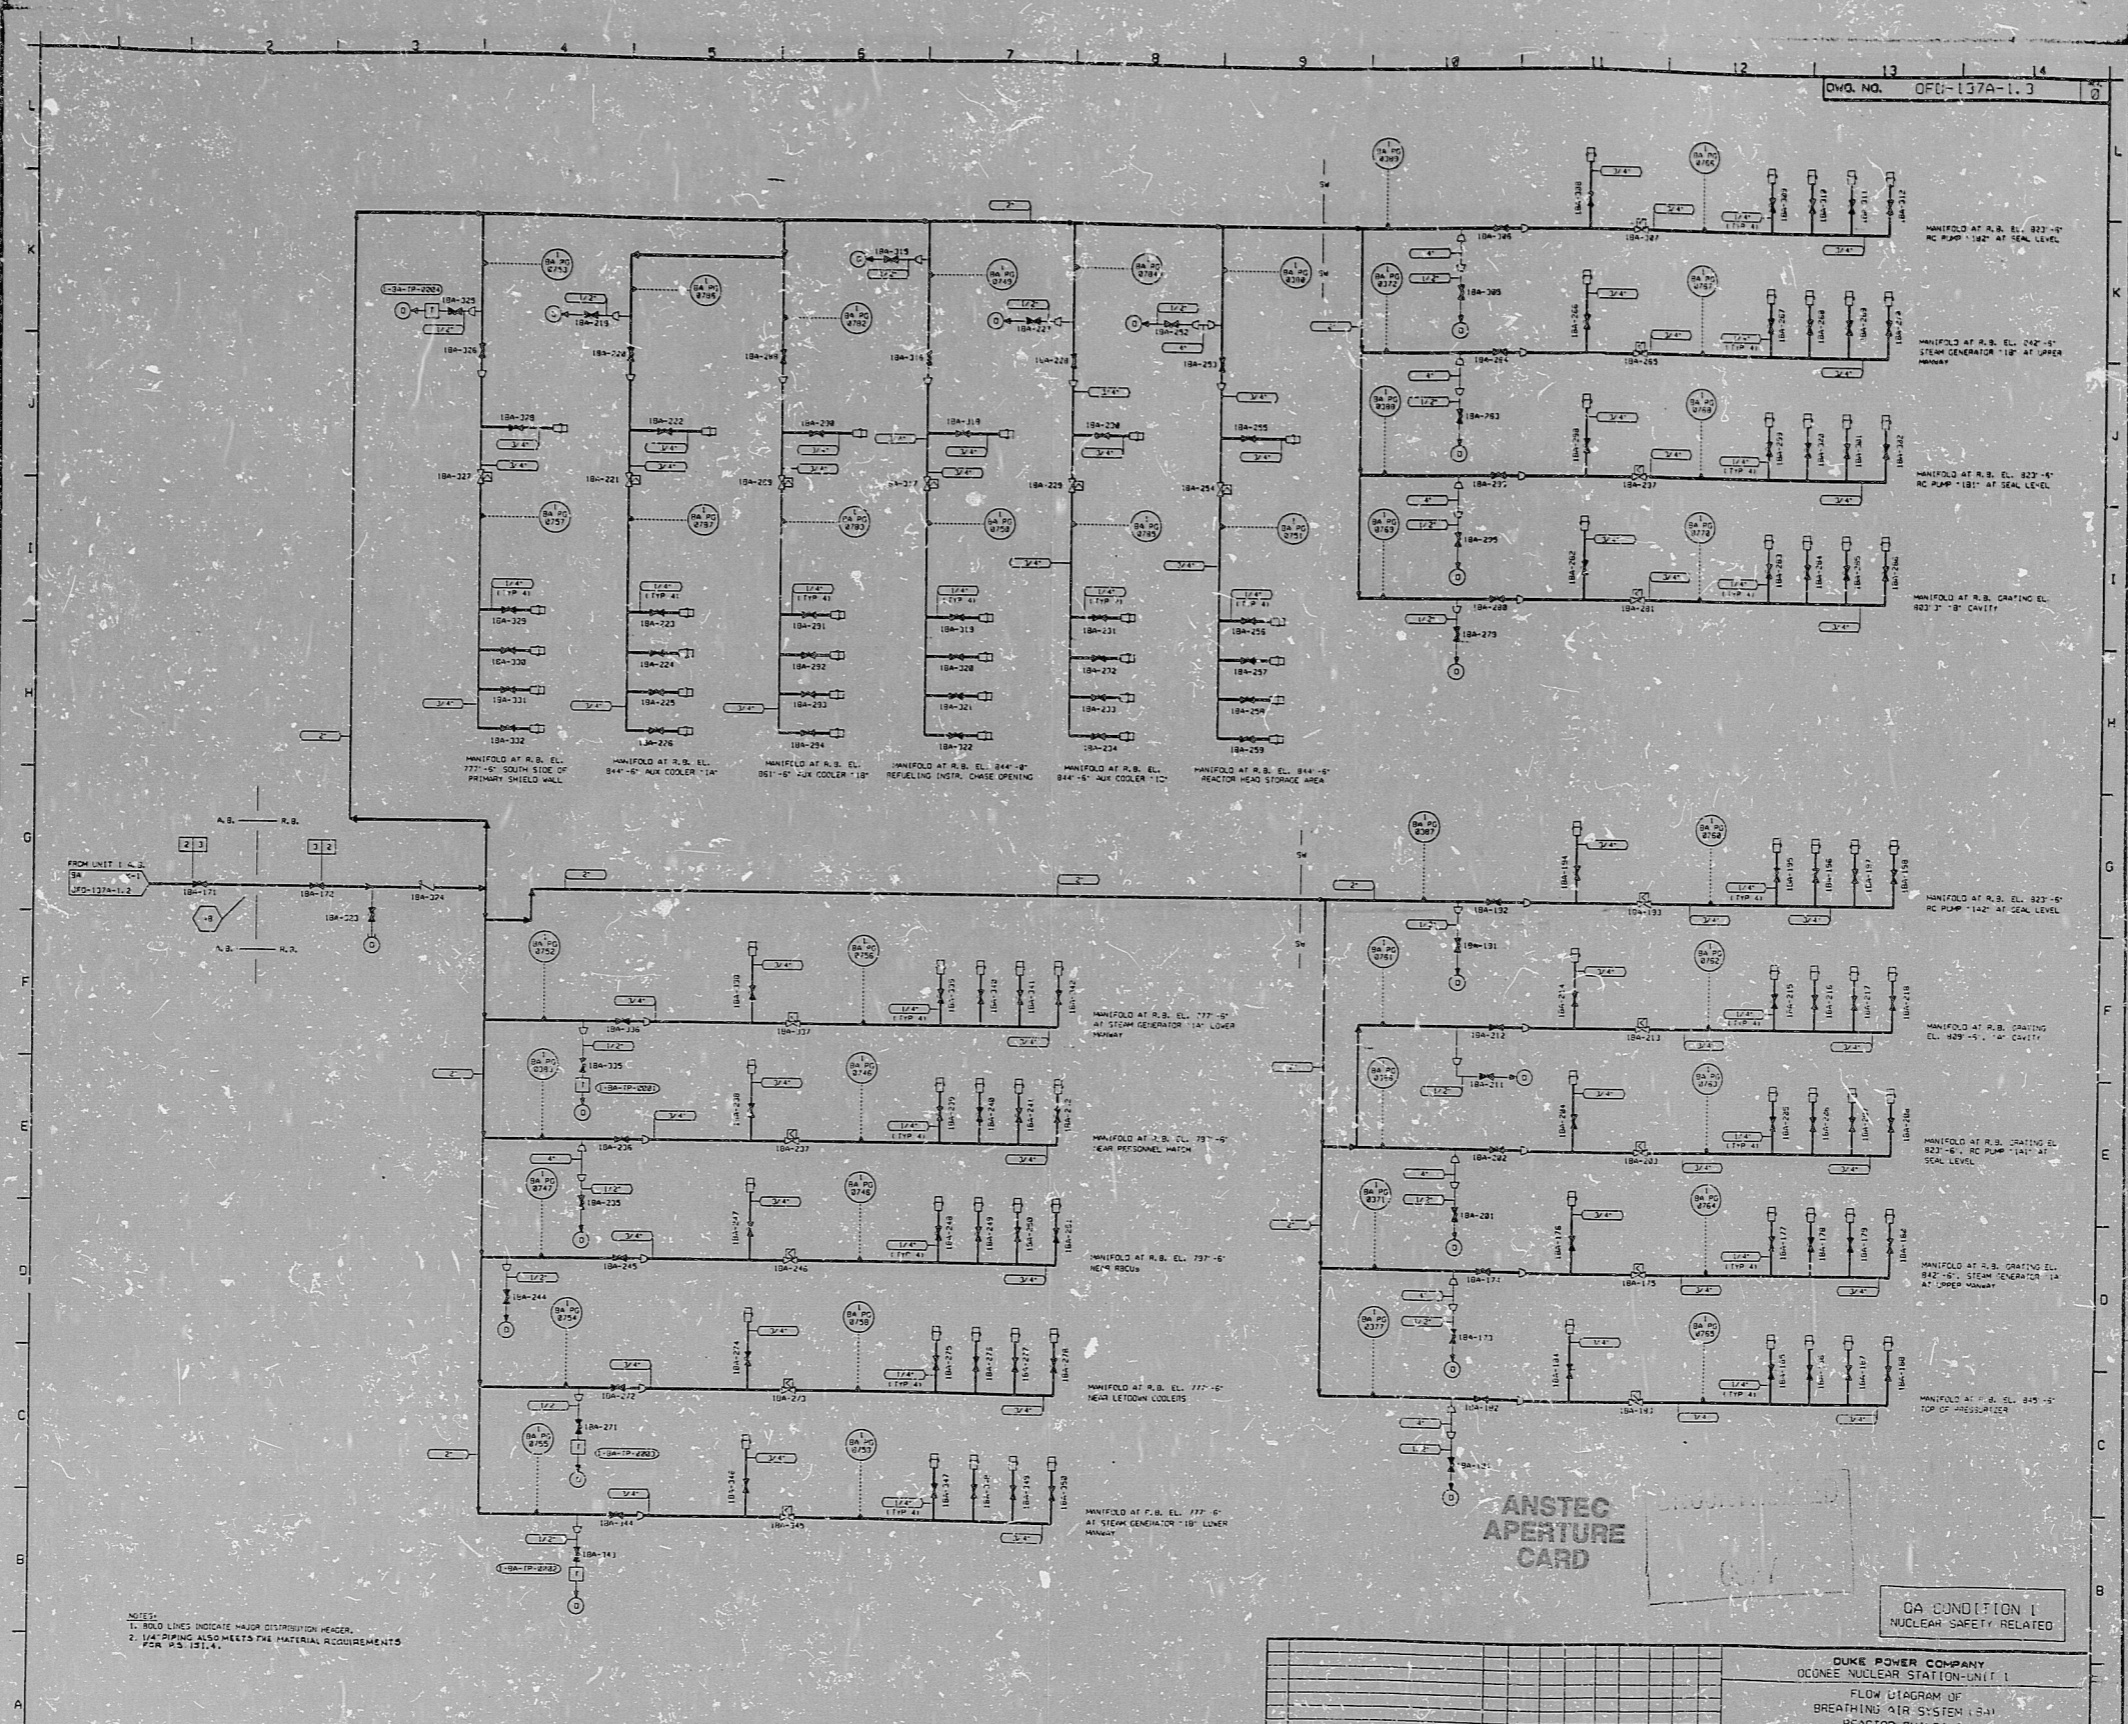

NOTE:
 1. SOLID LINES INDICATE MAJOR DISTRIBUTION HEADERS.
 2. DASHED LINES ALSO MEETS THE MATERIAL REQUIREMENTS FOR P.S. 131.4.

ANSTEC APERTURE CARD

GA CONDITION I
 NUCLEAR SAFETY RELATED

NO.	REVISIONS	DATE	BY	CHKD	APPV
1					
2					
3					

DUKE POWER COMPANY
 DODDNER NUCLEAR STATION - UNIT 1
 FLOW DIAGRAM OF
 BREATHING AIR SYSTEM (SAS)
 REACTOR BUILDING
 (AIR MANIFOLDS)

DESIGNED BY: [Signature] DATE: 10/1/62
 DRAWN BY: [Signature] DATE: 10/1/62
 CHECKED BY: [Signature] DATE: 10/1/62
 APPROVED BY: [Signature] DATE: 10/1/62

LINE NO.	PIPE CLASS.	DESIGN PRESS.	ORIGIN TEMP.	MATERIAL	W.P.E.	PIPE SPEC.	W.P.	W.P. CLASS.
1	1"	150 PSI	100 F	316 SS	100	100	100	100
2	1/2"	150 PSI	100 F	316 SS	100	100	100	100
3	1/2"	150 PSI	100 F	316 SS	100	100	100	100

PDR RIDS

9607120053

