


G-191176 SN 1

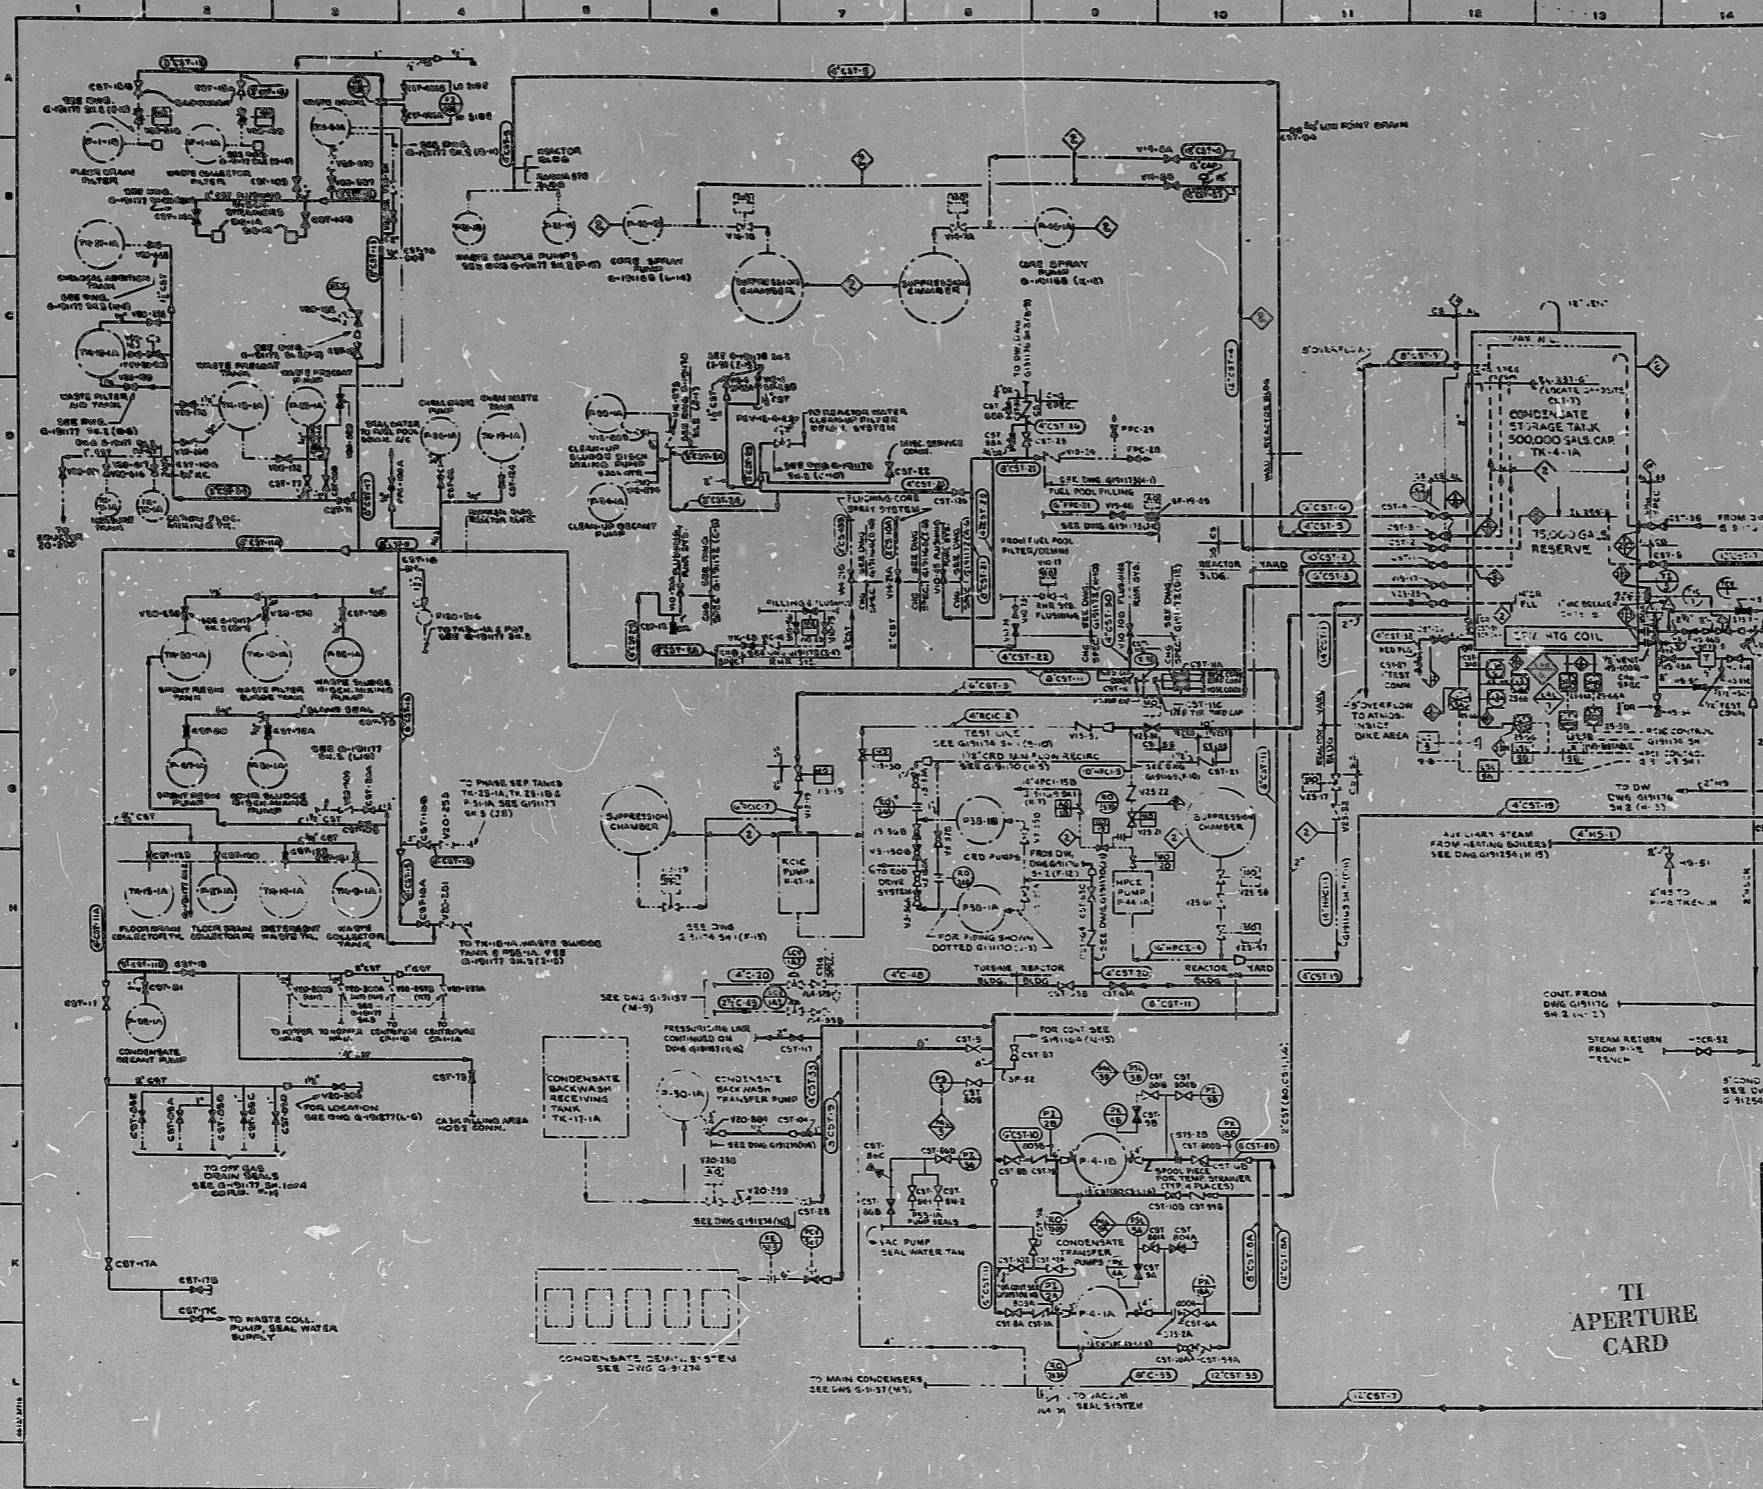

NO. THE LIST

NO.	DESCRIPTION	QTY	UNIT
1	CONDENSATE RECEIVING TANK	1	EA
2	CONDENSATE TRANSFER PUMP	1	EA
3	CONDENSATE BACKWASH RECEIVING TANK	1	EA
4	CONDENSATE BACKWASH TRANSFER PUMP	1	EA
5	CONDENSATE CLEANING SYSTEM	1	EA
6	CONDENSATE RECEIVING TANK	1	EA
7	CONDENSATE TRANSFER PUMP	1	EA
8	CONDENSATE BACKWASH RECEIVING TANK	1	EA
9	CONDENSATE BACKWASH TRANSFER PUMP	1	EA
10	CONDENSATE CLEANING SYSTEM	1	EA

REFERENCE DRAWINGS:

- CONDENSATE RECEIVING TANK
- CONDENSATE TRANSFER PUMP
- CONDENSATE BACKWASH RECEIVING TANK
- CONDENSATE BACKWASH TRANSFER PUMP
- CONDENSATE CLEANING SYSTEM
- CONDENSATE RECEIVING TANK
- CONDENSATE TRANSFER PUMP
- CONDENSATE BACKWASH RECEIVING TANK
- CONDENSATE BACKWASH TRANSFER PUMP
- CONDENSATE CLEANING SYSTEM

24	CONDENSATE RECEIVING TANK	1	EA
25	CONDENSATE TRANSFER PUMP	1	EA

YANKEE ATOMIC ELECTRIC COMPANY
 VERMONT VALLEY NUCLEAR POWER CORPORATION
 FLOW DIAGRAM - CONDENSATE
 DECONTAMINATED WATER TRANSFER SYSTEM

TI APERTURE CARD

UNCONTROLLED COPY FOR INFORMATION ONLY

PDR RIDS

8707140145

