


12177-PID-1-3

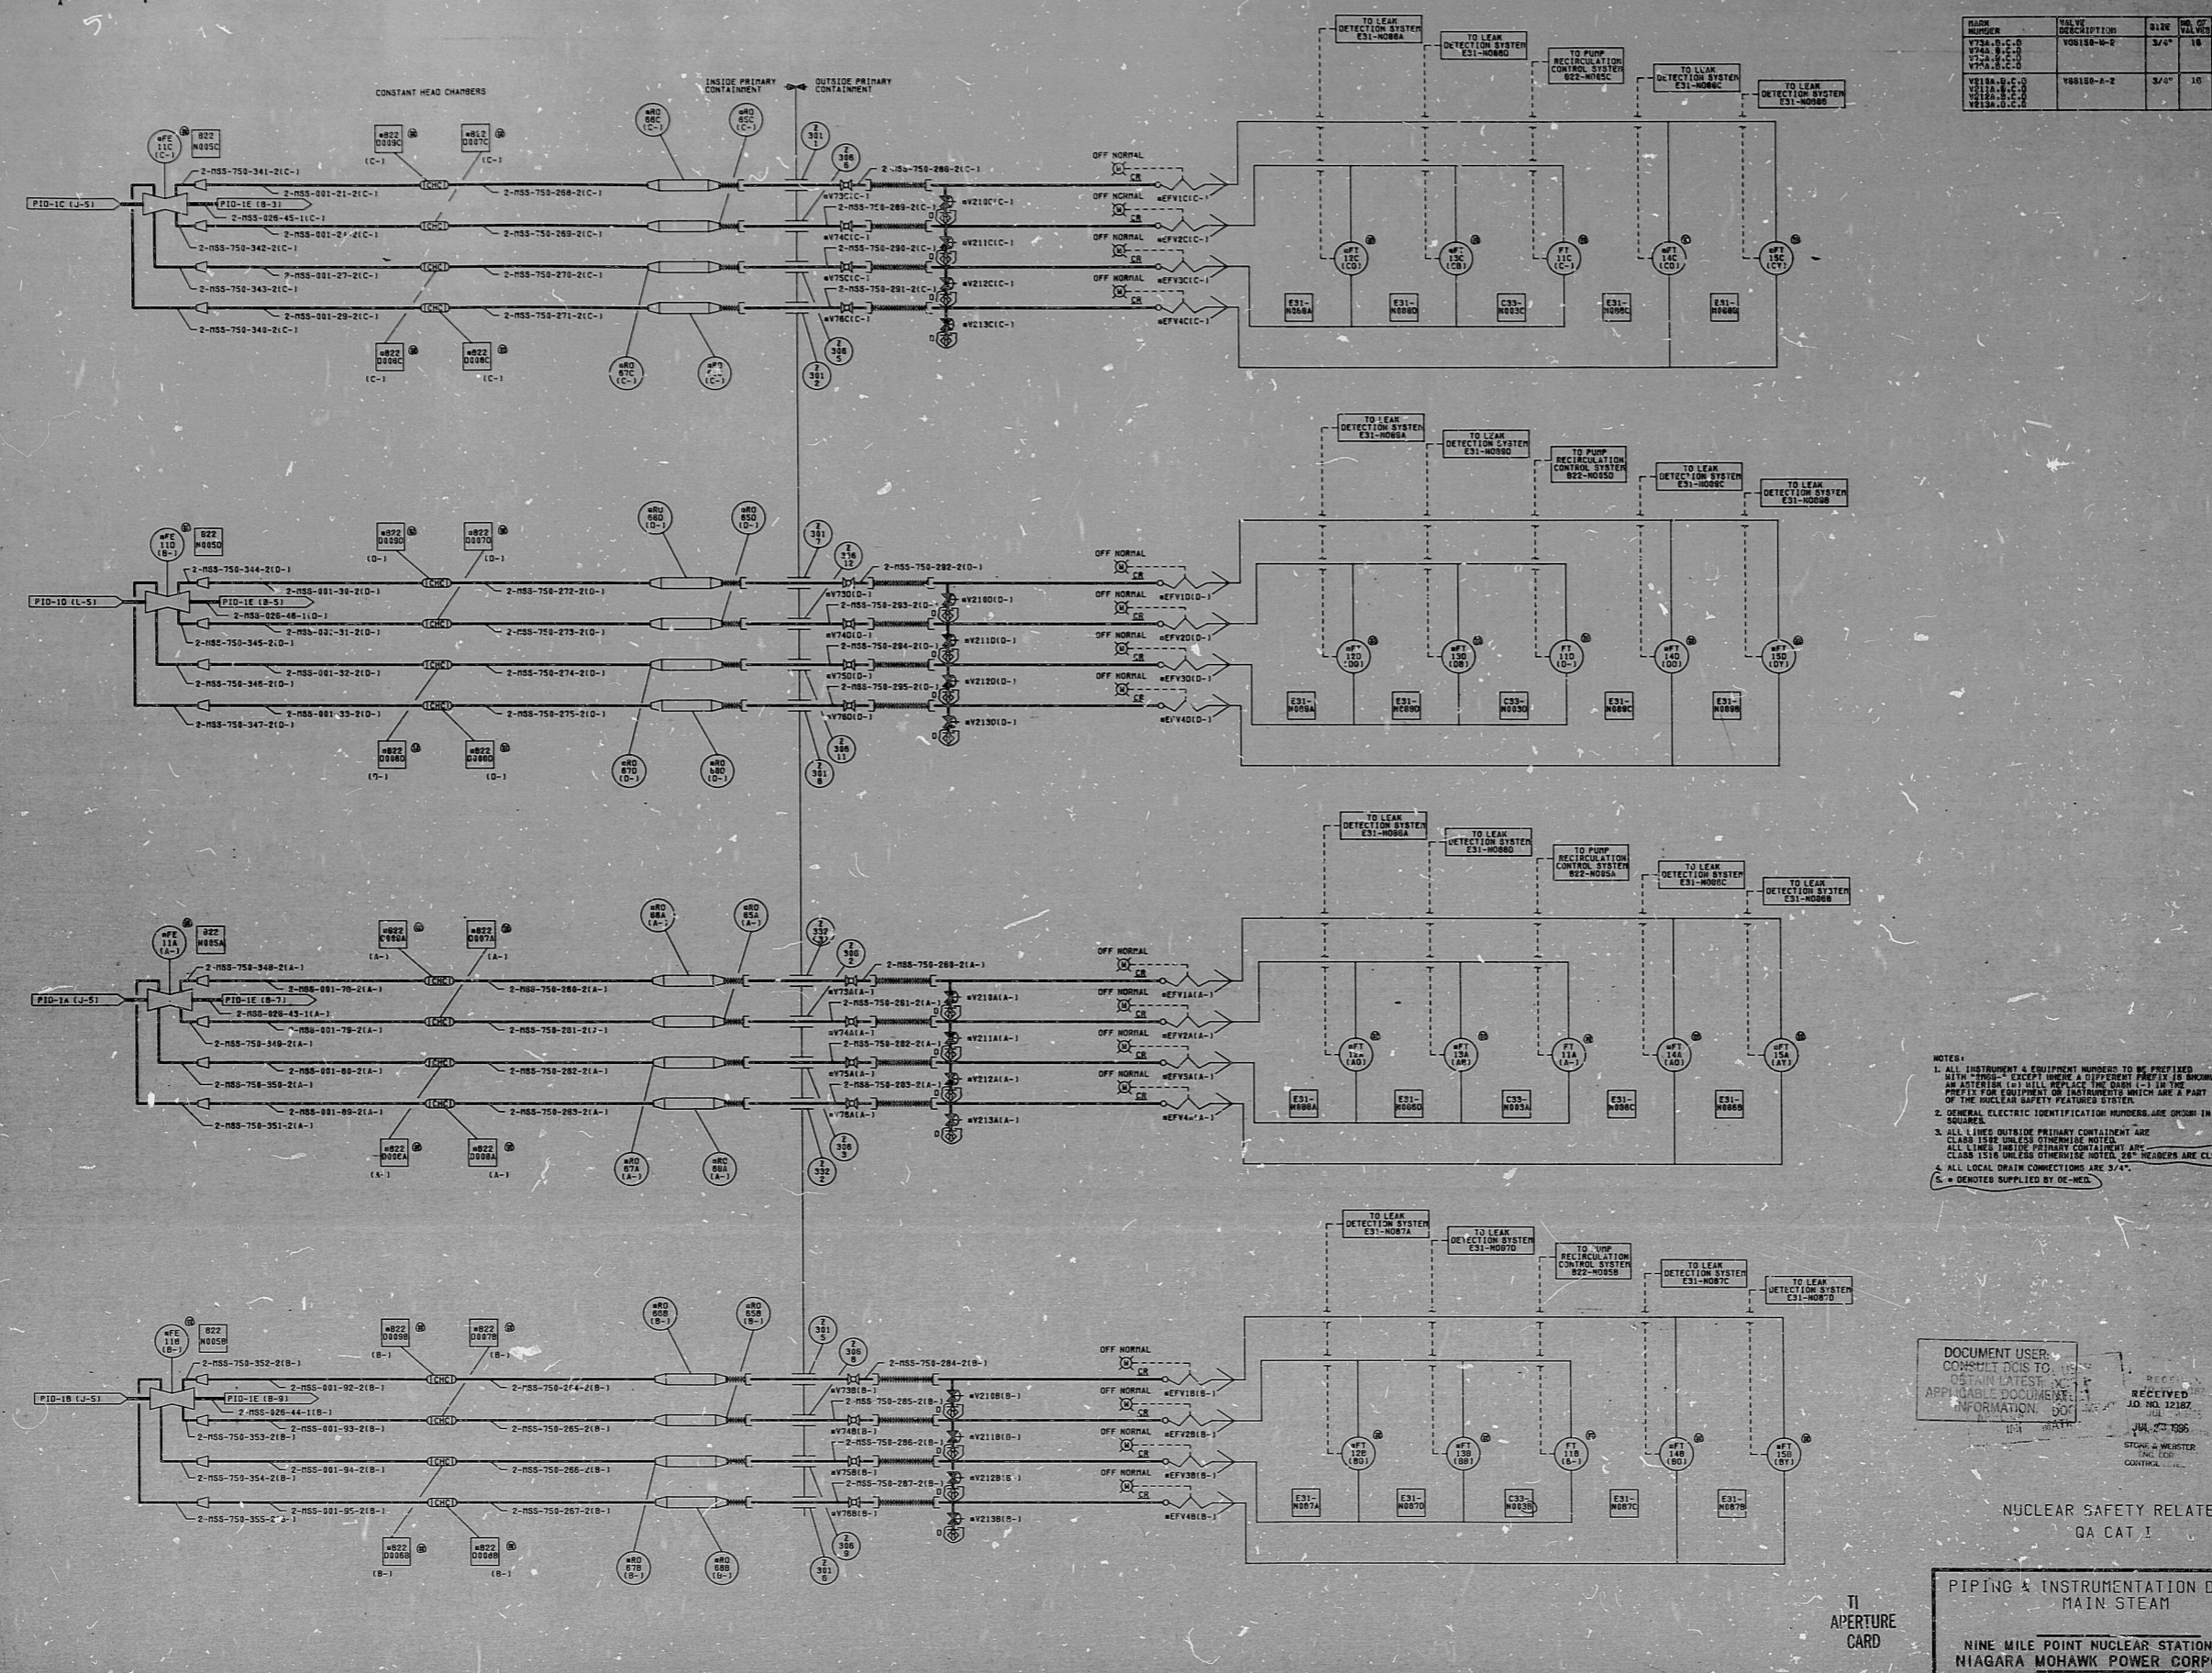

NAME	VALVE DESCRIPTION	SIZE	VAL. OF.
V22A, V22B, V22C	V0018B-0-0	3/4"	10
V22A, V22B, V22C	V0018B-0-0	3/4"	10
V22A, V22B, V22C	V0018B-0-0	3/4"	10

- NOTES:
1. ALL INSTRUMENT & EQUIPMENT NUMBERS TO BE PREFIXED WITH "7000" - EXCEPT INSTRUMENTS SHOWN IN THIS SYSTEM WHICH ARE PREFIXED WITH "7000".
 2. GENERAL ELECTRIC IDENTIFICATION NUMBERS ARE SHOWN IN SQUARES.
 3. ALL LINES OUTSIDE PRIMARY CONTAINMENT ARE CLEAR UNLESS OTHERWISE NOTED.
 4. ALL LOCAL DRAIN CONNECTIONS ARE 3/4".
 5. * DENOTES SUPPLIED BY GE-MED.

DOCUMENT USER
 CONSULT THIS TO
 OBTAIN LATEST
 APPROVED DOCUMENT
 INFORMATION. DO NOT
 USE OBSOLETE
 INFORMATION.

NUCLEAR SAFETY RELATED
 GA CAT I

TI
 APERTURE
 CARD

PIPING & INSTRUMENTATION DIAGRAM
 MAIN STEAM

NINE MILE POINT NUCLEAR UNIT 2
 NIAGARA MOHAWK POWER CORPORATION

STATE & WISCONSIN ENGINEERING REGISTRATION
 CHESTER HILL, PA.

NO.	DESCRIPTION	CHNG	CORRECT	DATE	ISSUE	NO.	DESCRIPTION	CHNG	CORRECT	DATE	ISSUE	NO.	DESCRIPTION	CHNG	CORRECT	DATE	ISSUE
1	AS TESTED ISSUE					2	INCORPORATES ECH NO'S					3	INCORPORATES ECH NO'S				

12177-PID-1-3

PDR RIDS

8709170386

