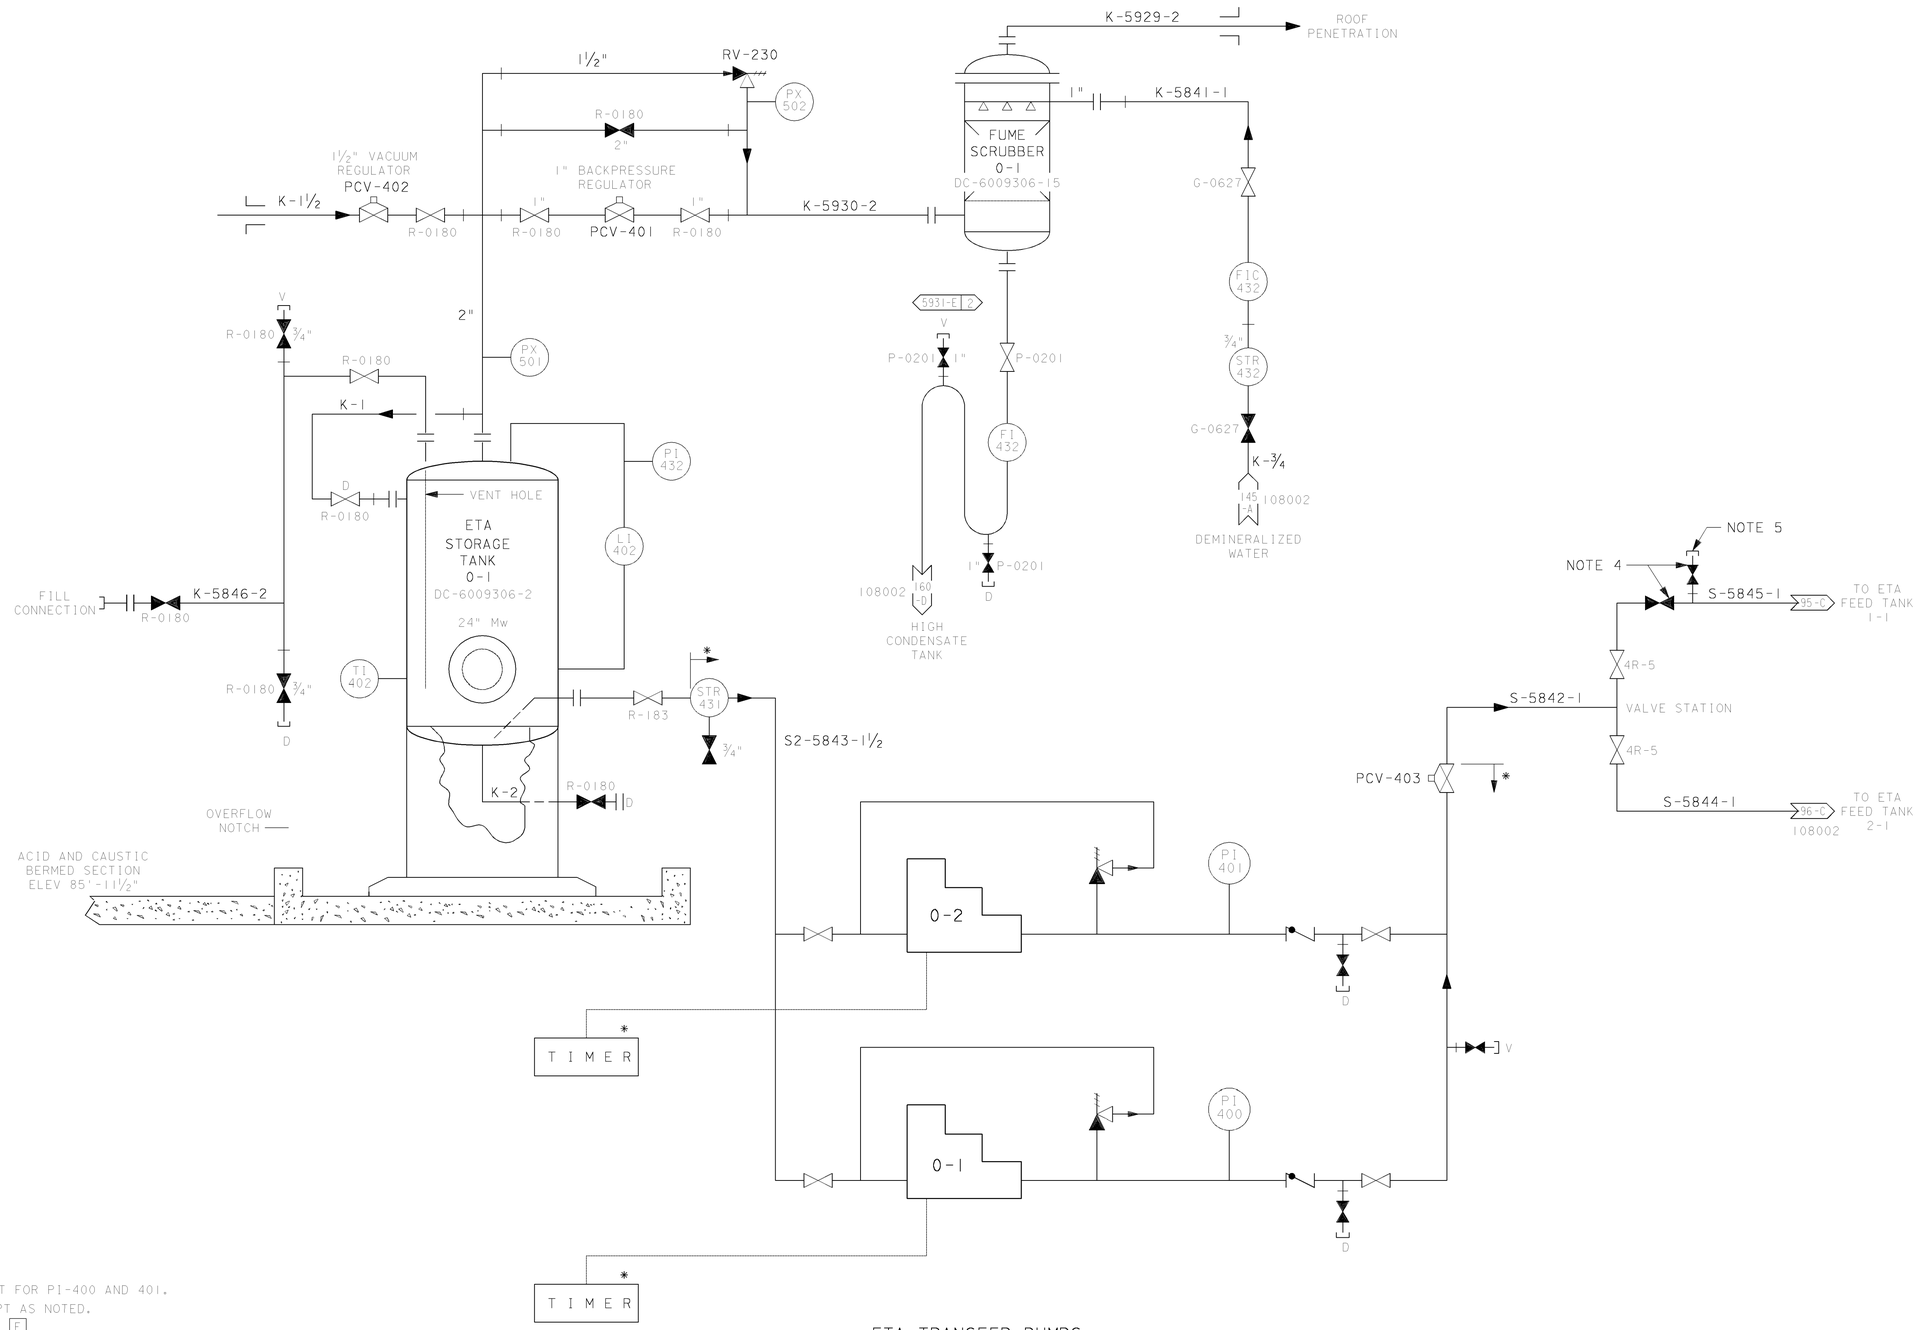


ETA TRANSFER PUMPS

DC-6009307-1

NOTES

1. * DENOTES VENDOR SUPPLIED PACKAGE EXCEPT FOR PI-400 AND 401.
2. ALL VENTS AND DRAINS ARE ½" SIZE, EXCEPT AS NOTED.
3. ALL PIPINGS ON THIS SHEET IS CODE CLASS E
4. VALVES ARE WHITEY MODEL SS-65TSW16T BALL VALVES WITH A TEFLON O-RING KIT.
5. CONNECTION IS FOR TEMPORARY CHEMICAL INJECTION TEST CONNECTION . THREADED CAP ON END OF PIPE.

UNIT 1

| P G & E CO. | | 102002 | REV. 103 |
|---|---|---|---|
| SHEET 9A | PAGE 0 | | |

| DATE | DWN | RE | IV | PROFESSIONAL ENGINEER | PE DISC. | PE# | PE EXP. | |
|---|---|---|---|---|---|---|---|---|
| 5/4/99 | CMG9 | FXC2 | - | KERSI J. DALAL | MECHANICAL | M 16690 | 3/31/2000 | Enhanced per FCT 023917 |

CAD User:CMG9 Date: 4-29-1999
DGN-2002S9A.DGN

3NP01C