


## NOTES: (CONT'D)

12. 1" GLOBE VALVE, ANCHOR DARLING 1878,  
STOCK CODE # 94-3771, DWG. 6006473-157 (30-B), (37-B), (35-B) (33-B)
13. 3/4" GLOBE VALVE, ANCHOR DARLING 1878 GB  
STOCK CODE # 94-2820, DWG. 6006473-97 (32-D), (34-A)
14. 3/4" GLOBE VALVE, ANCHOR DARLING 1878 GB  
STOCK CODE # 95-2755, DWG. 6006473-97 (32-D)
15. 3/4" CHECK VALVE, ANCHOR DARLING 1878 PC,  
S/C # 95-2427, DWG. 6011930-80 (38-D)
16. 3/4" GLOBE VALVE, ANCHOR DARLING 1878  
S/C 95-2755, DWG. 6011930-79 (30-A), (34-A)
17. 3/4" GLOBE VALVE, VELAN W04 9076Z-13AA  
S/C 95-1989 DWG. 6011929-3 (32-D)

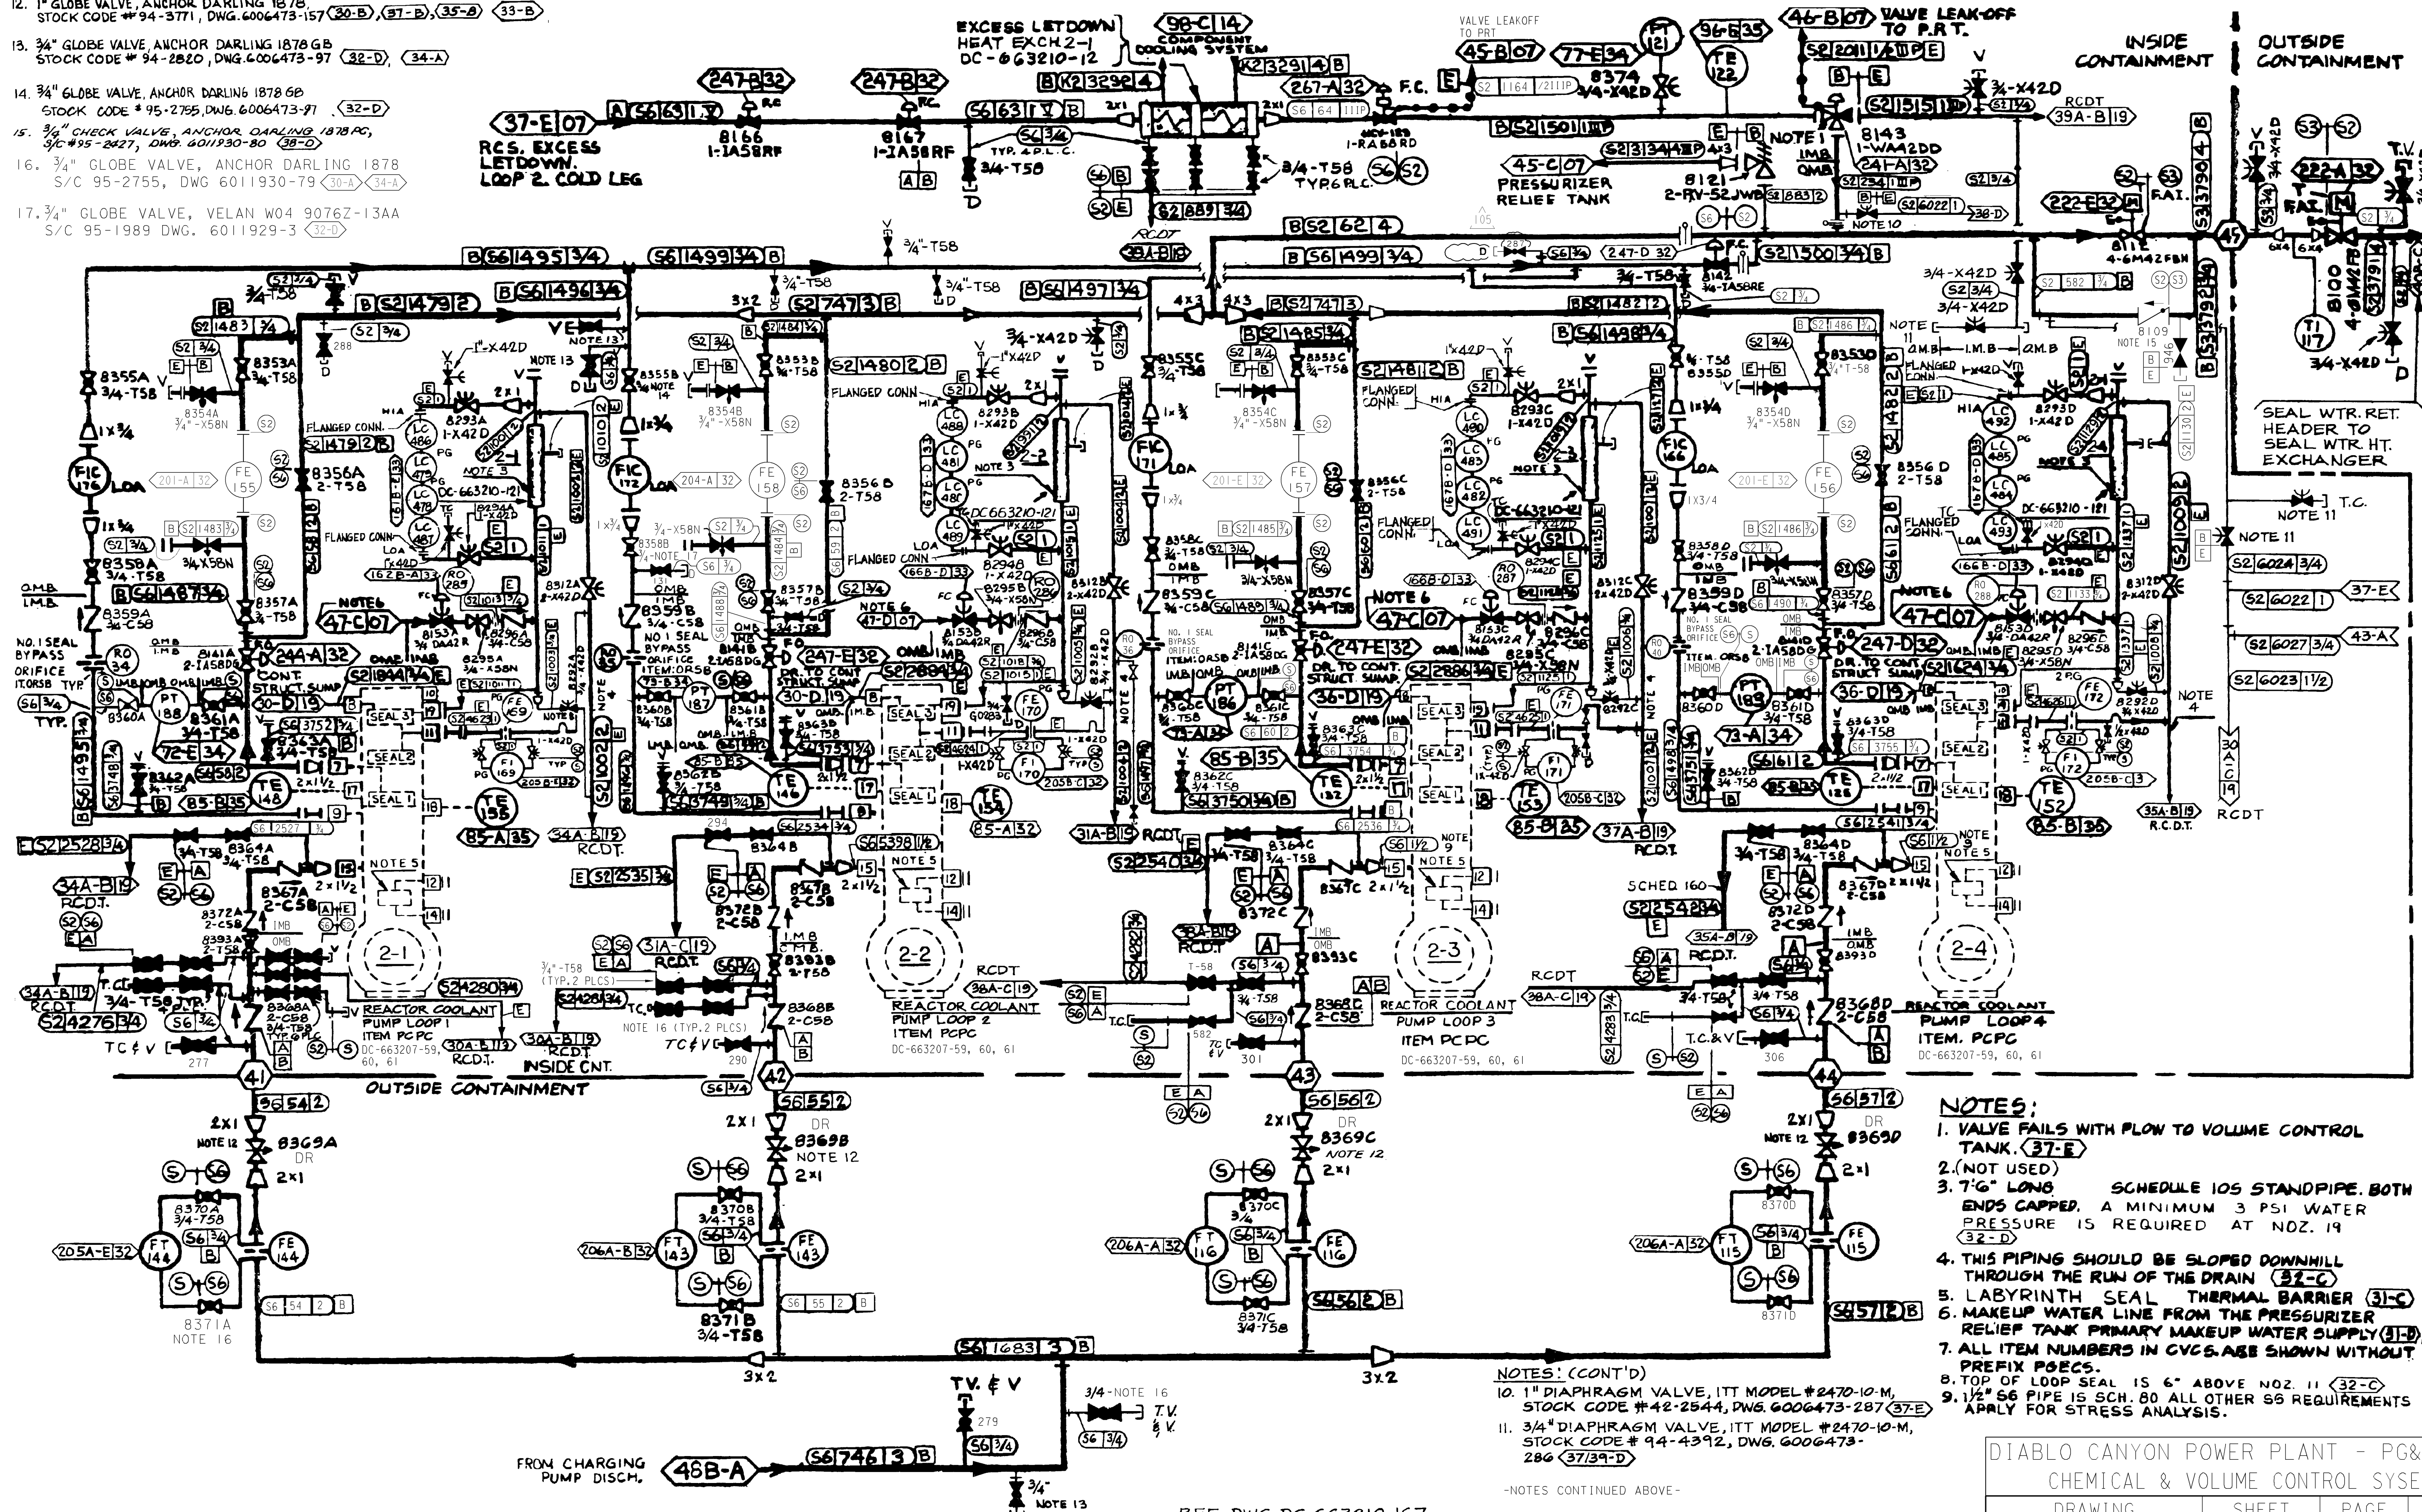

## NOTES:

1. VALVE FAILS WITH FLOW TO VOLUME CONTROL TANK. (37-E)
2. (NOT USED)
3. 7'-6" LONG SCHEDULE 10S STANDPIPE. BOTH ENDS CAPPED. A MINIMUM 3 PSI WATER PRESSURE IS REQUIRED AT NOZ. 19 (32-D)
4. THIS PIPING SHOULD BE SLOPED DOWNHILL THROUGH THE RUN OF THE DRAIN (32-C)
5. LABYRINTH SEAL THERMAL BARRIER (31-C)
6. MAKEUP WATER LINE FROM THE PRESSURIZER RELIEF TANK PRIMARY MAKEUP WATER SUPPLY (31-B)
7. ALL ITEM NUMBERS IN CYCLES ARE SHOWN WITHOUT PREFIX P0EC5.
8. TOP OF LOOP SEAL IS 6" ABOVE NOZ. 11 (32-C)
9. 1/2" S6 PIPE IS SCH. 80 ALL OTHER S6 REQUIREMENTS APPLY FOR STRESS ANALYSIS.

## NOTES: (CONT'D)

10. 1" DIAPHRAGM VALVE, ITT MODEL #2470-10-M, STOCK CODE #42-2544, DWG. 6006473-287 (37-E)
11. 3/4" DIAPHRAGM VALVE, ITT MODEL #2470-10-M, STOCK CODE # 94-4392, DWG. 6006473-286 (37/39-D)

-NOTES CONTINUED ABOVE-

REF. DWG. DC-663210-167

DIABLO CANYON POWER PLANT - PG&E CO.  
CHEMICAL & VOLUME CONTROL SYSTEM

UNIT 2

108008

3

0105