


BY: R.M.L. DATE: _____ SUBJECT: NEBRASKA PUBLIC POWER DISTRICT SHEET NO. _____ OF _____
 CHKD. BY: DATE: _____ COPPER NUCLEAR STATION JOB NO. 2520-02
 INSTALLATION DETAILS: TEMPERATURE DETECTORS FOR NUCLEAR BOILER SYSTEMS LEAK DETECTION

REV. NO. 7

ILL-E-70-3 SHT. NO. 107 F
 DWG NO. I.D.-105 SHEET-7

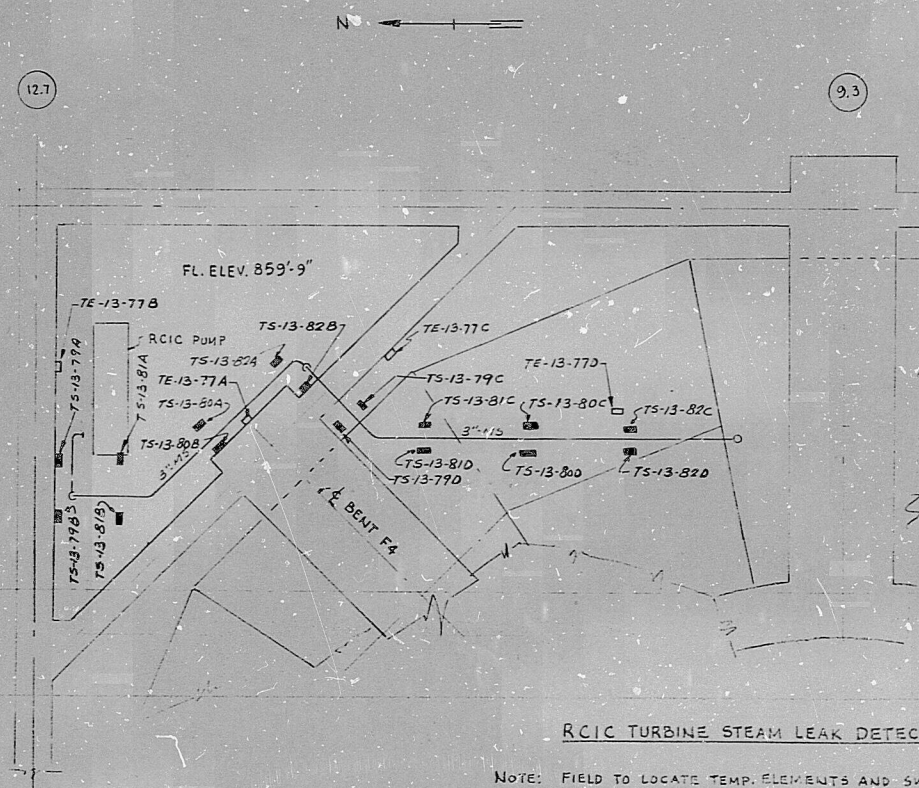


RECEIVED
 FILMED
 N.P.P.D., D.C.C.
 S/N 1807

NON-CONTROLLED PRINT
 MAY 07 1999
 NPPD PAC

RCIC TURBINE STEAM LEAK DETECTION

NOTE: FIELD TO LOCATE TEMP. ELEMENTS AND SWITCHES ABOVE STEAM PIPING APPROX. AS SHOWN, AND TO CLEAR ALL OBSTRUCTIONS.
 FOR MOUNTING DETAILS OF TS-13-77 SEE GE. DWG. 145C3018
 FOR MOUNTING DETAILS OF TS-13-79 THRU 82 SEE DWG. NO. I.D.-105 SHT. 2

NOV. 30, 1977 N.P.P.D.



APERTURE
 CARD

9907090031

PDR RIDS

9907090031

